

PROJECT DATA

PROPERTY OWNER: MR. AND MRS. DAVID BROWN 1100 ALLIED DR.,

PLANTO, TX 75093 TEL. (214) 235-6010

PROJECT ADDRESS: SW CORNER OF GUADALUPE AND 4TH, CARMEL, CA 93923

PROJECT DESCRIPTION: REMOVE (E) SHEDS (175 SF). DEMOLISH (E) ATTACHED GARAGE (274 F) AND BUILD A NEW ATTACHED GARAGE (270 SF). EXTEND (E) HOUSE BY 391 SF. NEW UPPER LEVEL ADDITION (637 SF) WITH TERRACE (216 SF). NEW ATTACHED SHED (STORAGE) WITH CEILING HEIGHT NOT TO EXCEED 4'-11" (43 SF). NEW TRASH CAN

ENCLOSURE. NEW OUTDOOR BUILT-IN BBQ, FIRÈPLACE WITH RECIRCULATING FOUNTAIN, AND GENERATOR. REPLACE DETERIORATED GRAPE STAKE FENCE ALONG PRIVATE ROAD WITH NEW TO MATCH EXISTING HEIGHT (77 L.F.).

EXISTING GRADING, DRAINAGE, AND LANDSCAPING TO REMAIN

LOT AND BLOCK: LOT 1, BLOCK 45 010-036-001-000 ZONING: R-1 (CP)

TYPE OF CONSTRUCTION: V-BR-3, U OCCUPANCY:

EXISTING - 1, PROPOSED - 2 STORIES: 24' (EXISTING HEIGHT - 13'-11 3/8", PROPOSED HEIGHT - 21'-1 3/8") HEIGHT LIMIT:

NONE GRADING: TREE REMOVAL:

APPLICABLE CODES: 2022 CALIFORNIA BUILDING CODE (CBC), 2022 CALIFORNIA RESIDENTIAL CODE (CRC), 2022 CALIFORNIA FIRE CODE (CFC), 2022 CALIFORNIA PLUMBING CODE

(CPC), 2022 CALIFORNIA ELECTRICAL CODE (CEC), 2022 CALIFORNIA MECHANICAL CODE (CMC), 2022 CALIFORNIA ENERGY CODE (CEnC), 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN)

8,000 SF LOT AREA:

7,200 SF BUILDABLE AREA: 2,779 SF (BASE FLOOR AREA) FLOOR AREA ALLOWED:

FLOOR AREA CALCULATIONS

HOUSE	EXISTING FLOOR AREA	DEMOLITION	ADDITION	PROPOSED FLOOR AREA
HOUSE MAIN LEVEL	1,481 S.F.	0 S.F.	391 S.F.	1,872 S.F.
HOUSE UPPER LEVEL	0 S.F.	0 S.F.	637 S.F.	637 S.F.
GARAGE (INCL. MECH. ROOM)	274 S.F.	274 S.F.	270 S.F.	270 S.F.
SHED	132 S.F.	132 S.F.	0 S.F.	0 S.F.
SHED	43 S.F.	43 S.F.	0 S.F.	0 S.F.
	1.930 S.F.	449 S.F.	1,298 S.F.	2,779 S.F.

FLOOR AREA PROPOSED 2,779 SF

ADU (UNDER A SEPARATE PERMIT) FLOOR AREA - 672 SF

SITE COVERAGE CALCULATIONS

SITE COVERAGE ALLOWED: 22% OF BASE FLOOR AREA = 611 S.F.

* 4% OF SITE FOR DRIVEWAY (IF 50% OF COVER. IS PERMEABLE) = 288 SF TOTAL ALLOWED - 899 S.F.

	EXISTING	REMOVED	ADDITION/NEW	PROPOSED TOTAL
DRIVEWAY (CONC. REPLACED W/ PERMEABLE)	277 S.F.	277 S.F.	313 S.F.	313 S.F.
FRONT PATHWAY (CONC. REPLACED W/ CHIPS)	109 S.F.	109 S.F.	0 S.F.	0 S.F.
ENTRY DOOR LANDING	65 S.F.	65 S.F.	21 S.F.	21 S.F.
PERMEABLE PAVERS LANDING (COURTYRD)	71 S.F.	71 S.F.	201 S.F.	201 S.F.
STONE STEPS (COURTYRD)	71 3.1.	71 3.1.	56 S.F.	56 S.F.
MASTER BDRM. CONC. LANDING AND STEPS	0 S.F.	0 S.F.	51 S.F.	51 S.F.
BBQ PAD	0 S.F.	0 S.F.	46 S.F.	46 S.F.
FIREPLACE/FOUNTAIN PAD	0 S.F.	0 S.F.	46 S.F.	46 S.F.
TRASH ENCLOSURE	0 S.F.	0 S.F.	46 S.F.	46 S.F.
GENERATOR CONC. PAD	0 S.F.	0 S.F.	12 S.F.	12 S.F.
LAUNDRY LANDING AND STEPS	0 S.F.	0 S.F.	21 S.F.	21 S.F.
SHED (CEILING HEIGHT 4'-11")	0 S.F.	0 S.F.	43 S.F.	43 S.F.
	522 S.F.	522 S.F.	856 S.F.	856 S.F.

NOTE: 1,736 SF OF CONCRETE PATIO AND SWIMMING POOL WAS REMOVED UNDER A SEPARATE PERMIT FOR ADU

SITE COVERAGE PROPOSED: 856 S.F. (PERMEABLE – 560 SF, IMPERVIOUS – 296 SF)





ANATOLY OSTRETSOV

P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

REVISIONS:


07-04-23 PLANNING REVISIONS <u>/2</u> <u>10-11-23</u> PLANNING REVISIONS


SITE PLAN **PROPOSED**

DATE: 04-02-23 **DESIGN APPROVAL**

SHEET NO.

A1.0

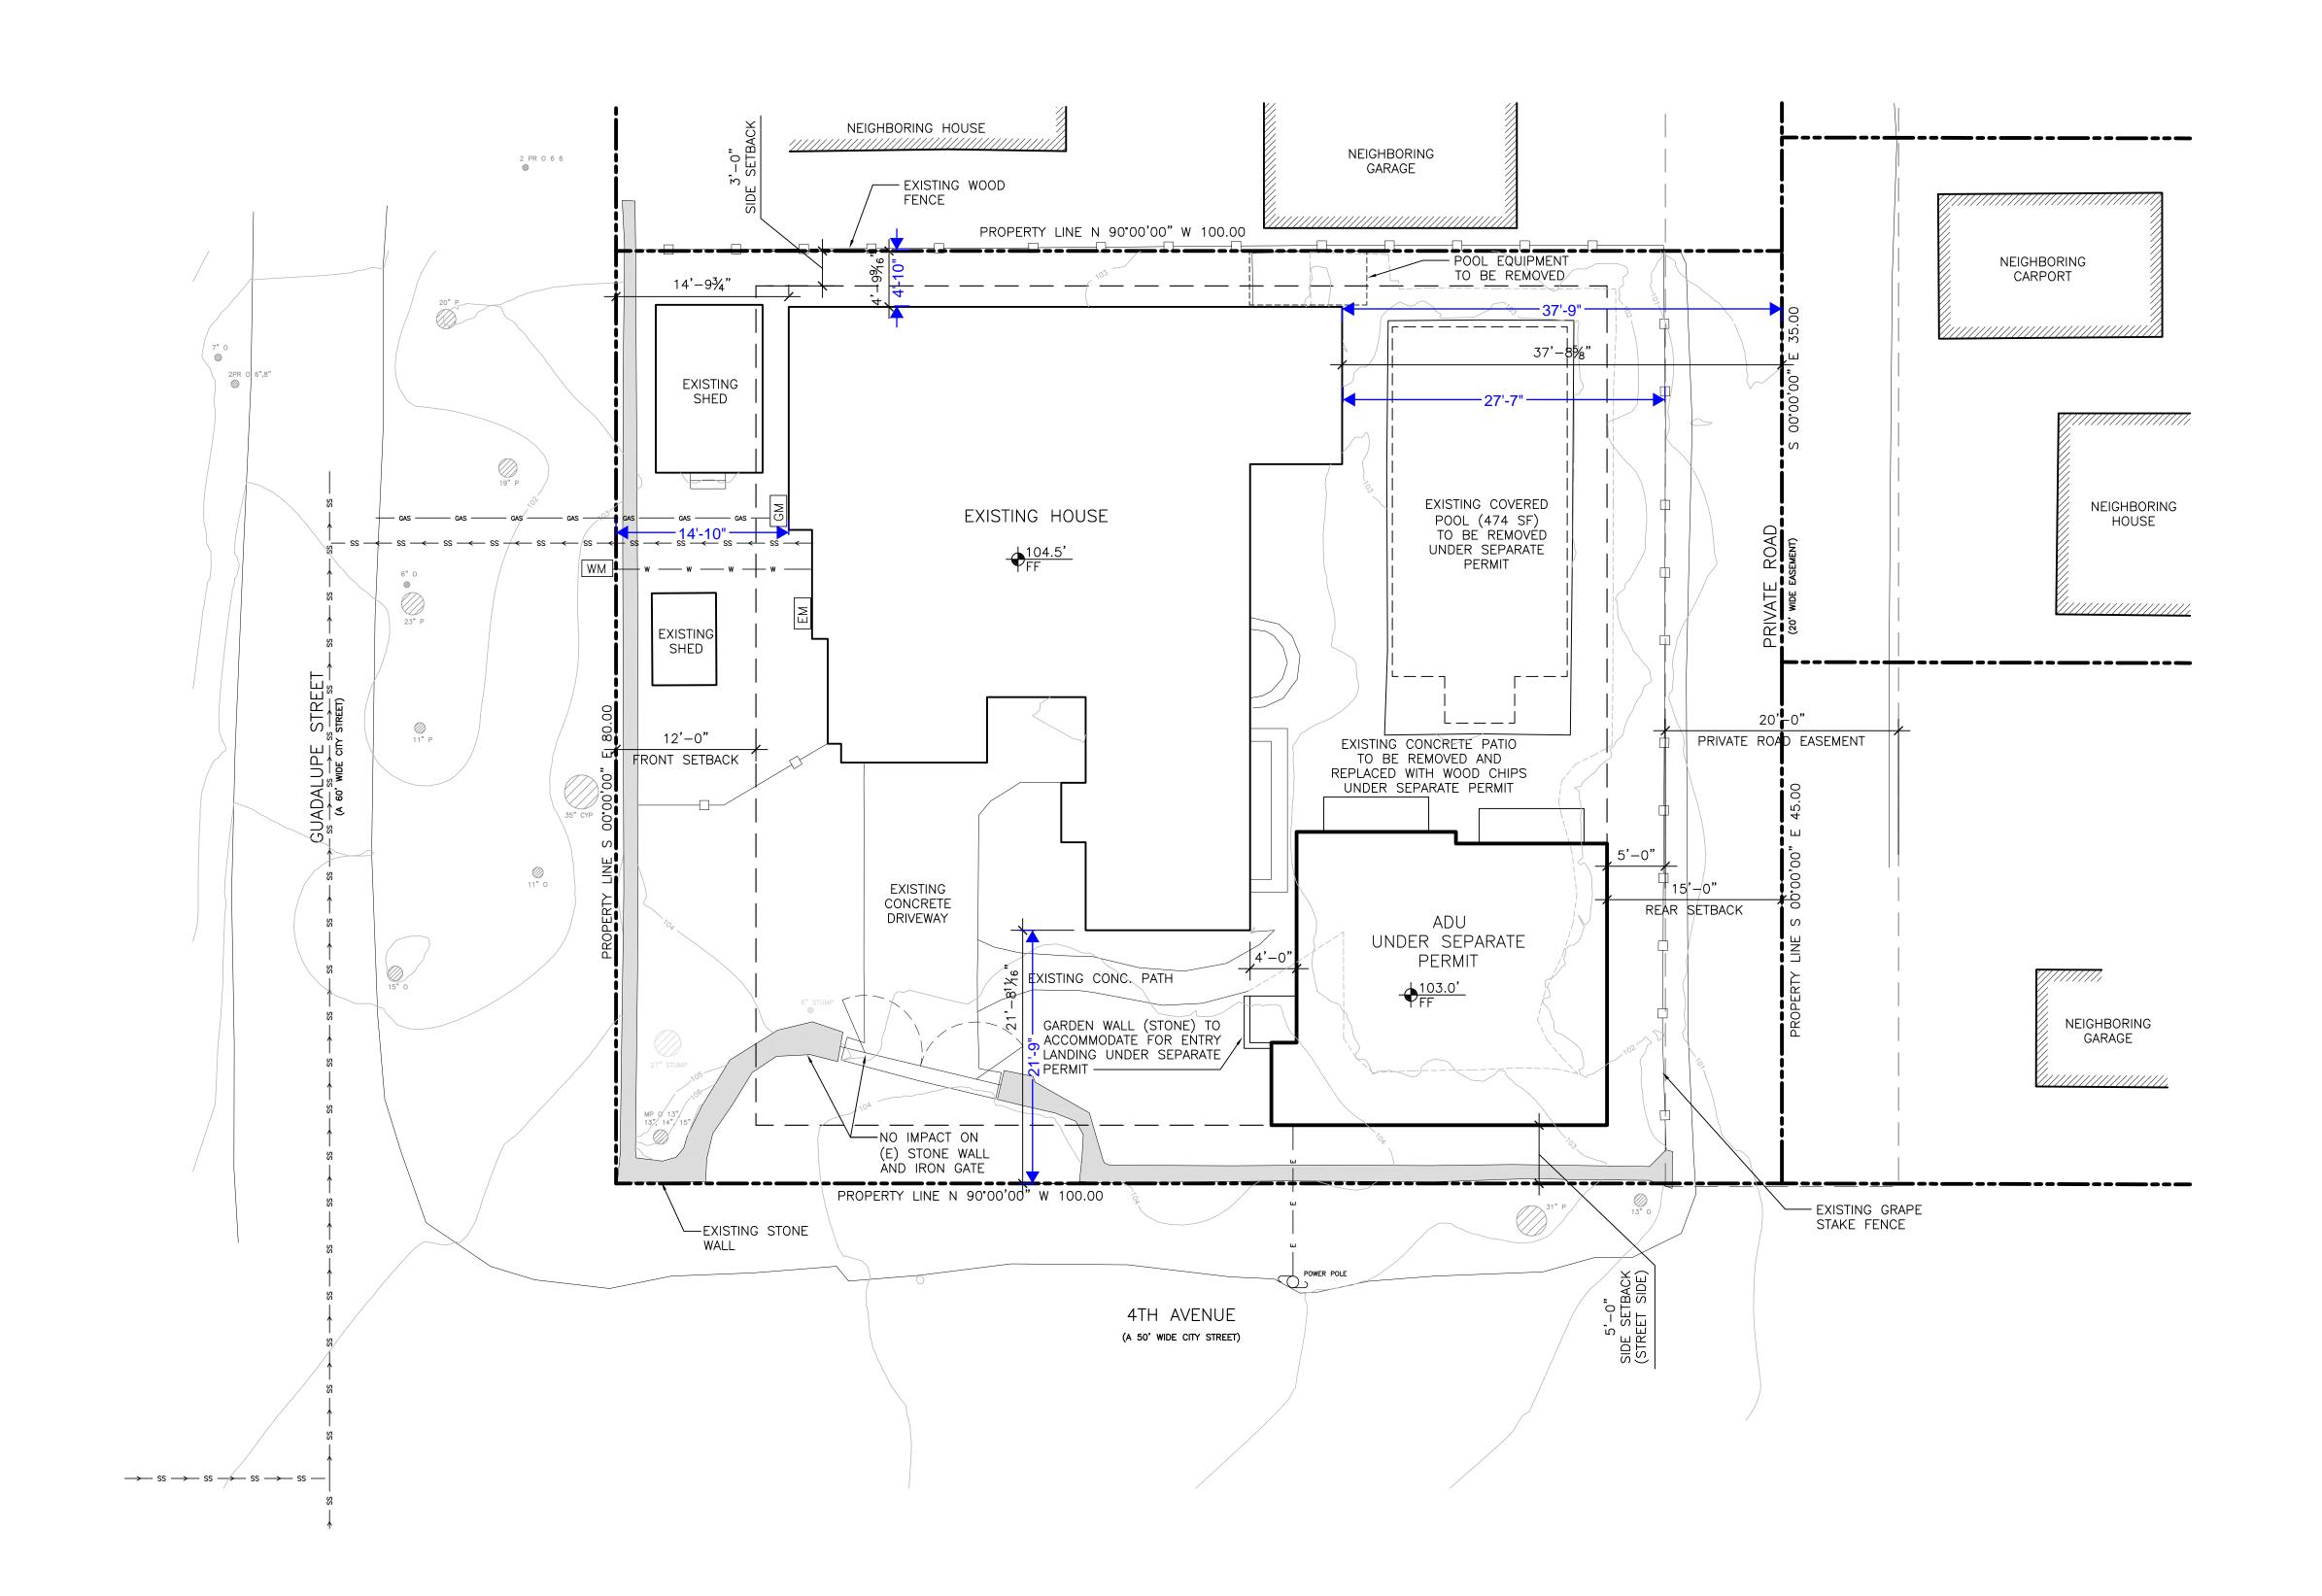



1/8"=1'-0"

EXISTING SITE PLAN

ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942

(831) 682-1331 anatoly@aoarchdesign.com


REVISIONS: 07-04-23
PLANNING REVISIONS

SITE PLAN **EXISTING**

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

A1.1

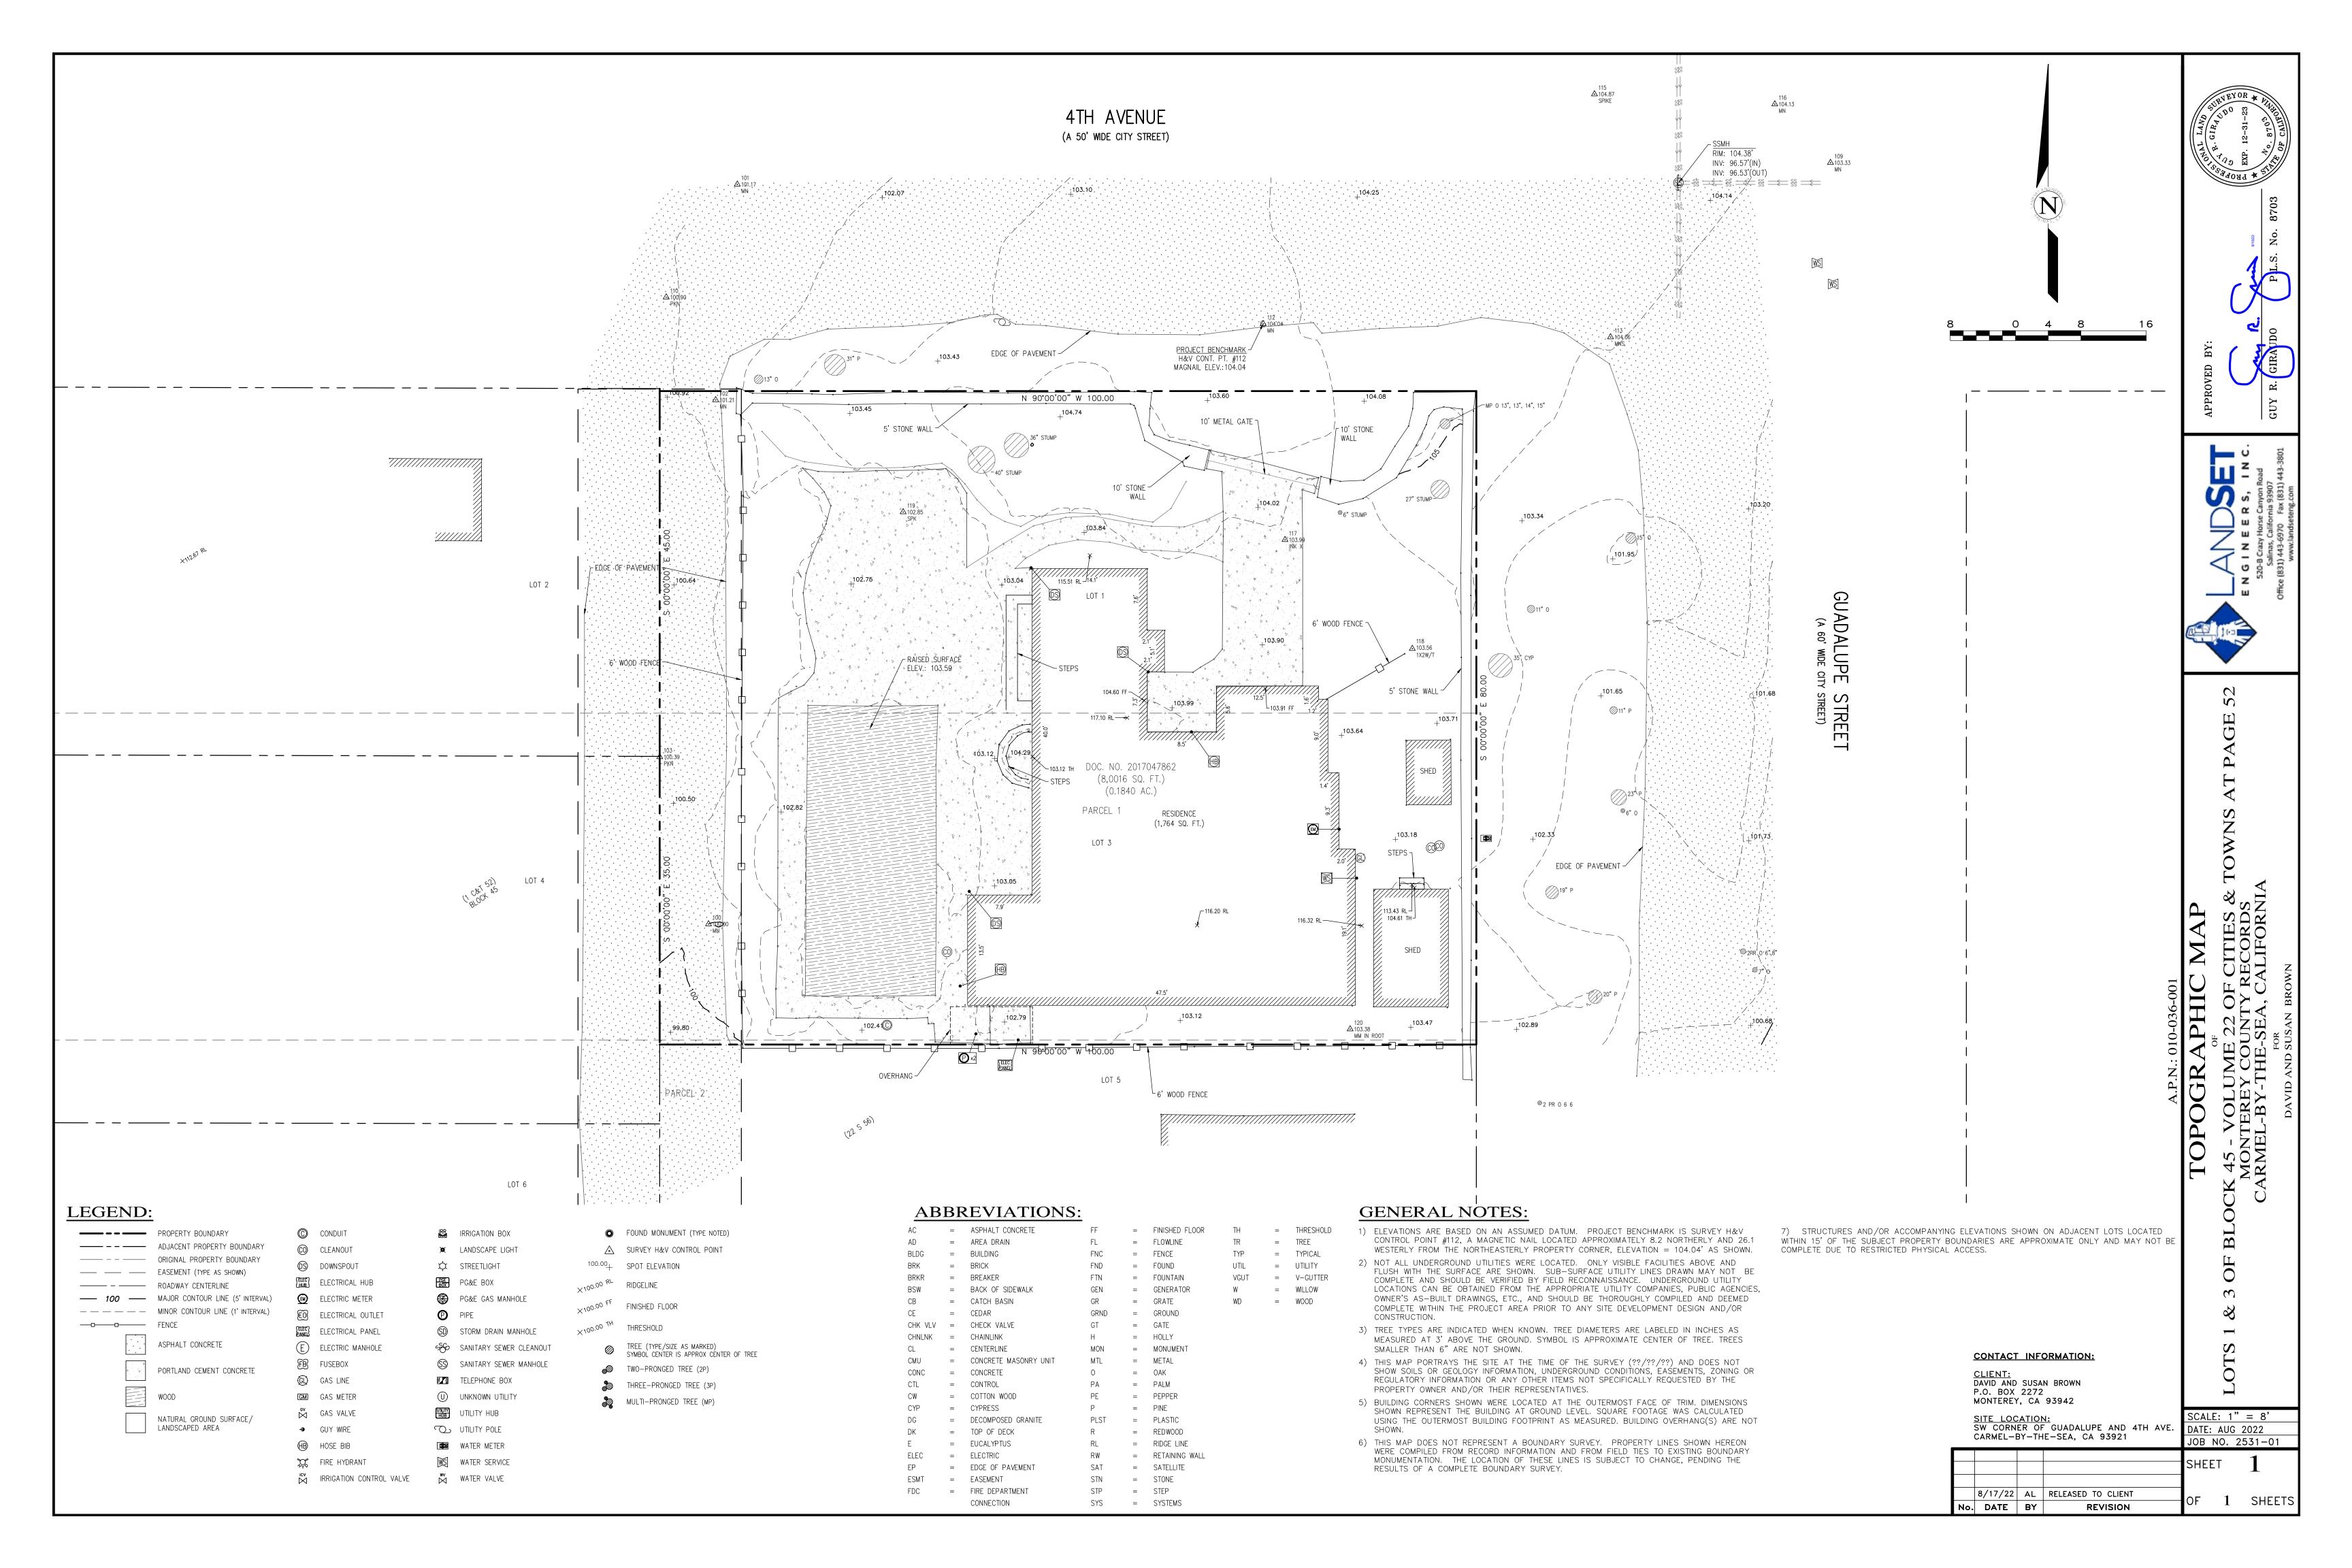


NEIGHBORHOOD STUDY

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

A1.2

NEIGHBORHOOD STUDY

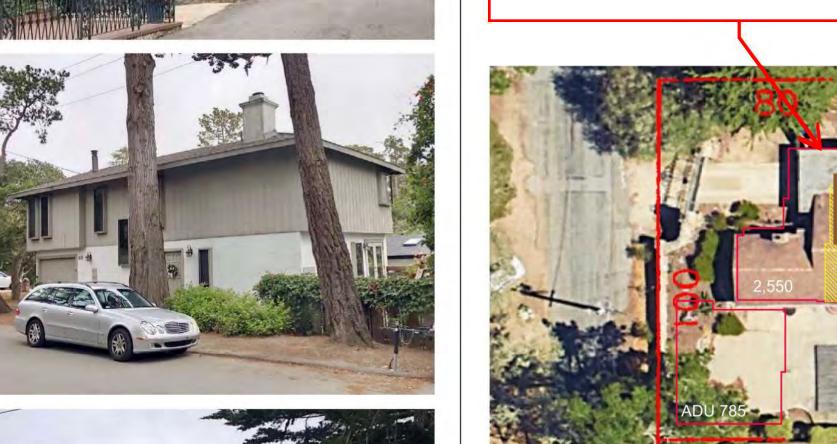

SUBJECT PROPERTY

LOT SIZE - 8,000 SF

ROOF OUTLINE - 2,550 SF = 32% OF LOT SIZE

ROOF OUTLINE (INCL. ADU) - 3,335 SF = 41.6% OF LOT SIZE

SECOND FLOOR OUTLINE (SHOWN WITH BROWN COLOR) - 730 SF = 9%

BUILDING COVERAGE IS BETTER THAN IN MORE THAN 90% OF MEASURED

BUILDING COVERAGE (INCL. ADU) IS BETTER THAN IN MORE THAN 50% OF















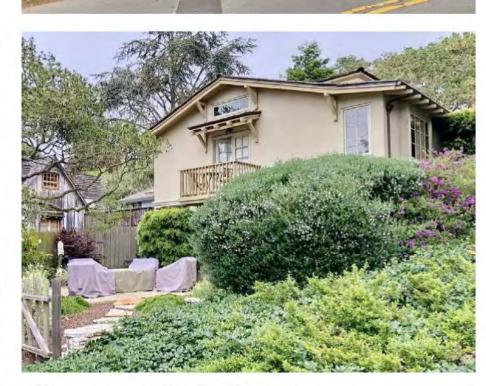



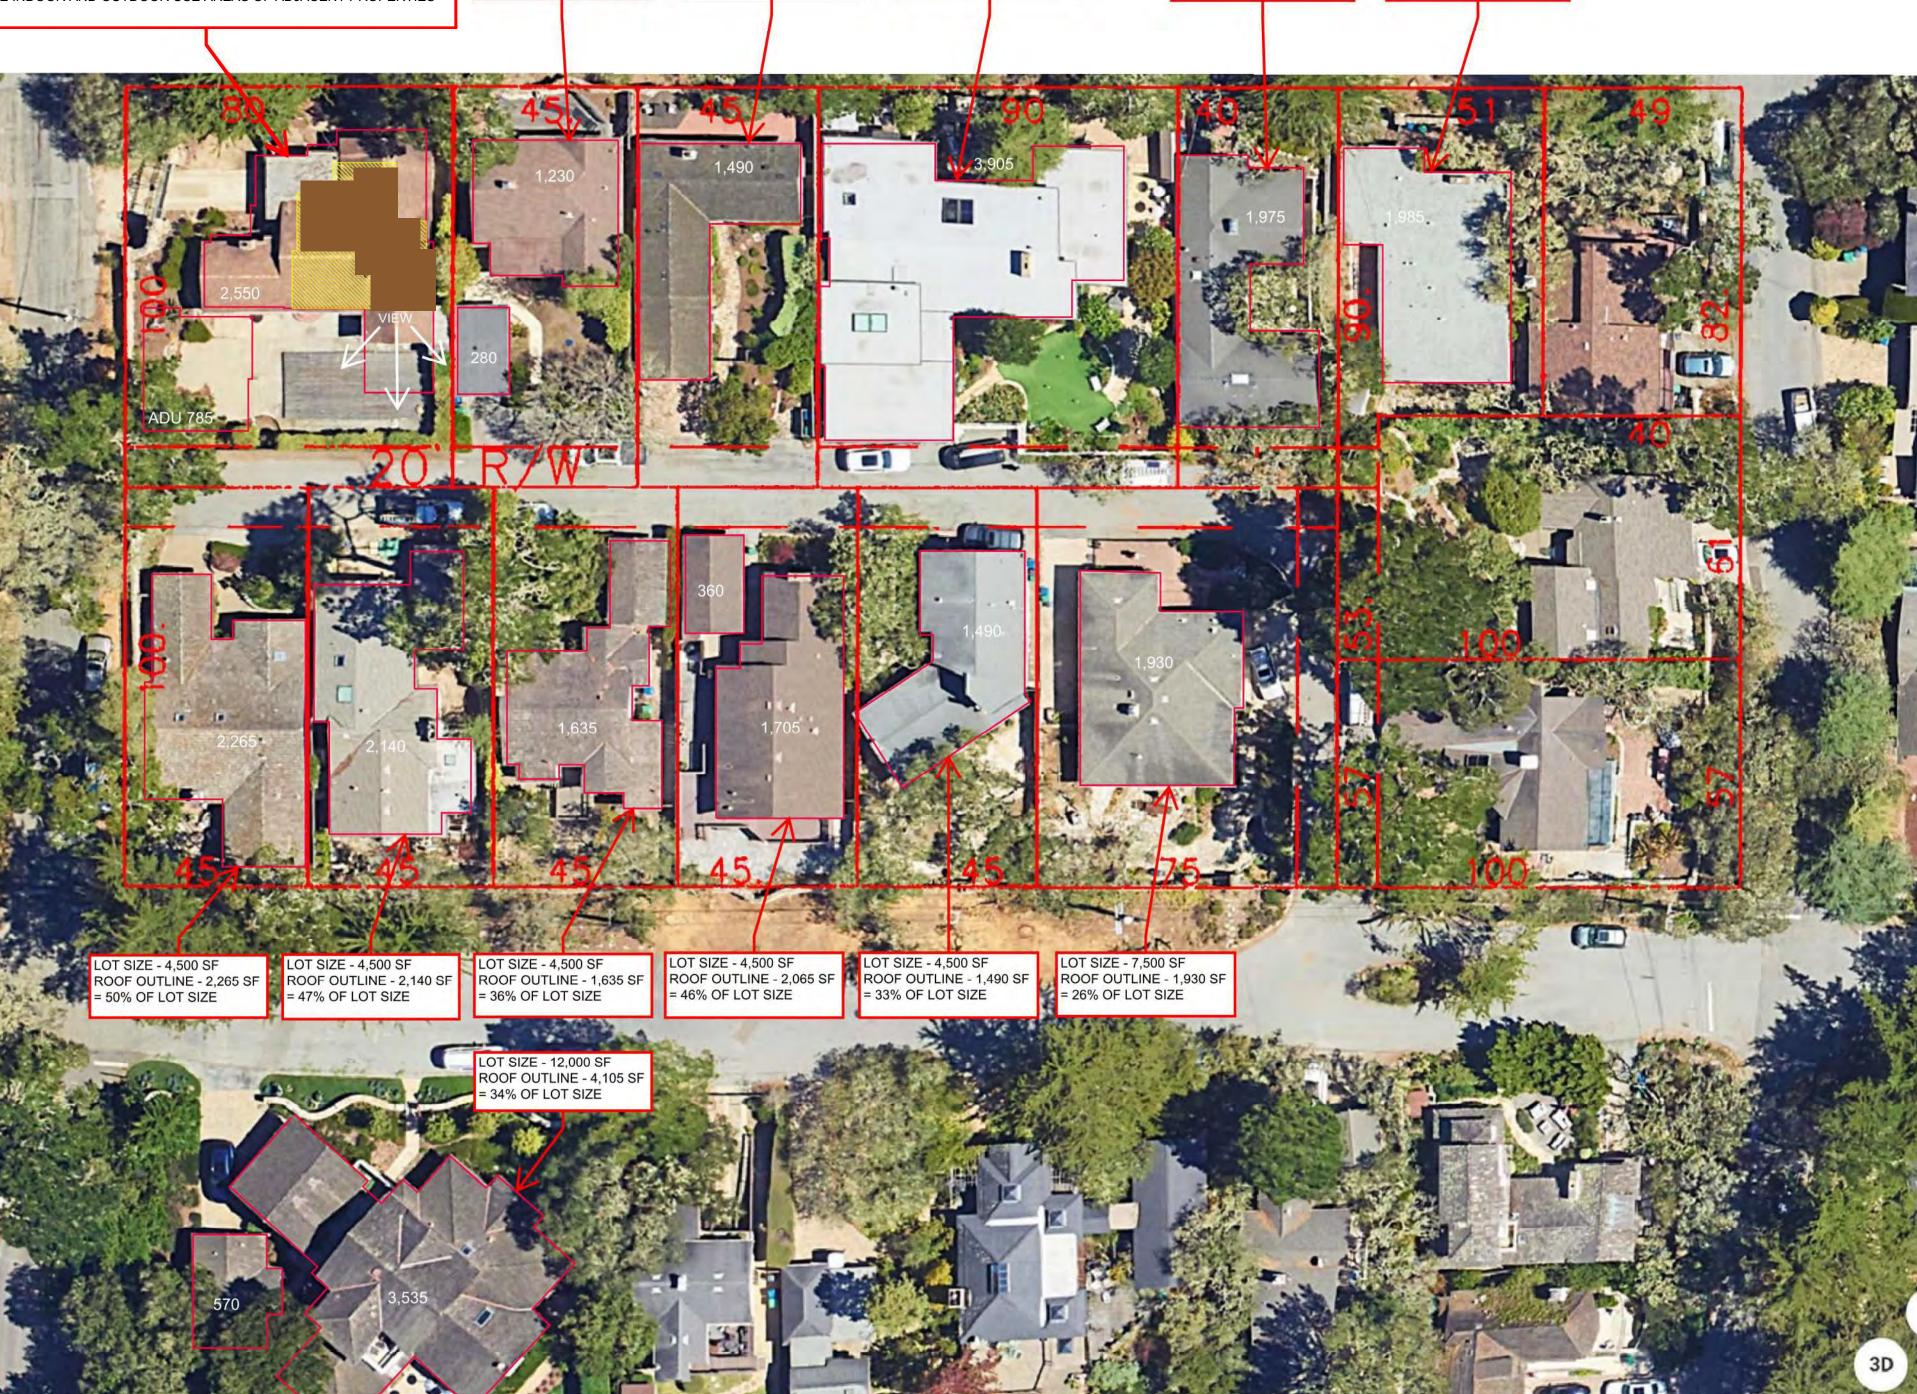

LOT SIZE - 9,000 SF

= 43% OF LOT SIZE

ROOF OUTLINE - 3,905 SF

LOT SIZE - 4,500 SF ROOF OUTLINE - 1,510 SF = 33% OF LOT SIZE

LOT SIZE - 4,500 SF

ROOF OUTLINE - 1,510 SF = 34% OF LOT SIZE

LOT SIZE - 4,300 SF+/_ ROOF OUTLINE - 1,985 SF

= 46% OF LOT SIZE

LOT SIZE - 4,000 SF ROOF OUTLINE - 1,975 SF

= 49% OF LOT SIZE




ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

07-04-23
PLANNING REVISIONS
10-11-23
PLANNING REVISIONS

STREETSCAPE **ELEVATIONS**

DATE: 04-02-23 DESIGN APPROVAL

A1.3

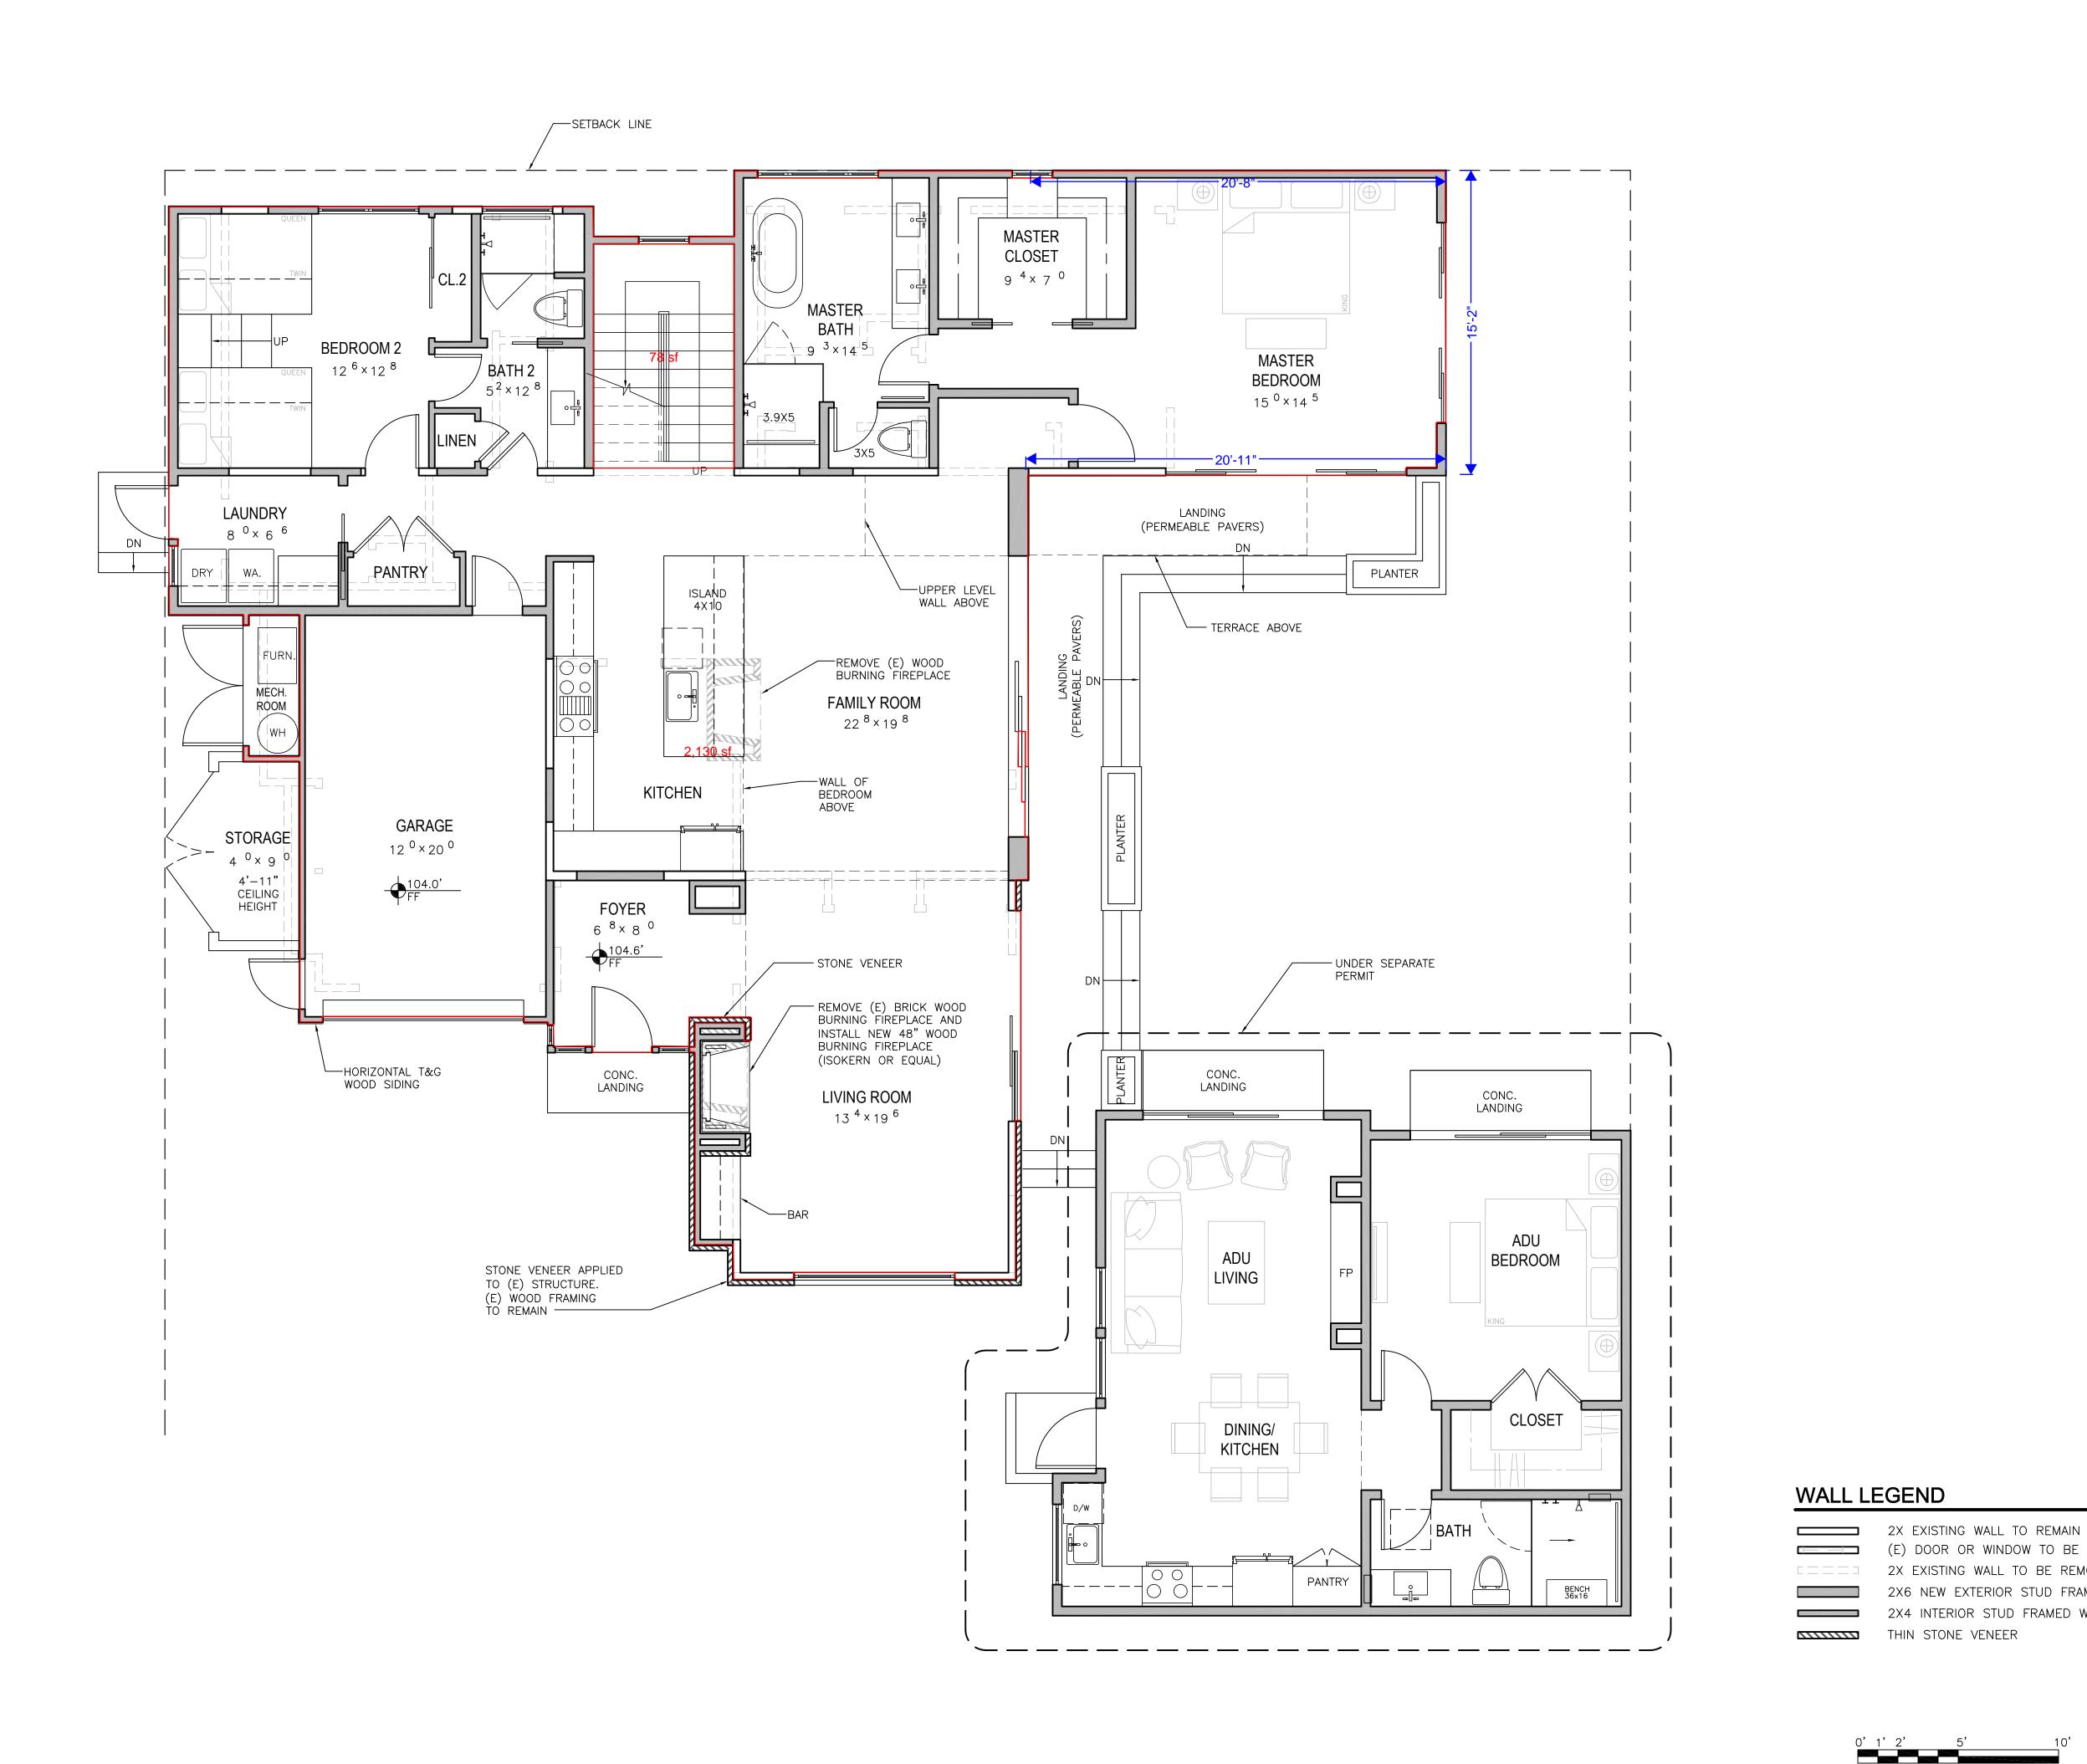



ANATOLY OSTRETSOV P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

REVISIONS:

07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

MAIN LEVEL FLOOR PLAN

DATE: 04-02-23 DESIGN APPROVAL

A2.0

SHEET NO.

MAIN LEVEL FLOOR PLAN


(E) DOOR OR WINDOW TO BE REMOVED

2X6 NEW EXTERIOR STUD FRAMED WALL

2X EXISTING WALL TO BE REMOVED

2X4 INTERIOR STUD FRAMED WALL

1/4"=1'-0"

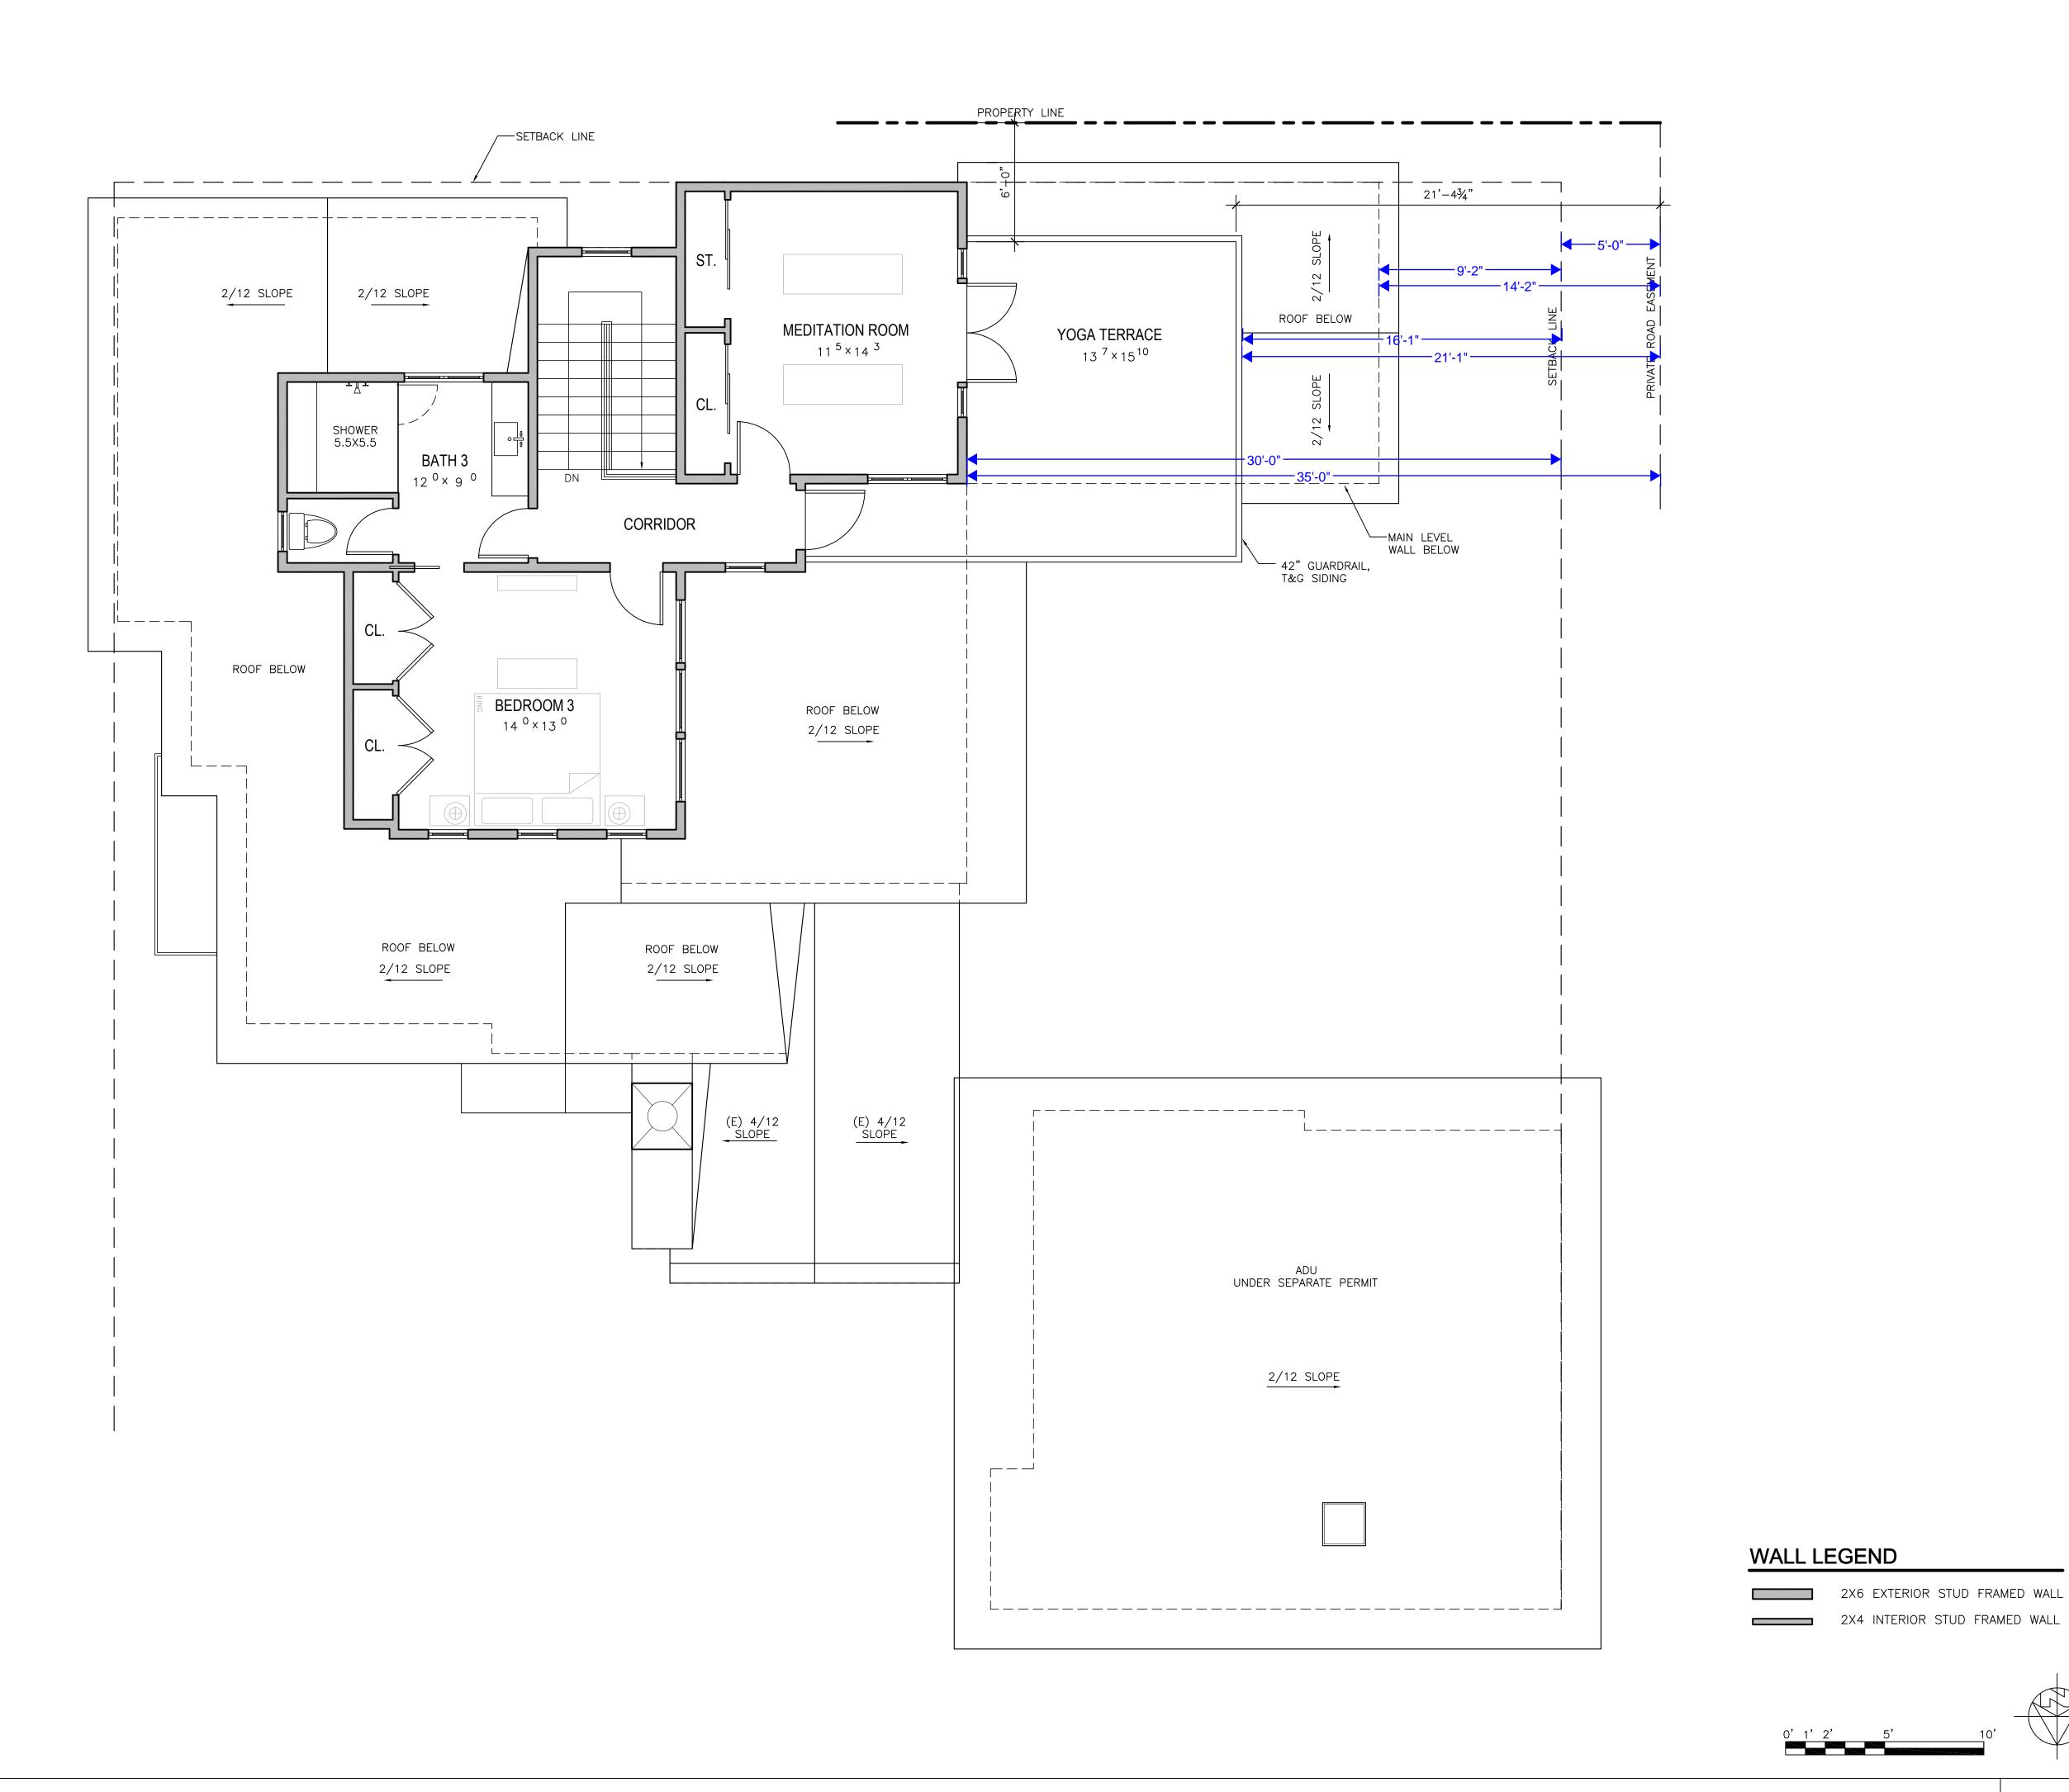



ANATOLY OSTRETSOV
P.O.BOX 2272
MONTEREY, CA 93942

P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

(831) 682-1331 oly@aoarchdesign.co

MEL. CA 93923

STOWN THUIDING

_ П П

V CORNER OF GUADAL

EMOLONO.

07-04-23
PLANNING REVISIONS

10-11-23
PLANNING REVISIONS

3

UPPER LEVEL FLOOR PLAN

DATE: 04-02-23
DESIGN APPROVAL

A2.1

SHEET NO.

UPPER LEVEL FLOOR PLAN 1/4"=1'-0"





P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

REVISIONS:

<u>07-04-23</u>
<u>PLANNING REVISIONS</u>

<u>10-11-23</u>
<u>PLANNING REVISIONS</u>

MAIN LEVEL DIMENSION PLAN

DATE: 04-02-23 DESIGN APPROVAL

A3.0

SHEET NO.

MAIN LEVEL DIMENSION PLAN

THIN STONE VENEER

2X EXISTING WALL TO REMAIN

(E) DOOR OR WINDOW TO BE REMOVED


2X6 NEW EXTERIOR STUD FRAMED WALL

2X EXISTING WALL TO BE REMOVED

2X4 INTERIOR STUD FRAMED WALL


WALL LEGEND

1/4"=1'-0"

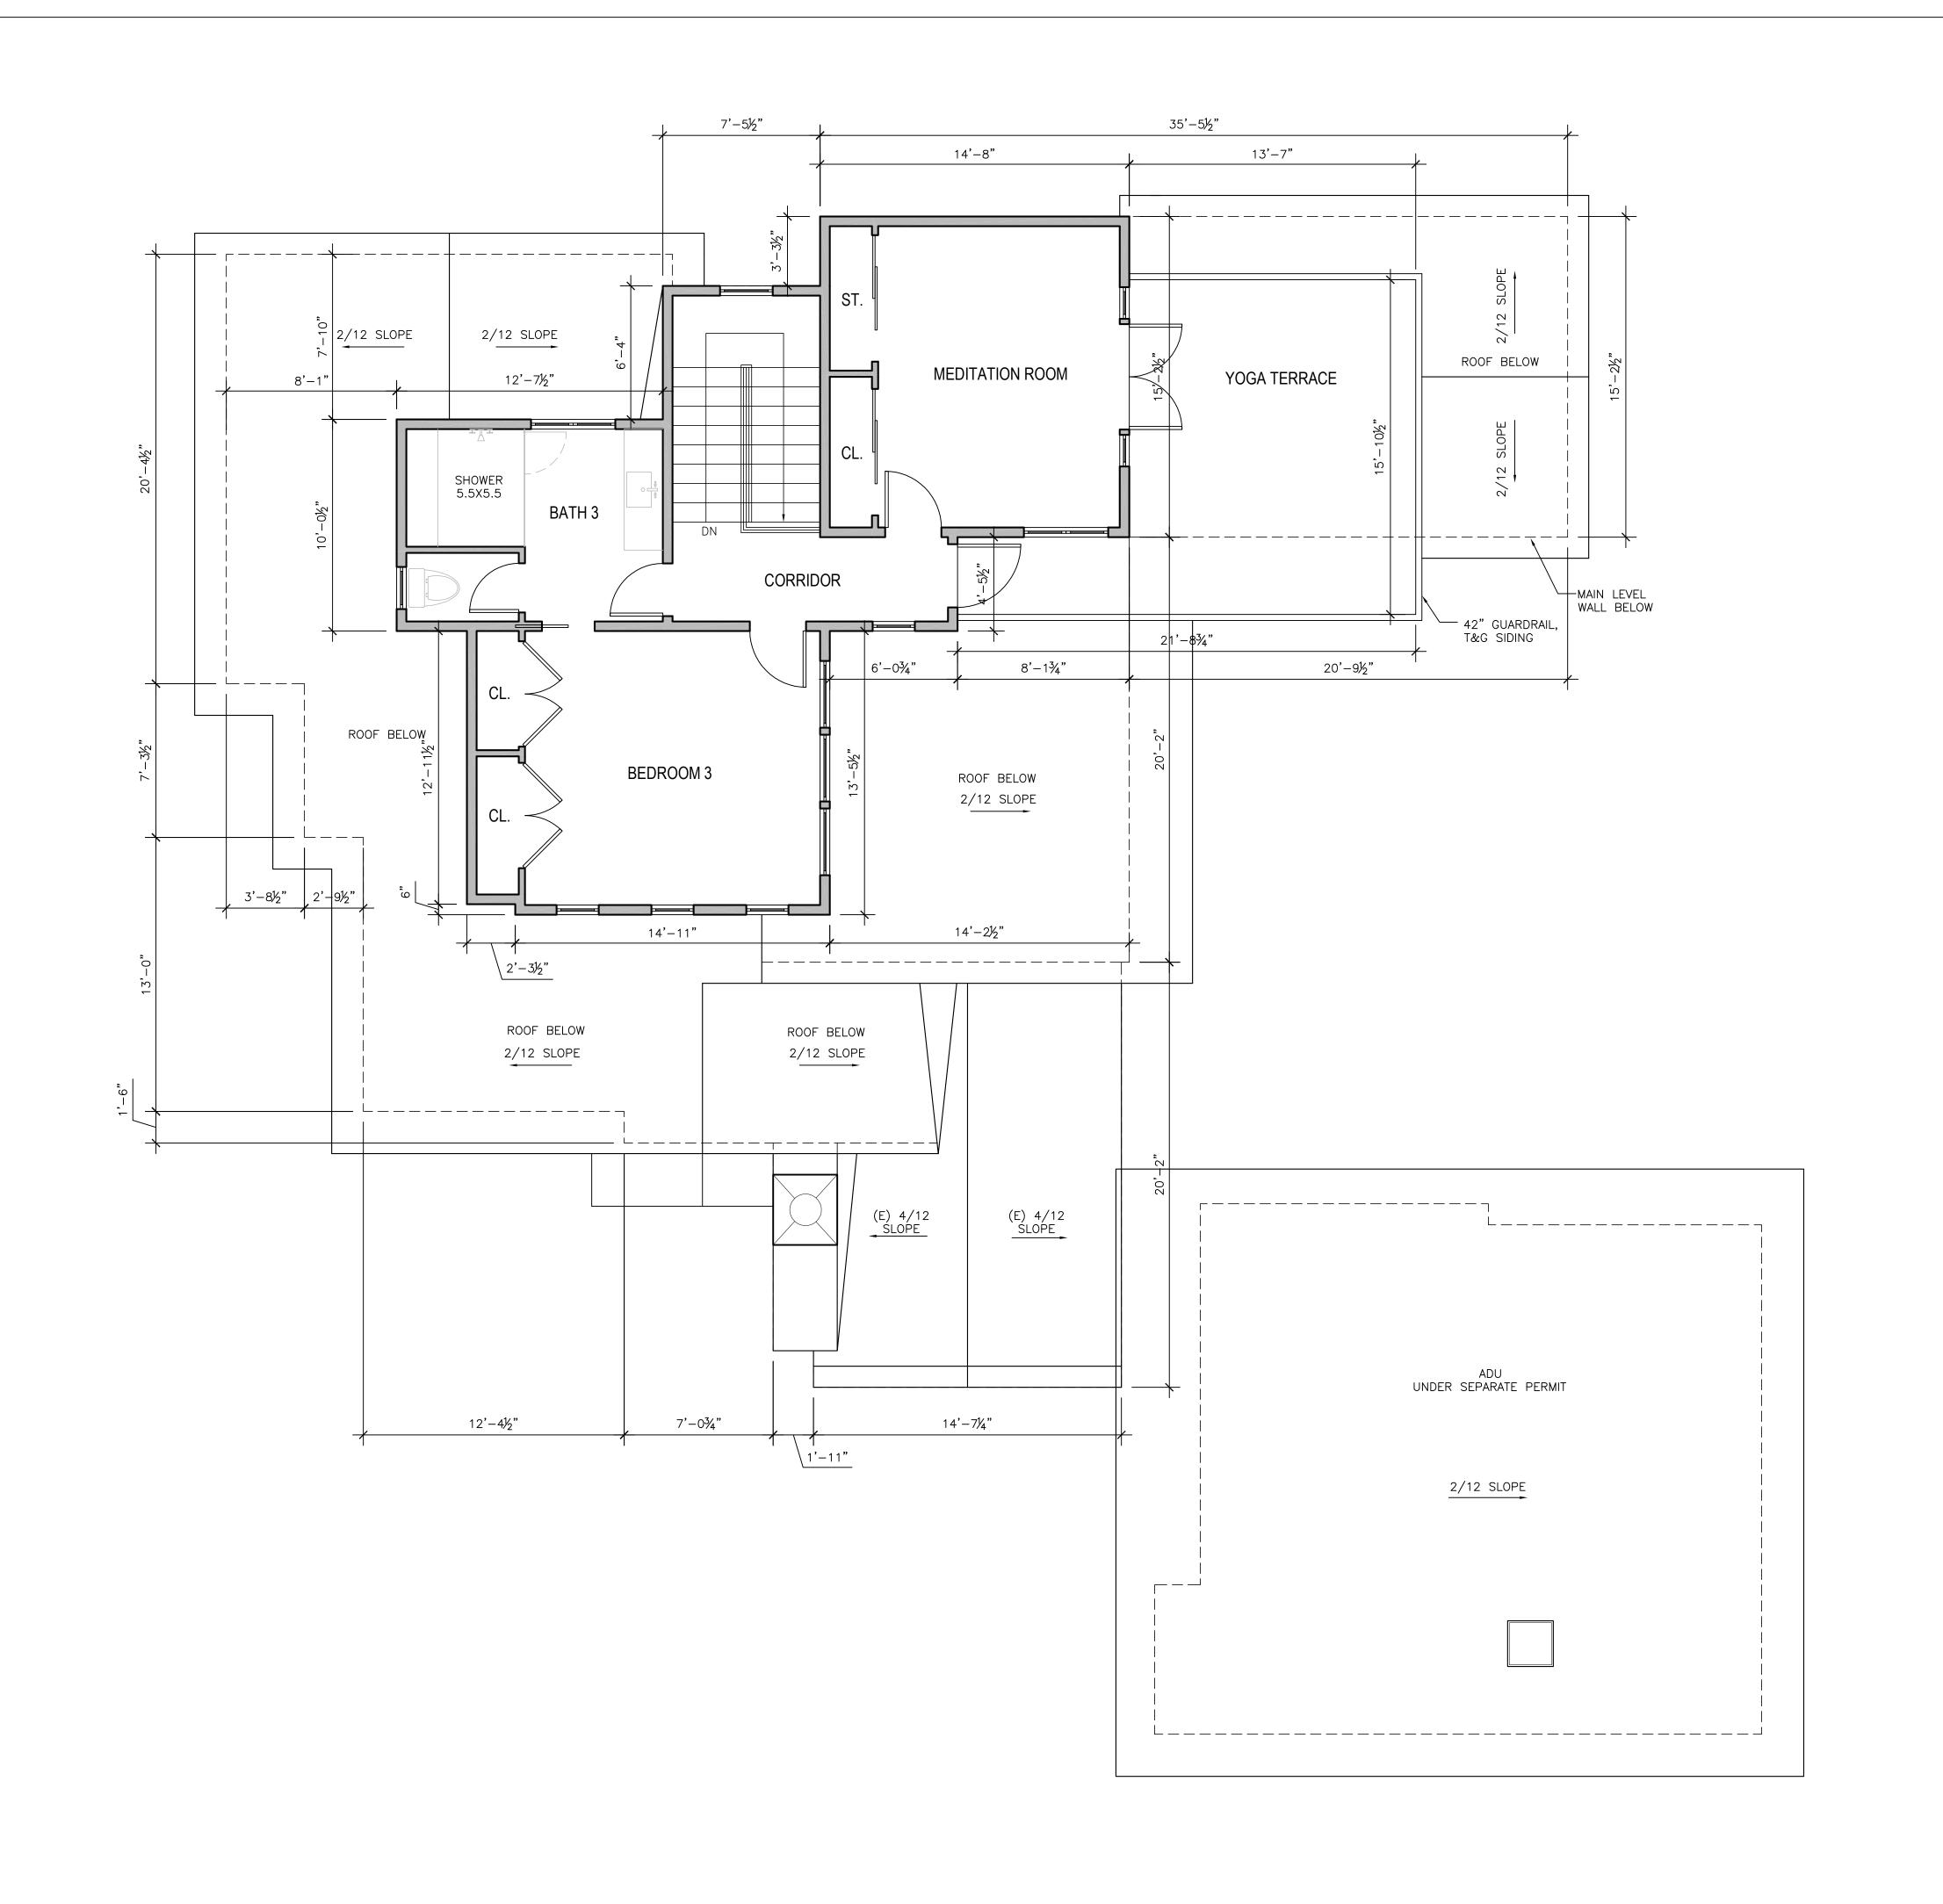

WALL LEGEND

2X6 EXTERIOR STUD FRAMED WALL 2X4 INTERIOR STUD FRAMED WALL



UPPER LEVEL DIMENSION PLAN

ANATOLY OSTRETSOV P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

SIDENC

REVISIONS:

07-04-23
PLANNING REVISIONS

10-11-23 PLANNING REVISIONS


UPPER LEVEL DIMENSION PLAN

DATE: 04-02-23 DESIGN APPROVAL

A3.1

SHEET NO.

1/4"=1'-0"

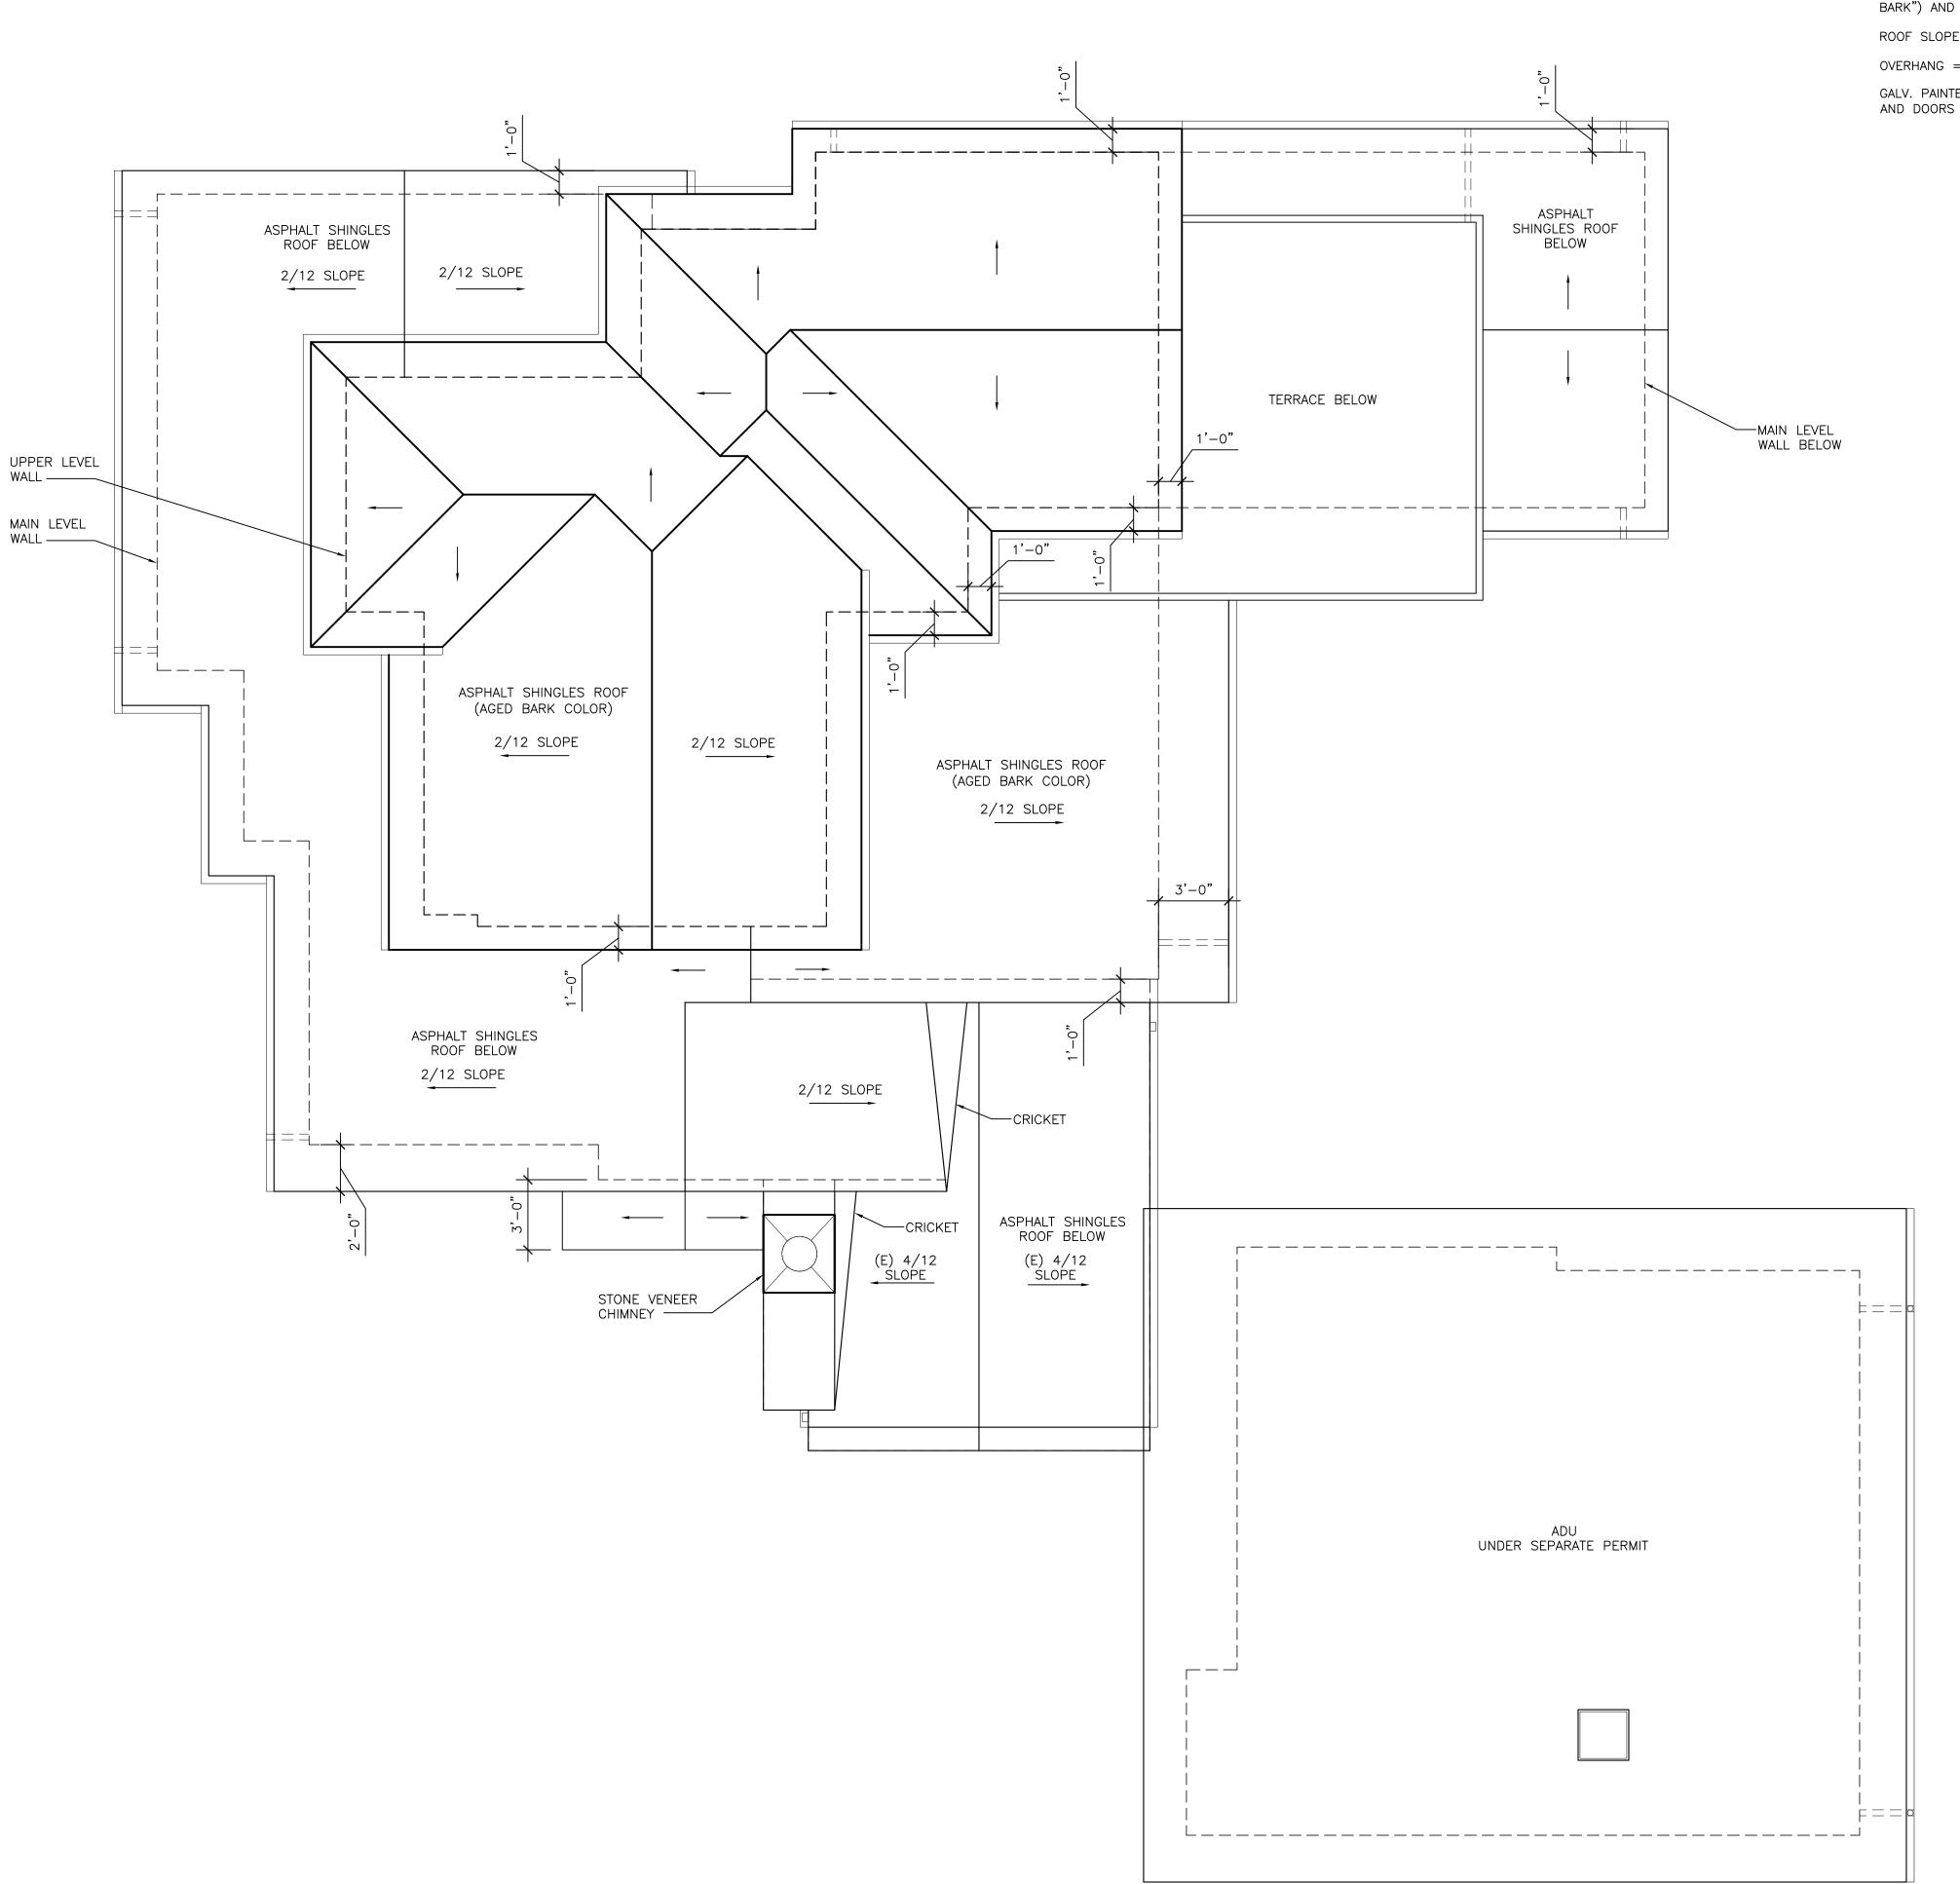

GENERAL ROOF NOTES

ROOF MATERIAL = CLASS 'A' ASPHALT SHINGLES ROOF (PRESIDENTIAL "AGED BARK") AND 3-PLY FLAT ROOF

ROOF SLOPE = 2/12 AND EXISTING 4.5/12

OVERHANG = 18", U.O.N.

GALV. PAINTED FASCIA GUTTERS WITH SQUARE DOWNSPOUTS TO MATCH WINDOWS AND DOORS COLOR (DARK BROWN)

ANATOLY OSTRETSOV

P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

REVISIONS:

07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

ROOF PLAN


DATE: 04-02-23

DESIGN APPROVAL

SHEET NO.

A5.0

ROOF PLAN

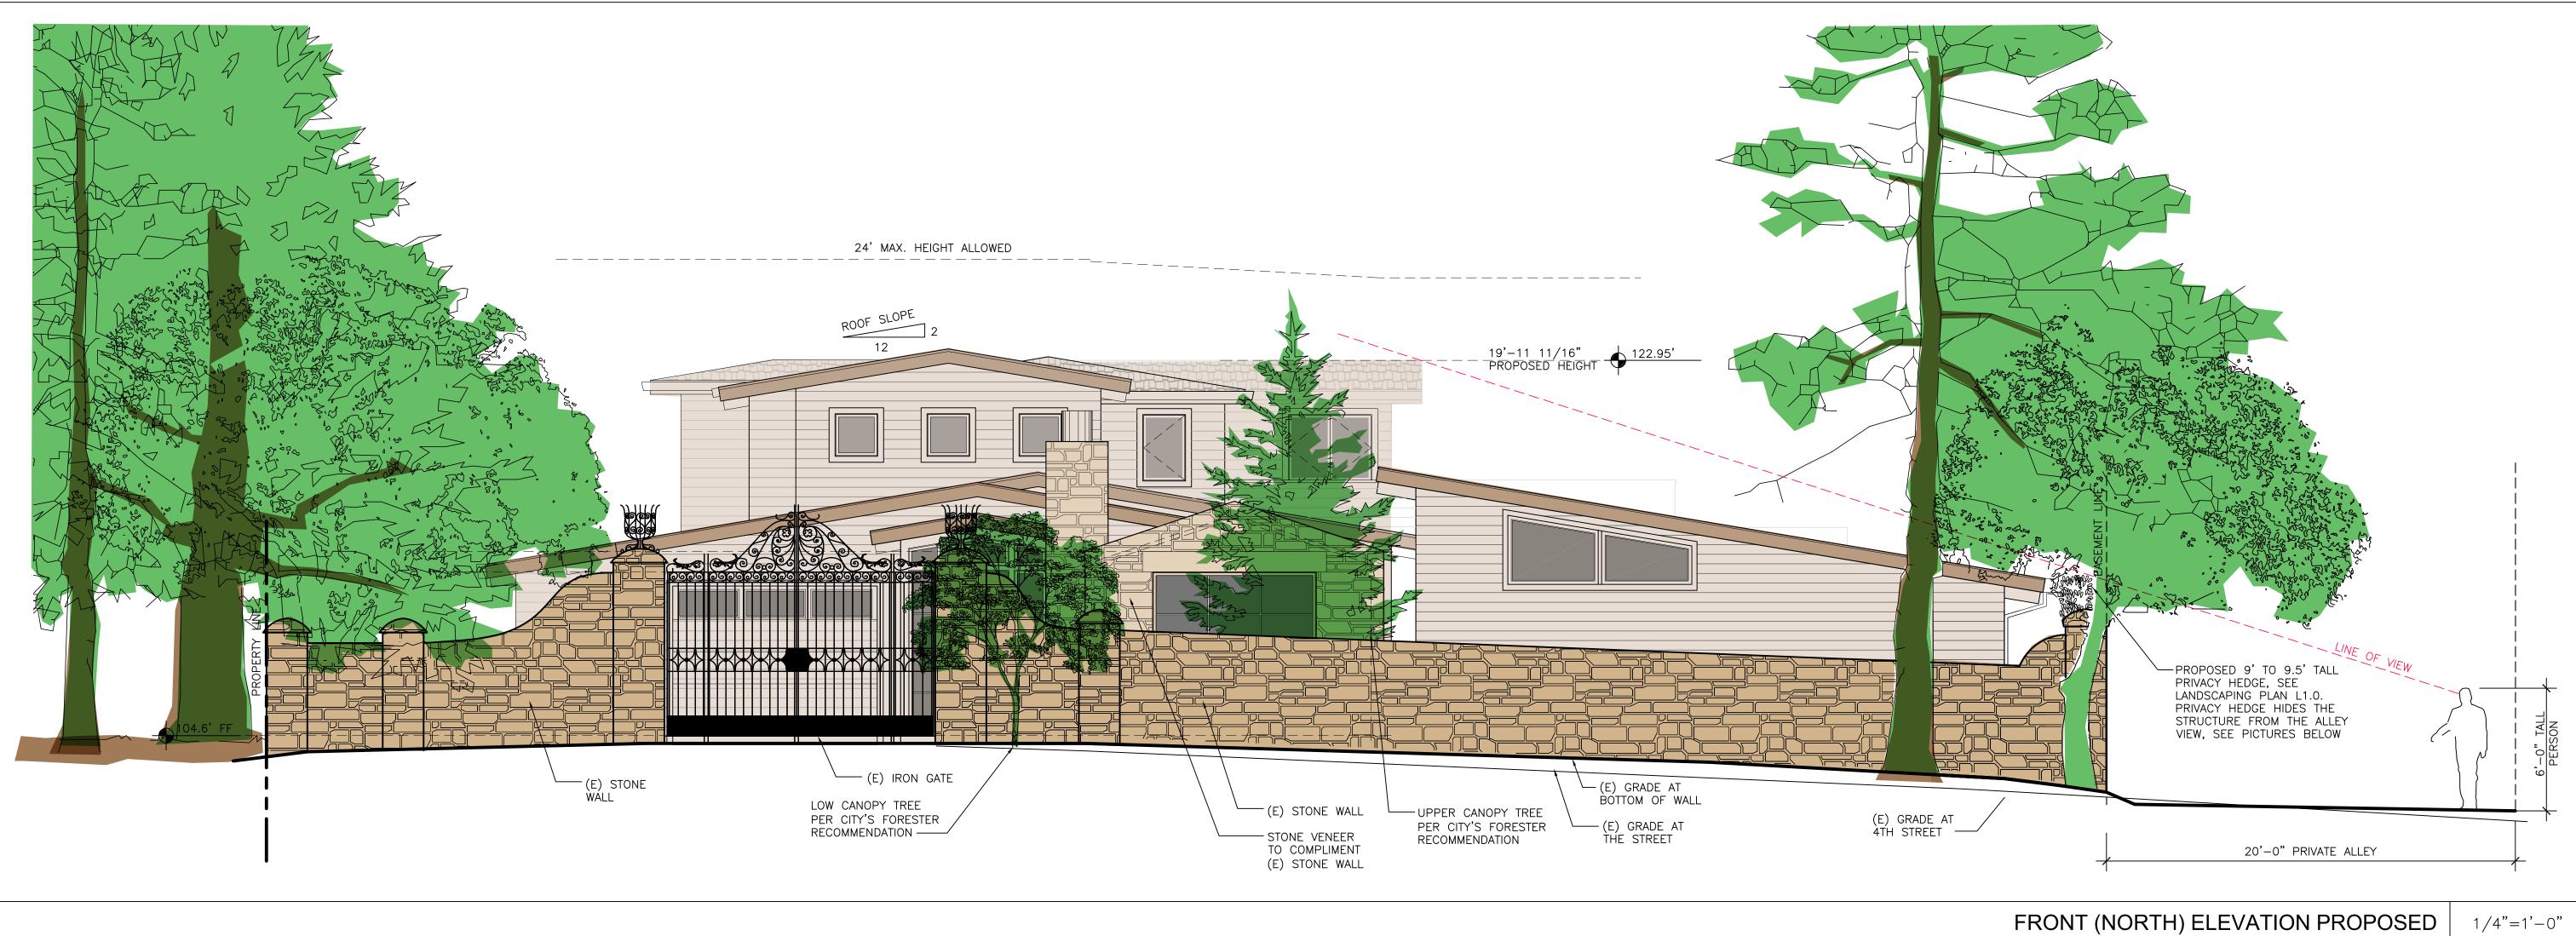



VIEW FROM ALLEY AFTER PLANTING PRIVACY HEDGE

ANATOLY OSTRETSOV

P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

10-11-23 PLANNING REVISIONS


EXTERIOR ELEVATIONS

DATE: 04-02-23 **DESIGN APPROVAL**


SHEET NO.

A6.0

VIEW FROM ALLEY BEFORE PLANTING PRIVACY HEDGE

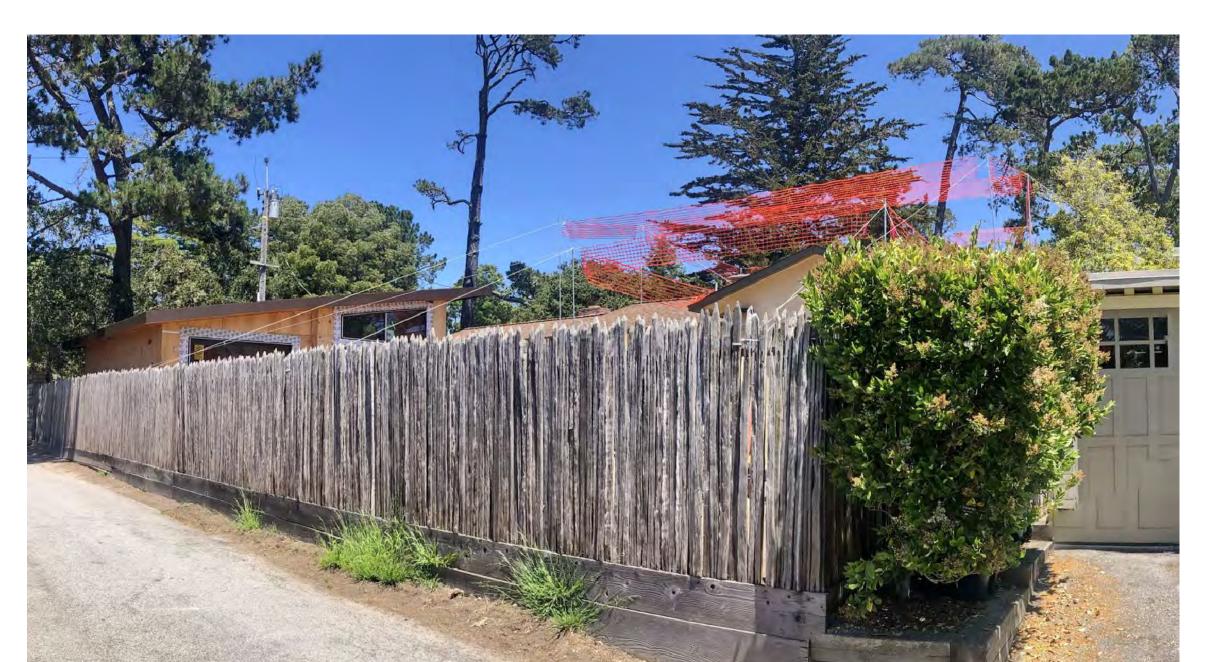




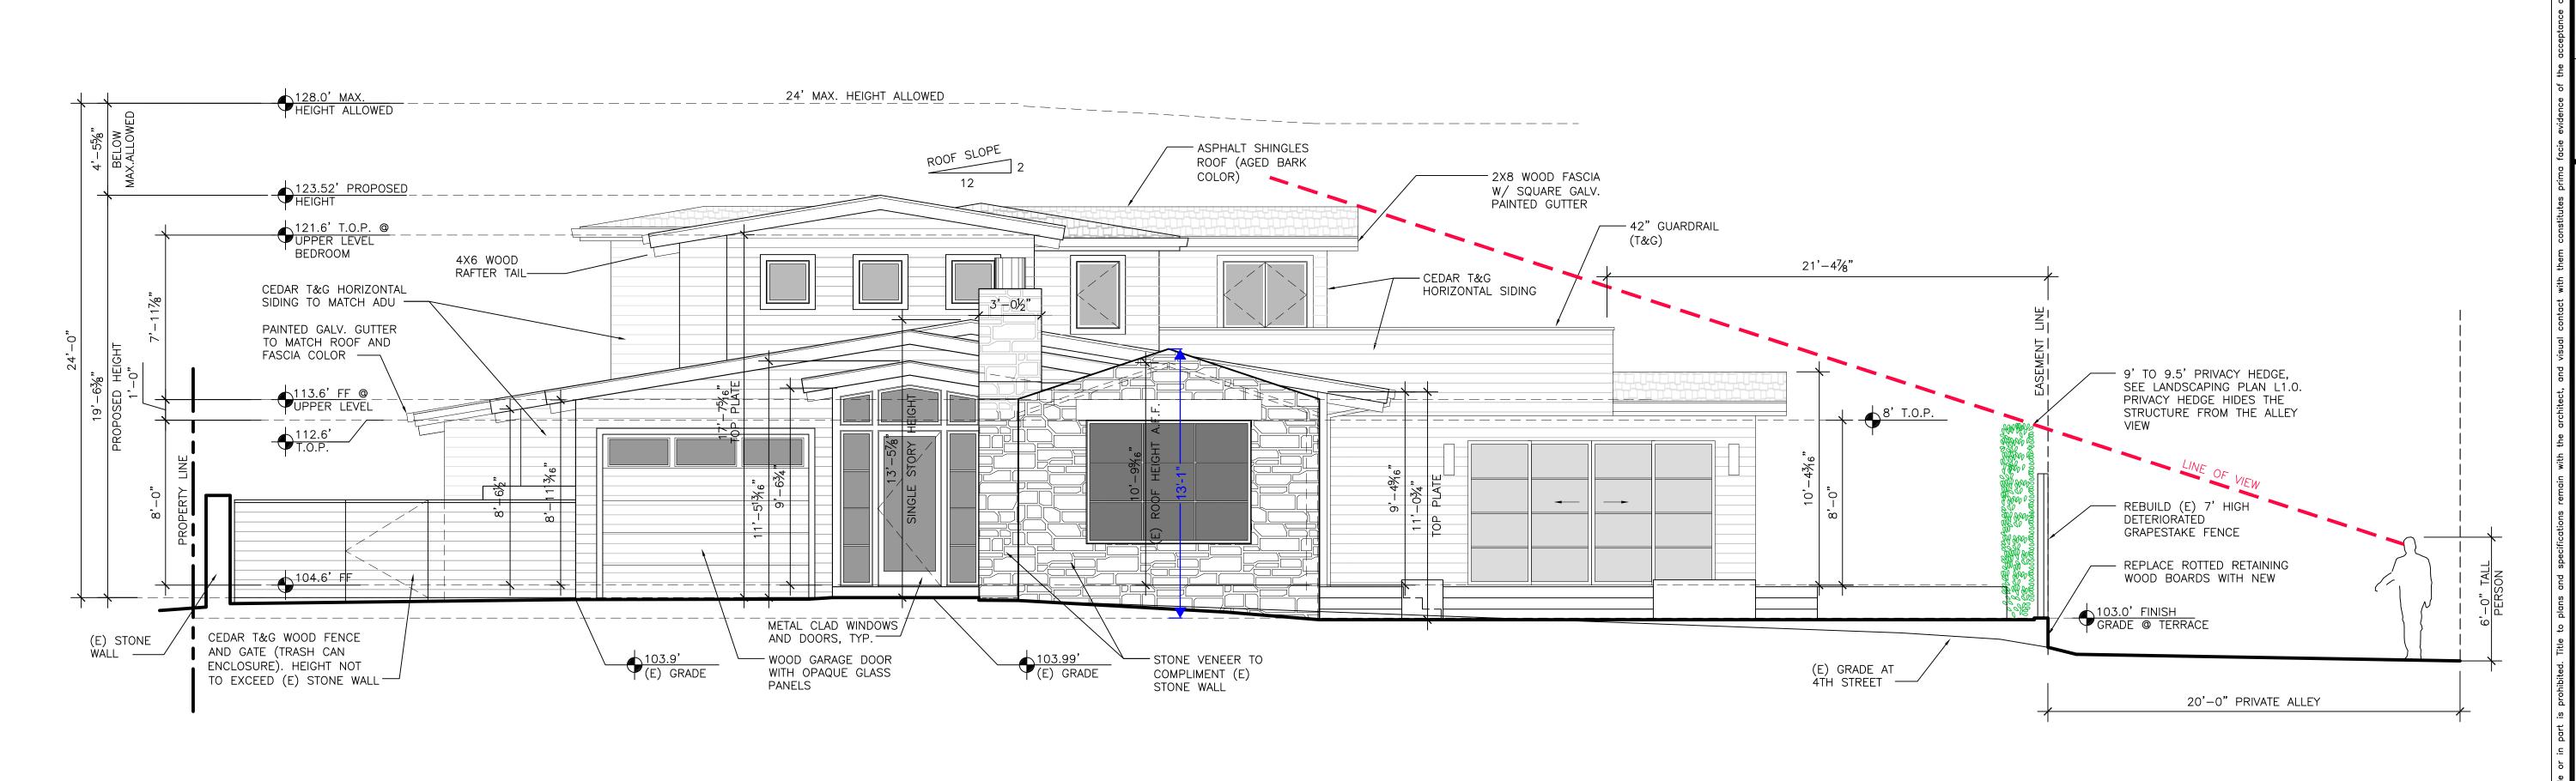

NORTH ELEVATION PROPOSED

1/4"=1'-0"

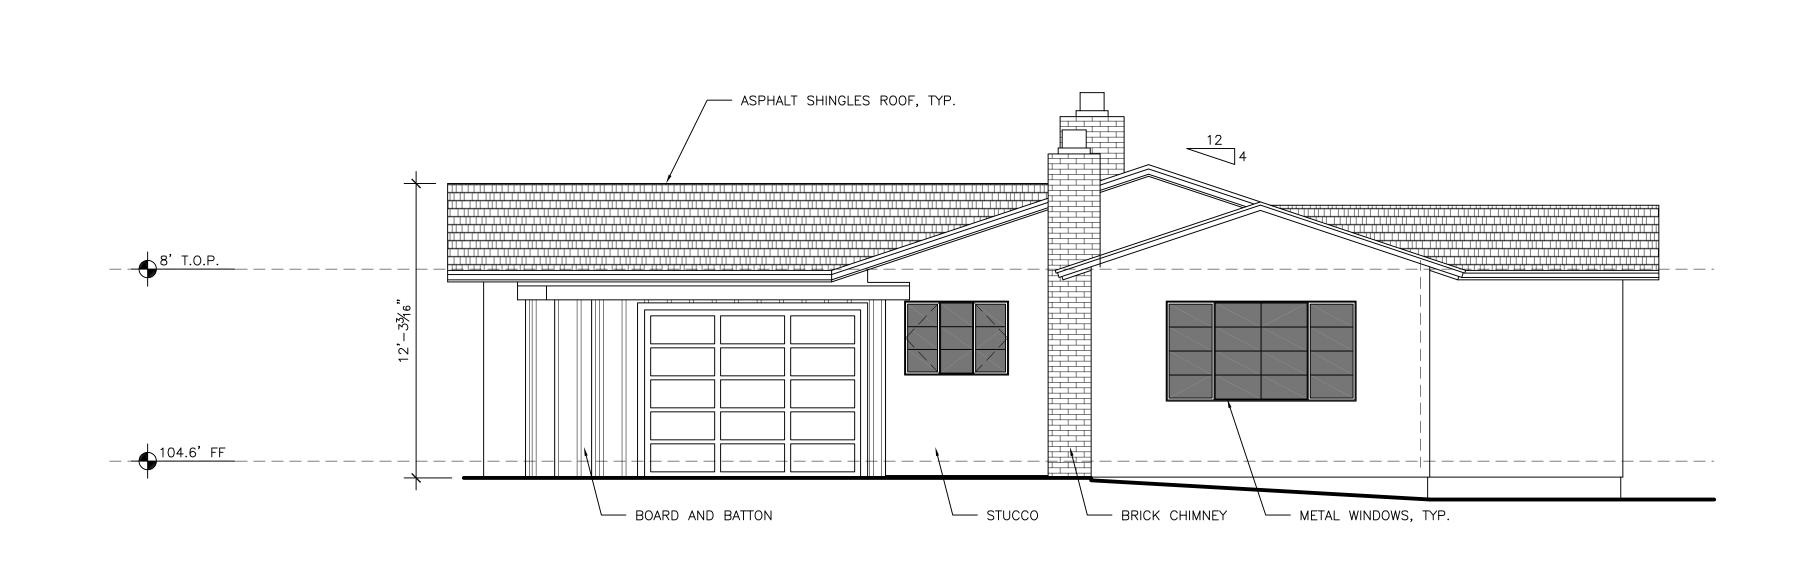



FRONT (NORTH) ELEVATION EXISTING 1/4"=1'-0"

VIEW FROM ALLEY AFTER PLANTING PRIVACY HEDGE

VIEW FROM ALLEY BEFORE PLANTING PRIVACY HEDGE



ANATOLY OSTRETSOV P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com


 \Box

2 10-11-23 PLANNING REVISIONS

EXTERIOR ELEVATIONS

DATE: 04-02-23 **DESIGN APPROVAL**

SHEET NO.

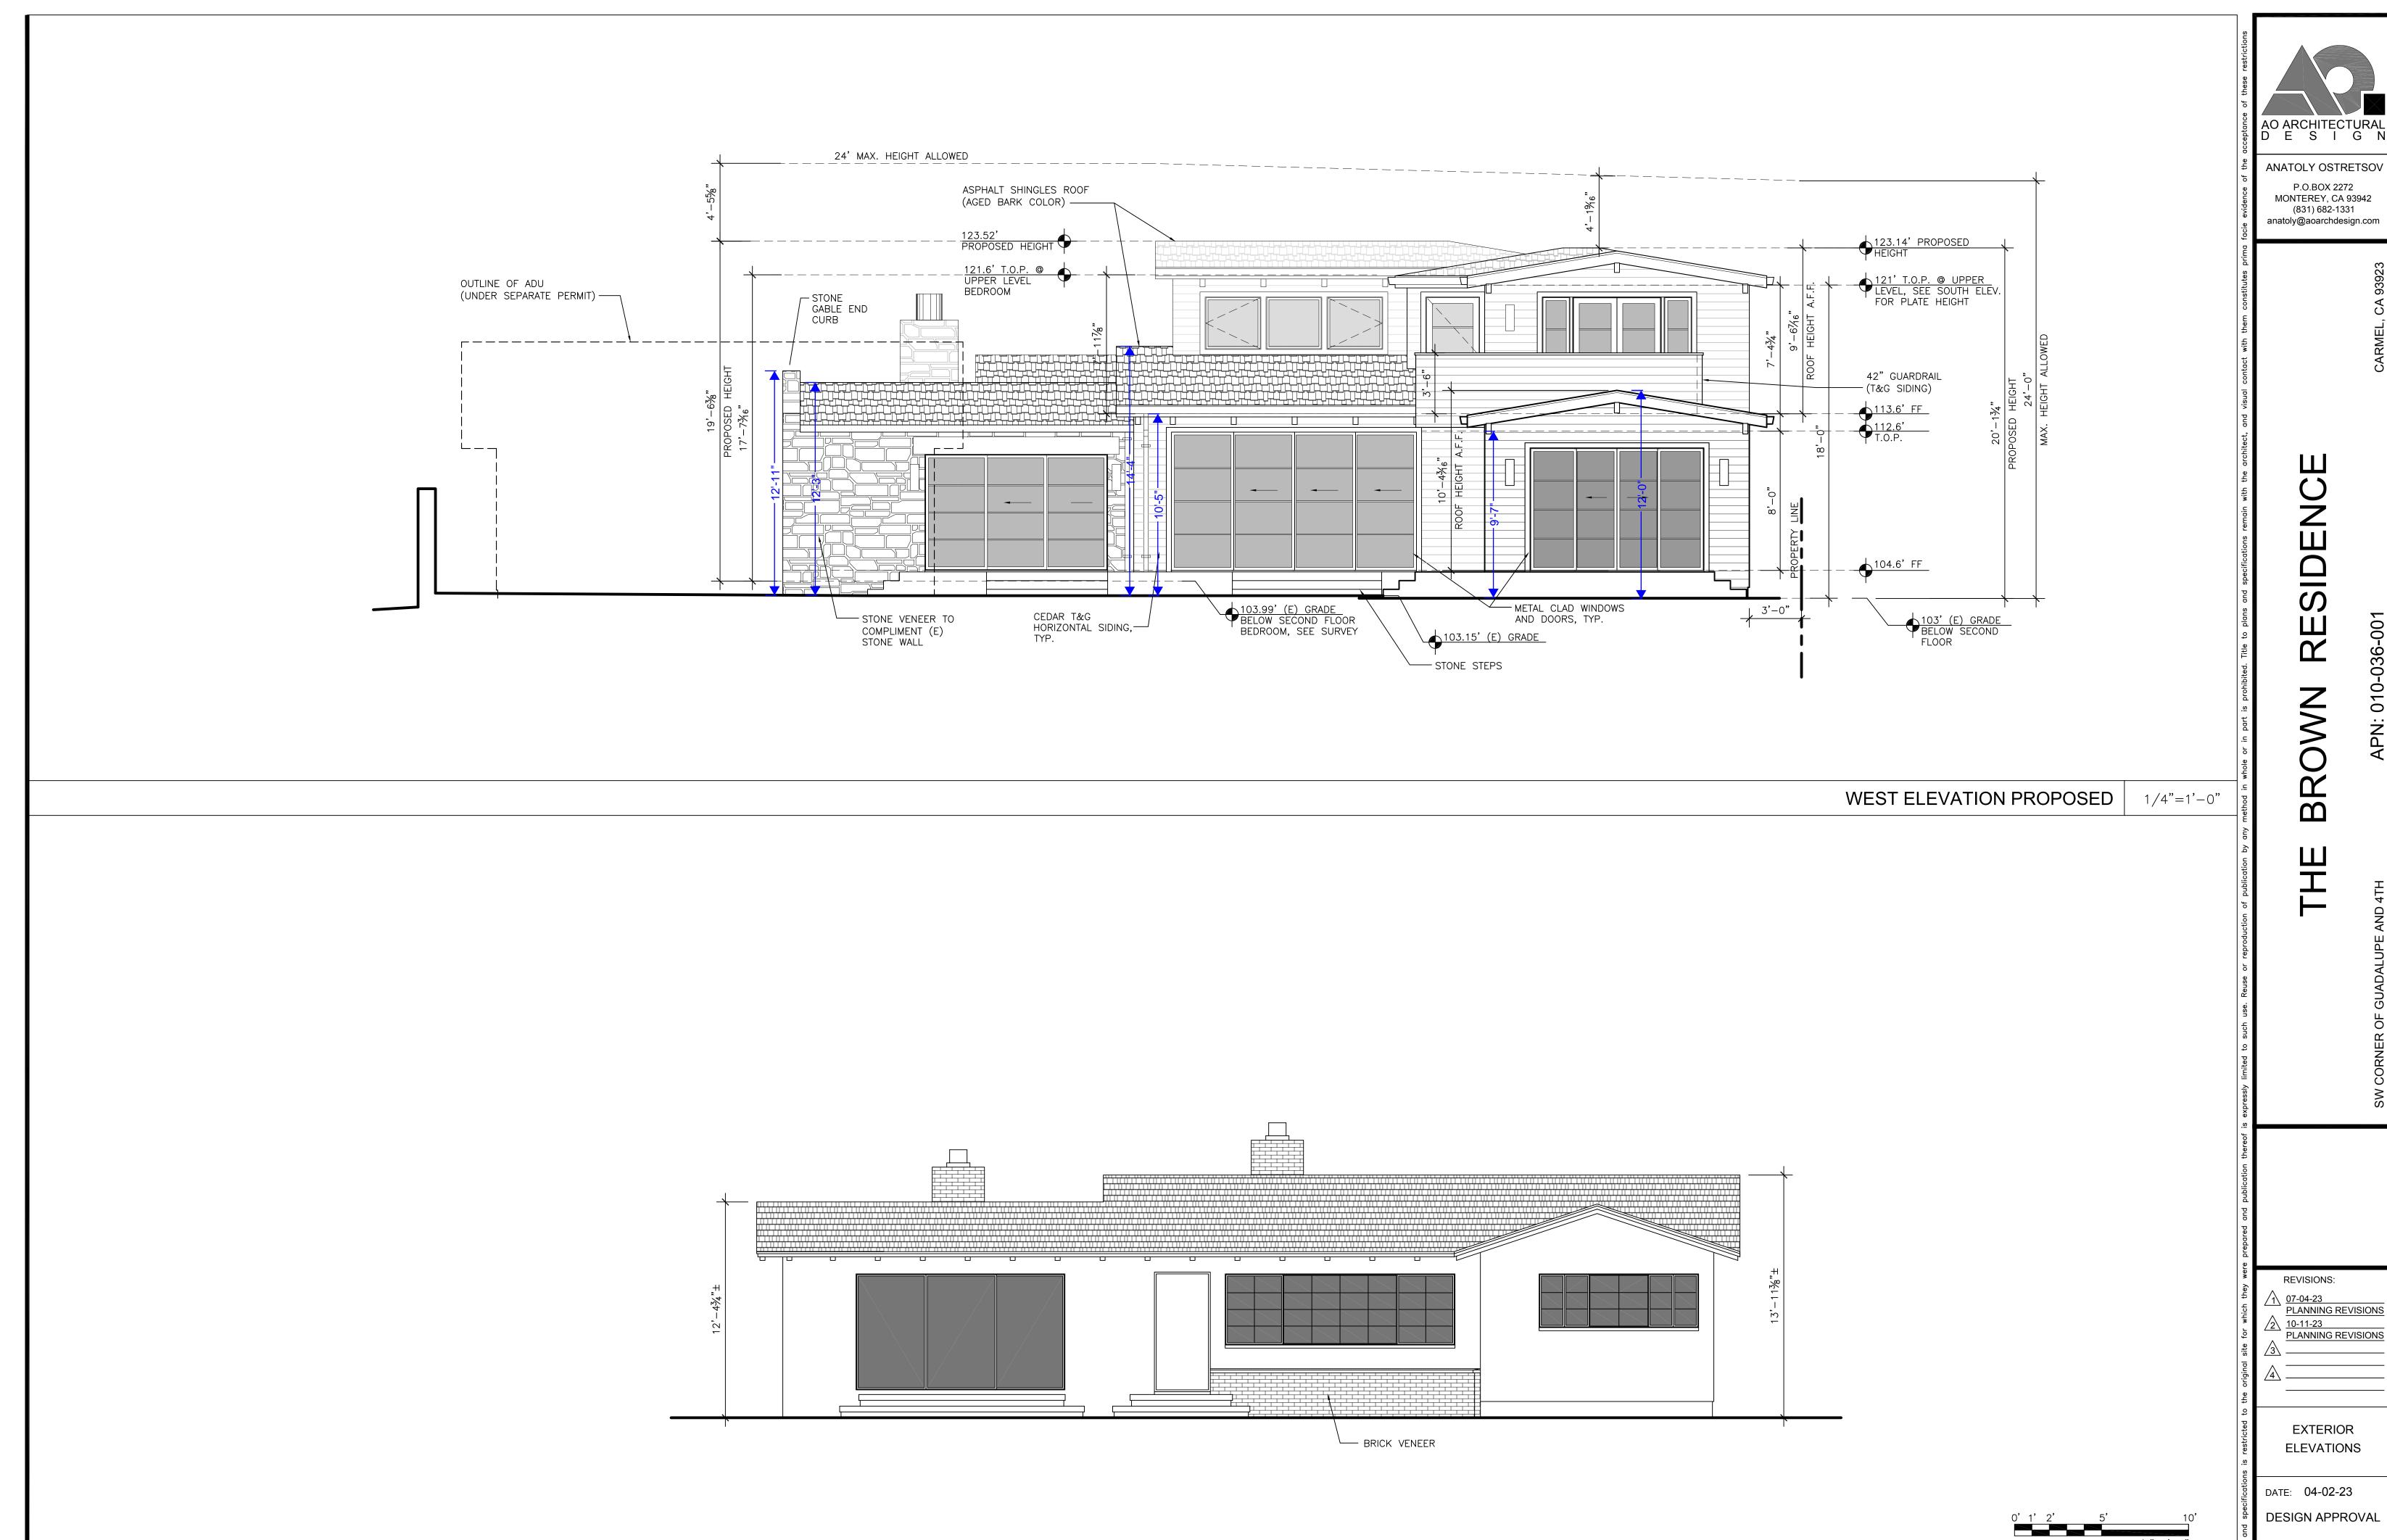

ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331

anatoly@aoarchdesign.com

10-11-23 PLANNING REVISIONS

EXTERIOR **ELEVATIONS**

SHEET NO.

WEST ELEVATION EXISTING



NOTE:
THE HOUSE WILL BE HIDDEN BEHIND PRIVACY HEDGE (9' TO 9.5' TALL TEXAS PRIVET PLANTS, SEE L1.0). SEE SIDE VIEW ON A6.0 AND A6.1

WEST ELEVATION PERSPECTIVE VIEW FROM ALLEY

ANATOLY OSTRETSOV P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com


07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

EXTERIOR ELEVATIONS

DATE: 04-02-23


DESIGN APPROVAL

SHEET NO.

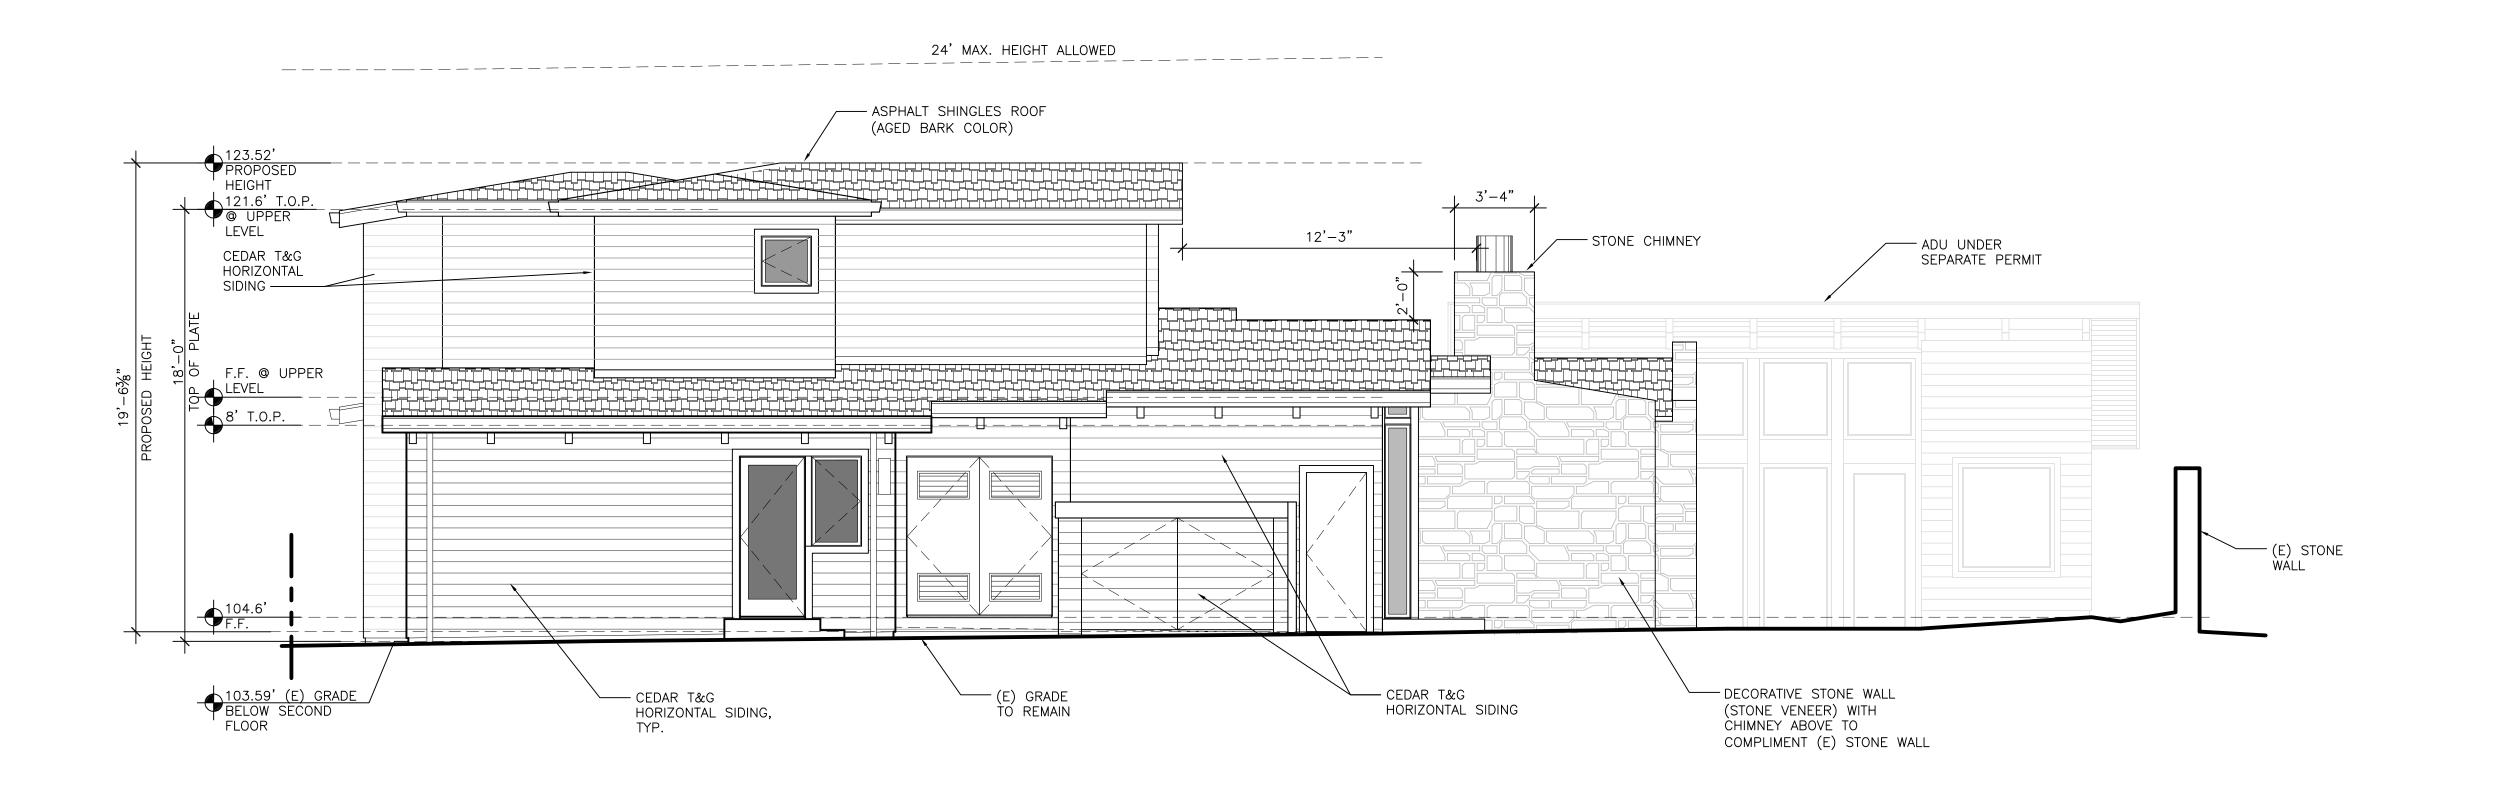

EAST ELEVATION PROPOSED

1/4"=1'-0"

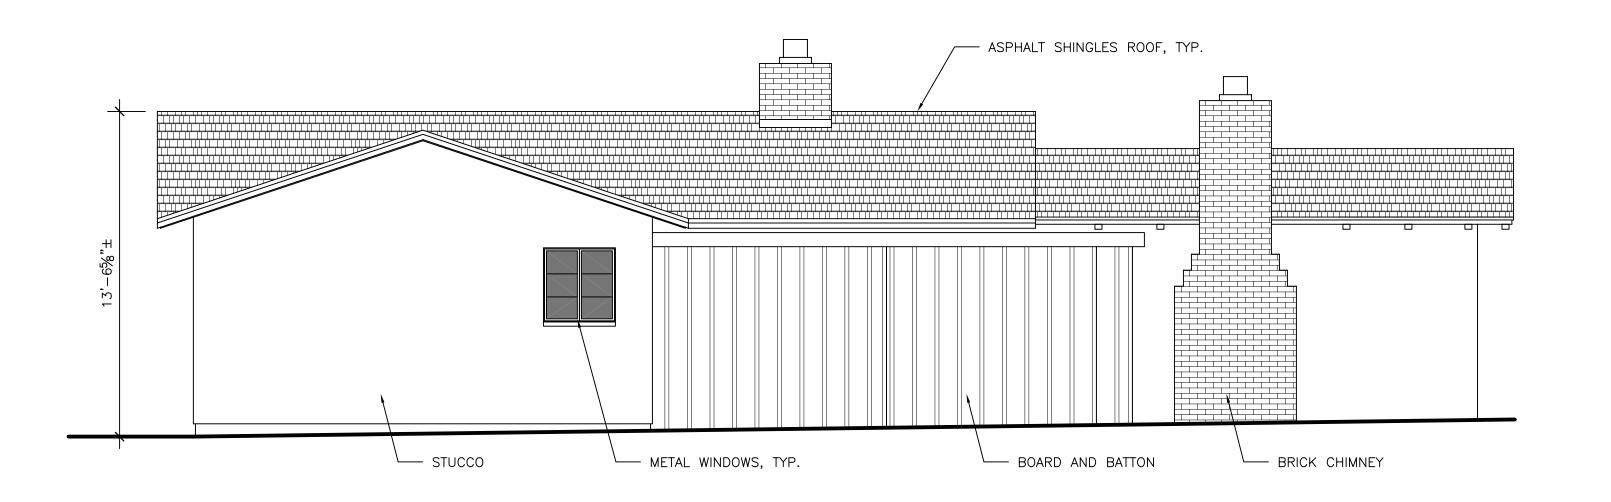

EAST ELEVATION EXISTING 1/4"=1'-0"

ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942

(831) 682-1331 anatoly@aoarchdesign.com

 \Box


07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

EXTERIOR

ELEVATIONS

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

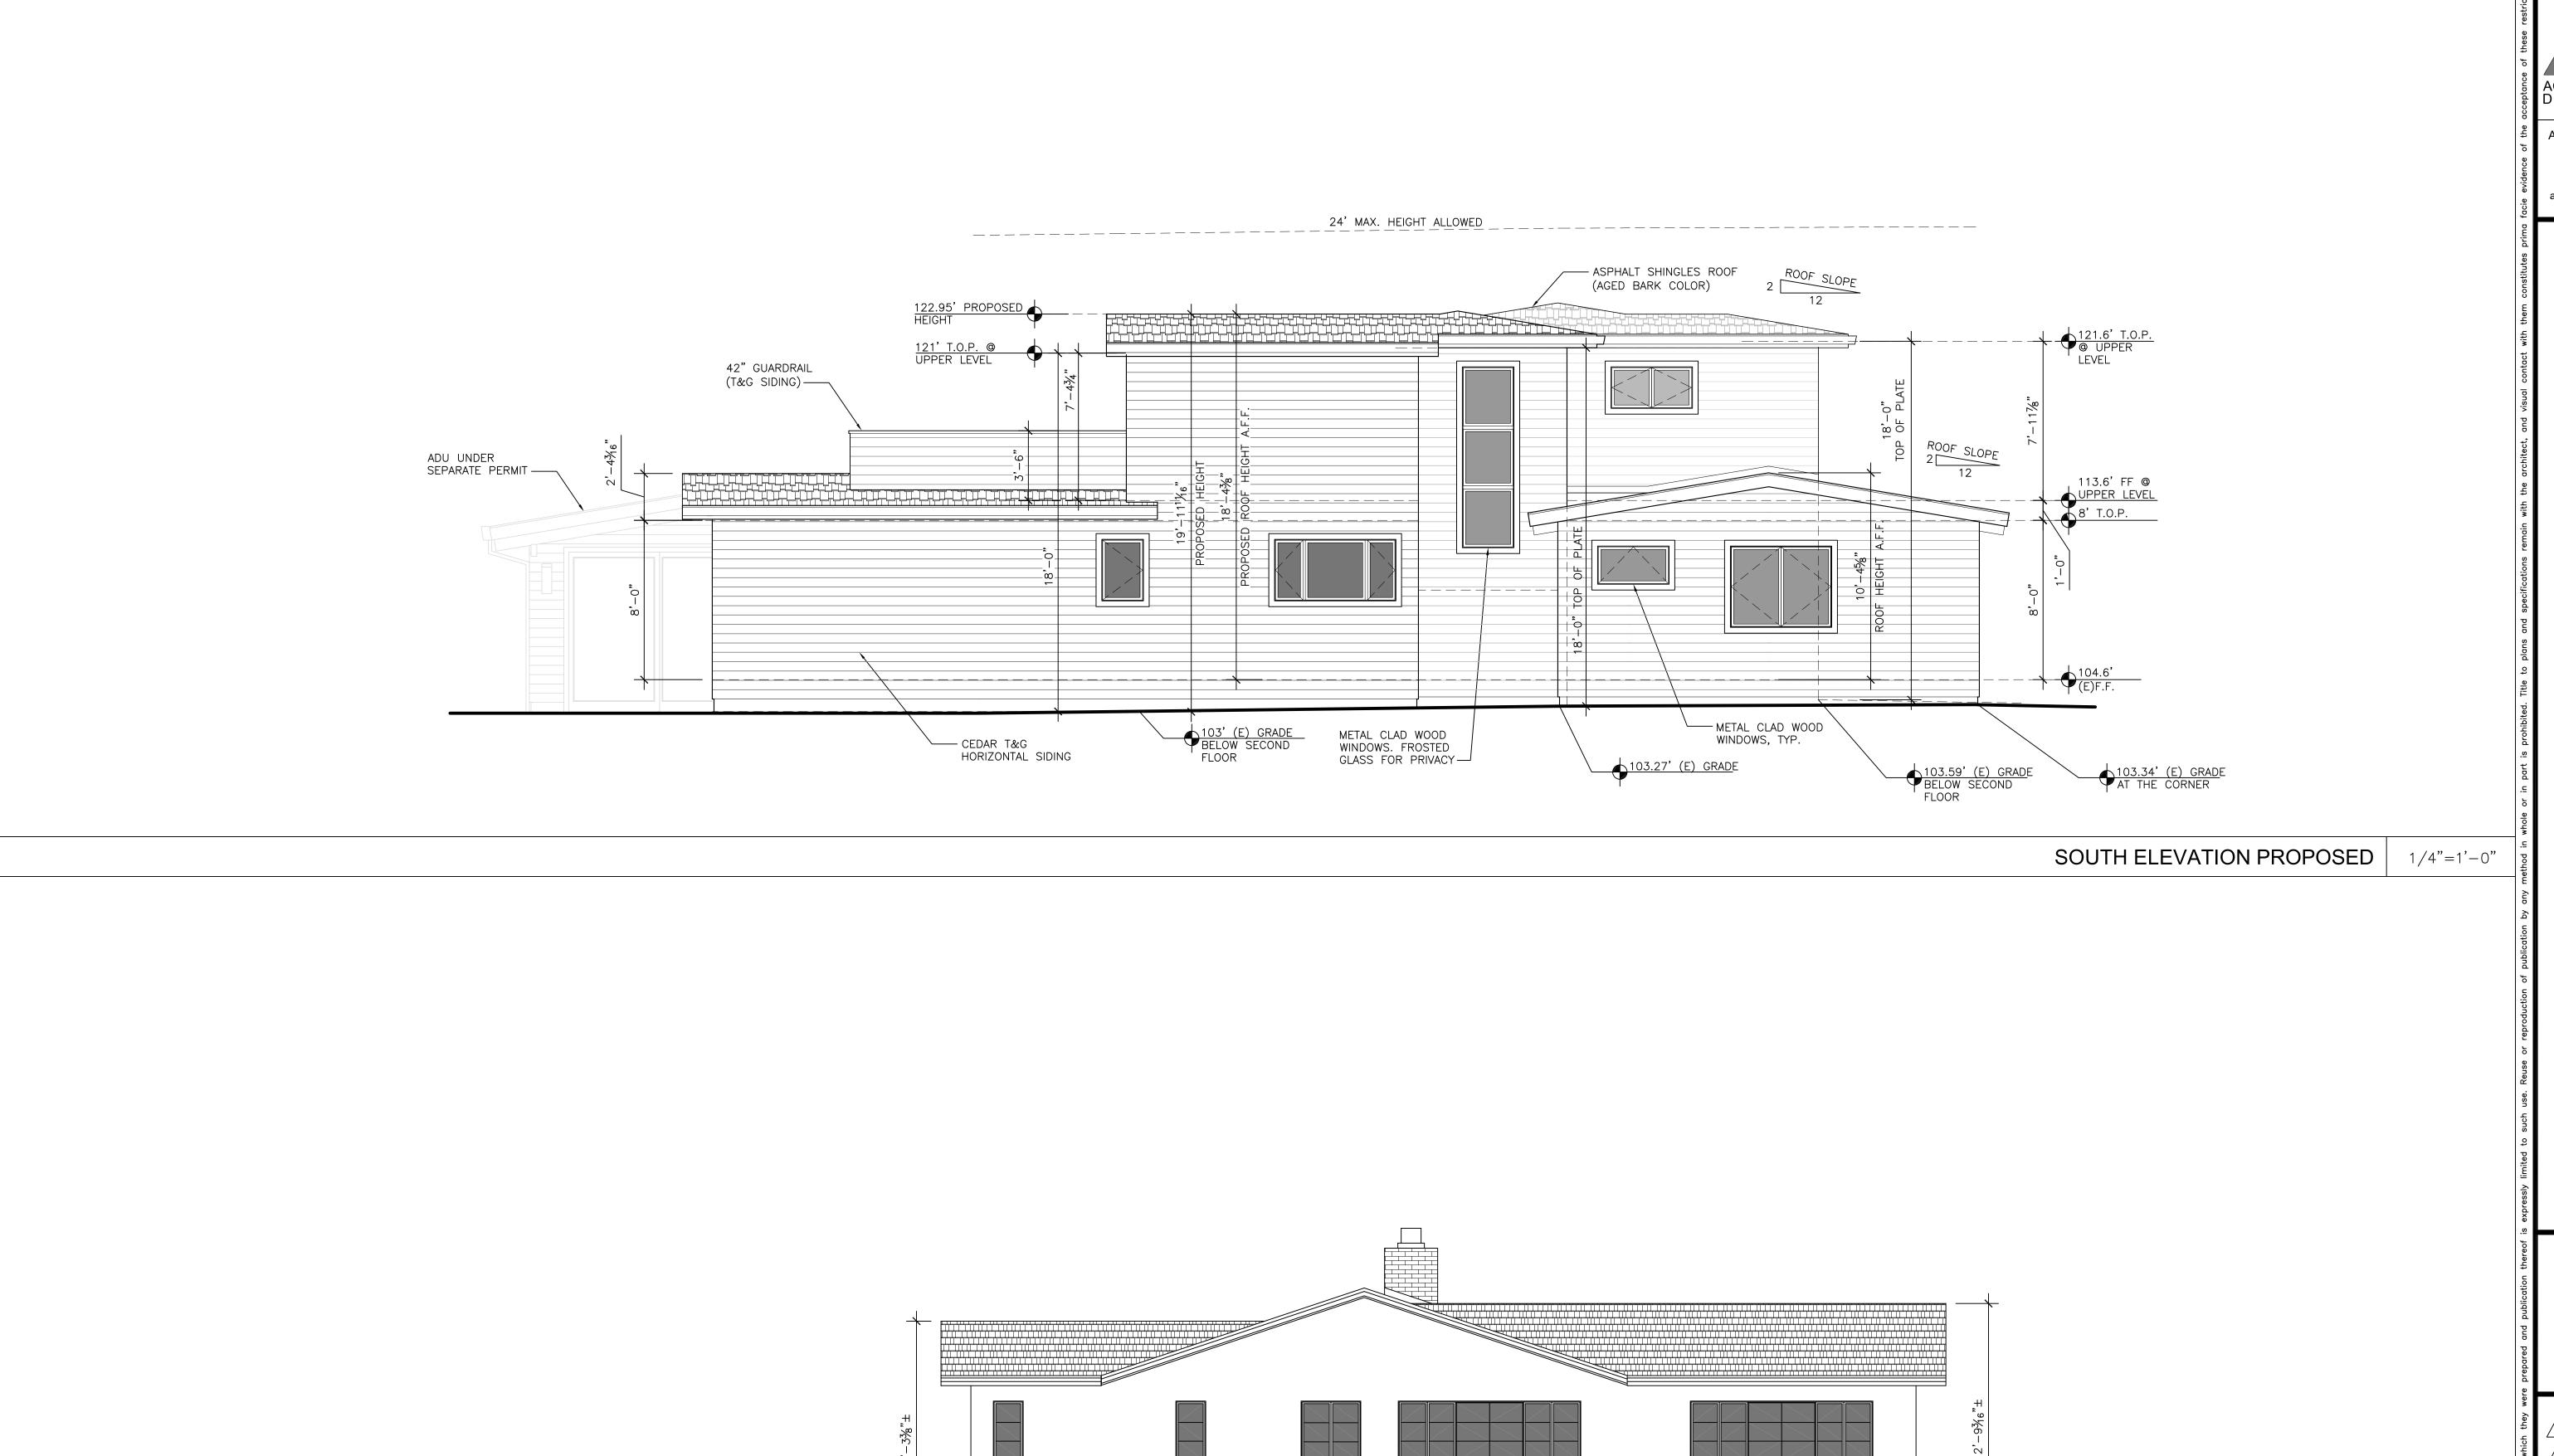

SOUTH ELEVATION EXISTING

ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

SIDENC

BR

07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

EXTERIOR **ELEVATIONS**

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

FRONT VIEW BEFORE



FRONT(NORTH) ELEVATION



ALLEY VIEW



WEST ELEVATION

EAST ELEVATION SOUTH ELEVATION





3D MODEL IMAGES PRESENTED TO VISUALIZE ONLY SIZE AND SHAPE OF THE BUILDINGS AND DIFFERENT FINISHES OF THE BUILDING EXTERIOR. STONE PATTERN REPRESENTS STONE, BROWN COLOR REPRESENTS T&G WOOD SIDING, AND DARK BLUE COLOR REPRESENTS GLASS OF WINDOWS AND DOORS. FOR ACTUAL COLORS REFER TO 'COLORS AND MATERIALS' COLUMN.






PRESIDENTIAL ASPHALT SHINGLES COLOR: AGED BARK



GALV. PAINTED GUTTERS WITH SQUARE DOWNSPOUTS (BROWN COLOR TO MATCH FASCIA BOARD AND WINDOWS)

WALLS



1X6 CEDAR T&G HORIZONTAL SIDING (STAINED)

TERRACE GUARDRAIL FINISHED WITH SAME MATERIAL



THIN STONE VENEER FOND DU LAC RUSTIC



STORAGE SHED, NOT VISIBLE FROM STREETS.
ELASTOMERIC PAINT OVER STUCCO
COLOR 2164-10 BENJAMIN MOORE
"SADDLE BROWN"

WINDOWS AND DOORS



SIERRA PACIFIC ALUMINUM CLAD WOOD WINDOWS AND EXTERIOR DOORS (OR EQUAL) COLOR: REGAL BROWN 059

DRIVEWAY PAVERS



UNILOCK ARTLINE PERMEABLE PAVERS. COLOR — GRAY

COURTYARD LANDING PAVERS



HYDROLOGIC PERMEABLE PAVERS. COLOR — BROWNSTONE

EXTERIOR LIGHT FIXTURE



WAC LIGHTING (LED)
ARCHETYPE WS-W15912
SIZE 5.5"X12"
COLOR: BLACK
DELIVERED LUMENS - 331

NOTE: ALL EXTERIOR LIGHT FIXTURES ATTACHED TO THE HOUSE SHALL BE NO HIGHER THAN 6' ABOVE FINISH FLOOR AND NOT EXCEED 25 WATTS PER FIXTURE (INCANDESCENT EQUIVALENT)

A6.6

RENDERINGS

COLORS AND MATERIALS

ANATOLY OSTRETSOV P.O.BOX 2272

MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

REVISIONS:

07-04-23
PLANNING REVISIONS 10-11-23 PLANNING REVISIONS

EXTERIOR RENDERINGS

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

			DO	OR S	CHEDULE	
DOOR	\vdash \land				NOTES	
NO.			ACTION	GLASS		
MAIN	LEVEL	•	!	'		
1	3'-0"	7'-6"	SWING	TEMPERED	ENTRY GLASS DOOR	
2	10'-6"	6'-8"	SLIDING	TEMPERED	3-PANEL GLASS DOOR	
3	14'-0"	8'-0"	SLIDING	TEMPERED	4-PANEL GLASS DOOR	
4	12'-0"	7'-0"	SLIDING	TEMPERED	2-WAY SLIDER 4-PANEL GLASS DOOR	
5	10'-0"	7'-0"	SLIDING	TEMPERED	2-WAY SLIDER 4-PANEL GLASS DOOR	
6	2'-8"	6'-8"	SWING	TEMPERED		
7	6'-0"	6'-8"	SWING		PAIR OF 3'-0" WOOD LOUVERED DOOR	
8	8'-0"	4'-6"	SWING		PAIR OF 4'-0" WOOD DOOR @ STORAGE	
9	2'-6"	6'-8"	SWING		WOOD DOOR @ GARAGE	
10	10'-0"	8'-0"			GARAGE DOOR. 3 GLASS PANELS AT TOP	
11	2'-10"	7'-0"	SWING		@ MASTER BEDROOM	
12	4'-0"	7'-0"	POCKET		@ MASTER CLOSET	
13	2'-6"	7'-0"	SWING		@ MASTER BATH	
14	2'-2"	7'-0"	SWING		@ MASTER BATH TOILET	
15	2'-6"	6'-0"	SWING	TEMPERED	@ MASTER BATH SHOWER	
16	2'-6"	6'-8"	SWING		@ BATH 2	
17	2'-0"	6'-8"	SWING		@ BATH 2 LINEN	
18	2'-6"	6'-8"	POCKET		@ BATH 2	
19	2'-6"	6'-0"	SWING	TEMPERED	@ BATH 2 SHOWER	
20	2'-4"	6'-8"	SWING		© BATH 2	
21	6'-0"	6'-8"	SLIDING		@ BEDROOM 2 CLOSET	
22	2'-8"	6'-8"	SWING		@ BEDROOM 2	
23	2'-10"	6'-8"	POCKET		@ LAUNDRY	
24	5'-0"	6'-8"	SWING		PAIR OF 2'-6" WOOD DOOR @ PANTRY	
25	2'-6"	6'-8"	SWING		20-MIN FIRE-RATED SELF-CLOSING, SELF-LATCHING @ GARAGE	
	R LEVEL	1	1			
26	3'-0"	6'-8"	SWING	TEMPERED	GLASS DOOR	
27	5'-0"	6'-8"	SWING	TEMPERED	PAIR OF 2'-6", MULLED W/ WIN. #20 AND 21	
28	6'-0"	6'-8"	SLIDING		@ MEDITATION RM STORAGE	
29	6'-0"	6'-8"	SLIDING		@ MEDITATION RM CLOSET	
30	2'-8"	6'-8"	SWING		@ MEDITATION RM	
31	2'-8"	6'-8"	SWING		@ BEDROOM 3	
32	5'-0"	6'-8"	SWING		PAIR OF 2'-6" @ BEDROOM 3 CLOSET	
33	5'-0"	6'-8"	SWING		PAIR OF 2'-6" @ BEDROOM 3 CLOSET	
34	2'-6"	6'-8"	POCKET		@ BEDROOM 3 BATH	
35	2'-4"	6'-8"	SWING		@ BATH 3 TOILET	
36	2'-6"	6'-0"	+	TEMPERED	@ SHOWER	
37	2'-6"	6'-8"	SWING		@ BATH 3	


DOOR NOTES:

- 1. EXTERIOR SLIDING DOORS AND FRONT DOOR TO BE METAL CLAD WOOD DOORS (SIERRA PACIFIC OR EQUAL).
- 2. ALL GLAZING IN DOORS SHALL BE TEMPERED GLASS (CBC 2406.4.1, CRC R308.4.1).
- 3. CONTRACTOR TO VERIFY ALL ASPECTS OF DOORS AND PROVIDE SHOP DRAWINGS
- 4. ALL EXPOSED EDGES TO BE SEALED TO PREVENT MOISTURE PENETRATION AND WARPING.

WINDOW NOTES:

PRIOR TO ORDERING.


- 1. ALL WINDOWS TO BE METAL CLAD WOOD WINDOWS (SIERRA PACIFIC OR EQUAL). 2. ALL WINDOWS TO BE DOUBLE GLAZED.
- 3. FOR WINDOWS THAT SERVE AS EMERGENCY EGRESS FROM SLEEPING AREAS:
- MINIMUM NET CLEAR OPENING DIMENSION OF 24 INCHES IN HEIGHT. - MINIMUM NET CLEAR OPENING DIMENSION OF 20 INCHES IN WIDTH.
- MINIMUM NET CLEAR OPENING DIMENSION OF 5.7 SQUARE FEET IN AREA. - BOTTOM OF SUCH OPENINGS SHALL NOT EXCEED 44 INCHES ABOVE FLOOR (CRC R310.2.1, R310.2.2)
- 4. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE OF THE GLAZING IS WITHIN A 24-INCH ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED
- POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE SHALL BE CONSIDERED A HAZARDOUS LOCATION REQUIRING SAFETY GLAZING MATERIALS (CBC 2406.4.2).
- 5. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL THAT MEETS ALL OF THE FOLLOWING CONDITIONS SHALL BE CONSIDERED A HAZARDOUS LOCATION REQUIRING SAFETY GLAZING MATERIALS:
- THE EXPOSED AREA OF AN INDIVIDUAL PANE IS GREATER THAN 9 SQUARE FEET. - THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 18 INCHES ABOVE THE FLOOR. - THE TOP EDGE OF THE GLAZING IS GREATER THAN 36 INCHES ABOVE THE FLOOR.
- ONE OR MORE WALKING SURFACE(S) ARE WITHIN 36 INCHES, MEASURED HORIZONTALLY AND IN A STRAIGHT LINE, OF THE PLANE OF THE GLAZING (CBC 2406.4.3).

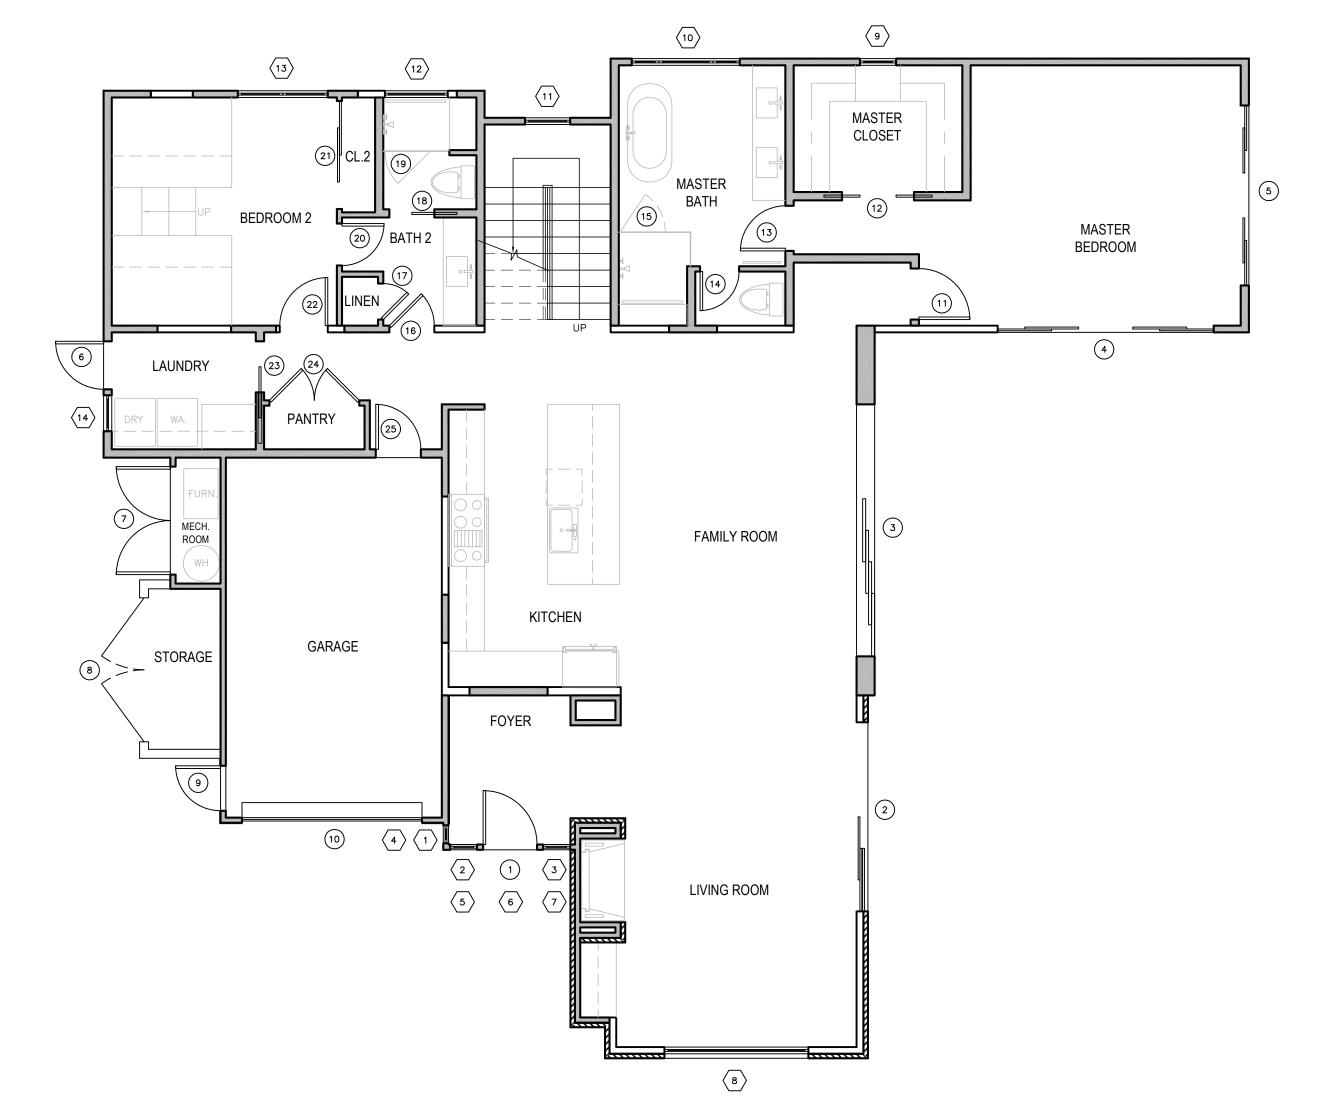

MAIN FLOOR PLAN

WNDW.	WINDOW SIZE		TVDE	NTDI	CLACC	NOTES		
NO.	WIDTH	HEIGHT		TYPE	MTRL.	GLASS	NOTES	
MAIN I	LEVEL							
1	12"	8'-0"	8'-0"	FIXED	WD	TEMPERED		
2	1'-6"	8'-0"	8'-0"	FIXED	WD	TEMPERED		
3	1'-6"	8'-0"	8'-0"	FIXED	WD	TEMPERED		
4	12"	1'-4"	9'-2"	FIXED	WD	TEMPERED	TRANSOM WINDOW	
5	1'-6"	1'-7"	9'-5"	FIXED	WD	TEMPERED	TRANSOM WINDOW, TRAPEZOID	
6	3'-0"	2'-0"	9'-8"	FIXED	WD	TEMPERED	TRANSOM WINDOW, TRAPEZOID	
7	1'-6"	1'-7"	9'-5"	FIXED	WD	TEMPERED	TRANSOM WINDOW, TRAPEZOID	
8	8'-0"	6'-0"	8'-0"	FIXED	WD			
9	2'-0"	3'-0"	7'-0"	CASEMENT	WD			
10	6'-0"	3'-0"	7'-0"	CAS/FIX/CAS	WD	TEMPERED	1'-6"/3'-0"/1'-6"	
11	2'-6"	9'-0"	15'-8"	FIXED	WD	TEMPERED	3 MULLED UNITS (2'-6"X3'-0"), FROSTED GLASS	
12	3'-6"	1'-10"	6'-8"	AWENING	WD	TEMPERED		
13	5'-0"	4'-0"	6'-8"	CAS/CAS	WD	TEMPERED	EGRESS WINDOW	
14	2'-0"	3'-6"	6'-8"	CASEMENT	WD	TEMPERED		
UPPER	LEVEL				•			
15	3'-0"	3'-0"	6'-8"	CASEMENT	WD		EGRESS WINDOW	
16	3'-0"	3'-0"	6'-8"	FIXED	WD			
17	3'-0"	3'-0"	6'-8"	CASEMENT	WD			
18	2'-0"	3'-2"	6'-8"	CASEMENT	WD	TEMPERED		
19	4'-0"	3'-2"	6'-8"	DBL. CASEMENT	WD			
20	1'-6"	6'-8"	6'-8"	FIXED	WD	TEMPERED	MULLED W/ DOOR #27	
21	1'-6"	6'-8"	6'-8"	FIXED	WD	TEMPERED	MULLED W/ DOOR #27	
22	4'-0"	2'-0"	6'-8"	DBL. CASEMENT	WD	TEMPERED		
23	2'-0"	2'-0"	6'-8"	CASEMENT	WD			
24	2'-0"	2'-0"	6'-8"	CASEMENT	WD			
25	2'-0"	2'-0"	6'-8"	FIXED	WD			
26	2'-0"	2'-0"	6'-8"	CASEMENT	WD			


WINDOW SCHEDULE

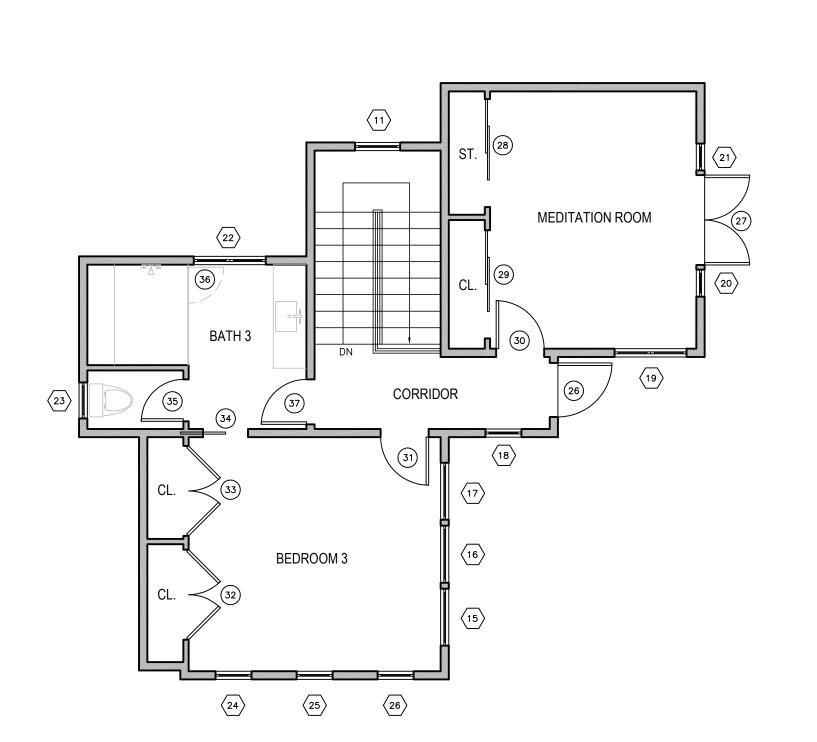

DOOR/WINDOW LEGEND

DENOTES A WINDOW

DENOTES A DOOR



UPPER FLOOR PLAN

3/16"=1'-0"

ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942

(831) 682-1331 anatoly@aoarchdesign.com


07-04-23
PLANNING REVISIONS PLANNING REVISIONS

WIN/DOOR SCHEDULE

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

A9.0

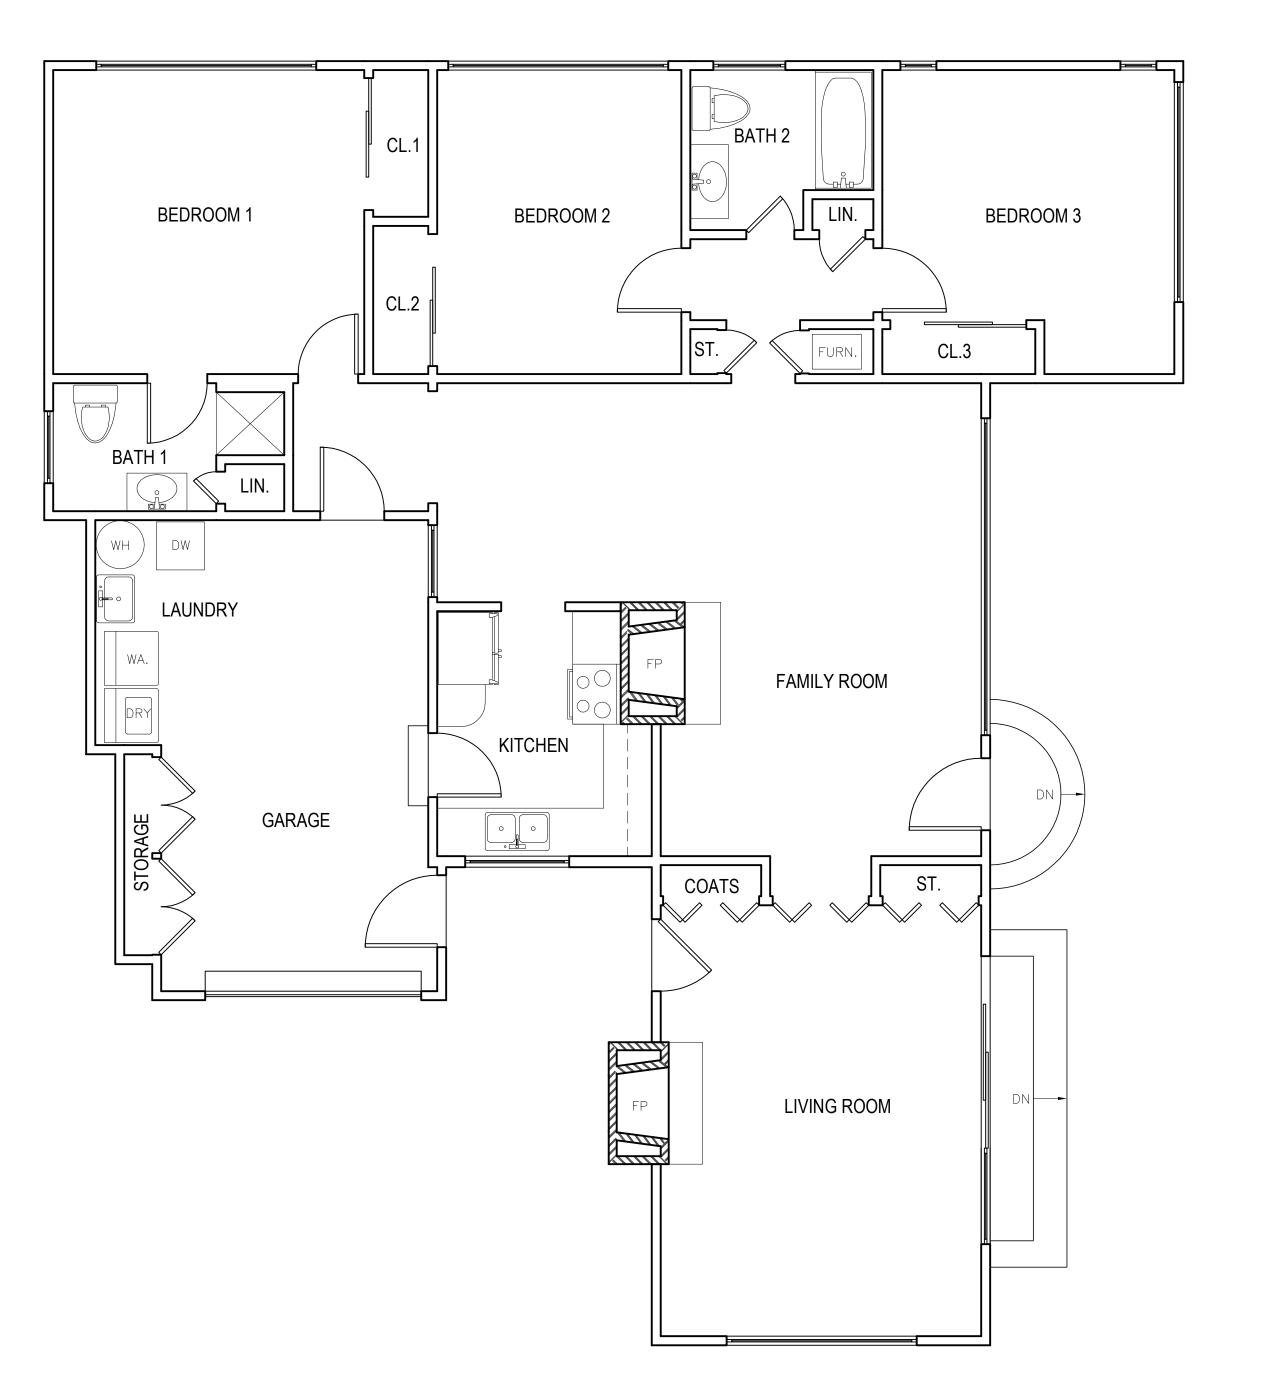




P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

EXISTING FLOOR PLAN

DATE: 07-30-2022 AS-BUILT

SHEET NO.

E2.0





ANATOLY OSTRETSOV P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

SIDENC


EXISTING ROOF PLAN

DATE: 07-30-2022 AS-BUILT

SHEET NO.

E5.0



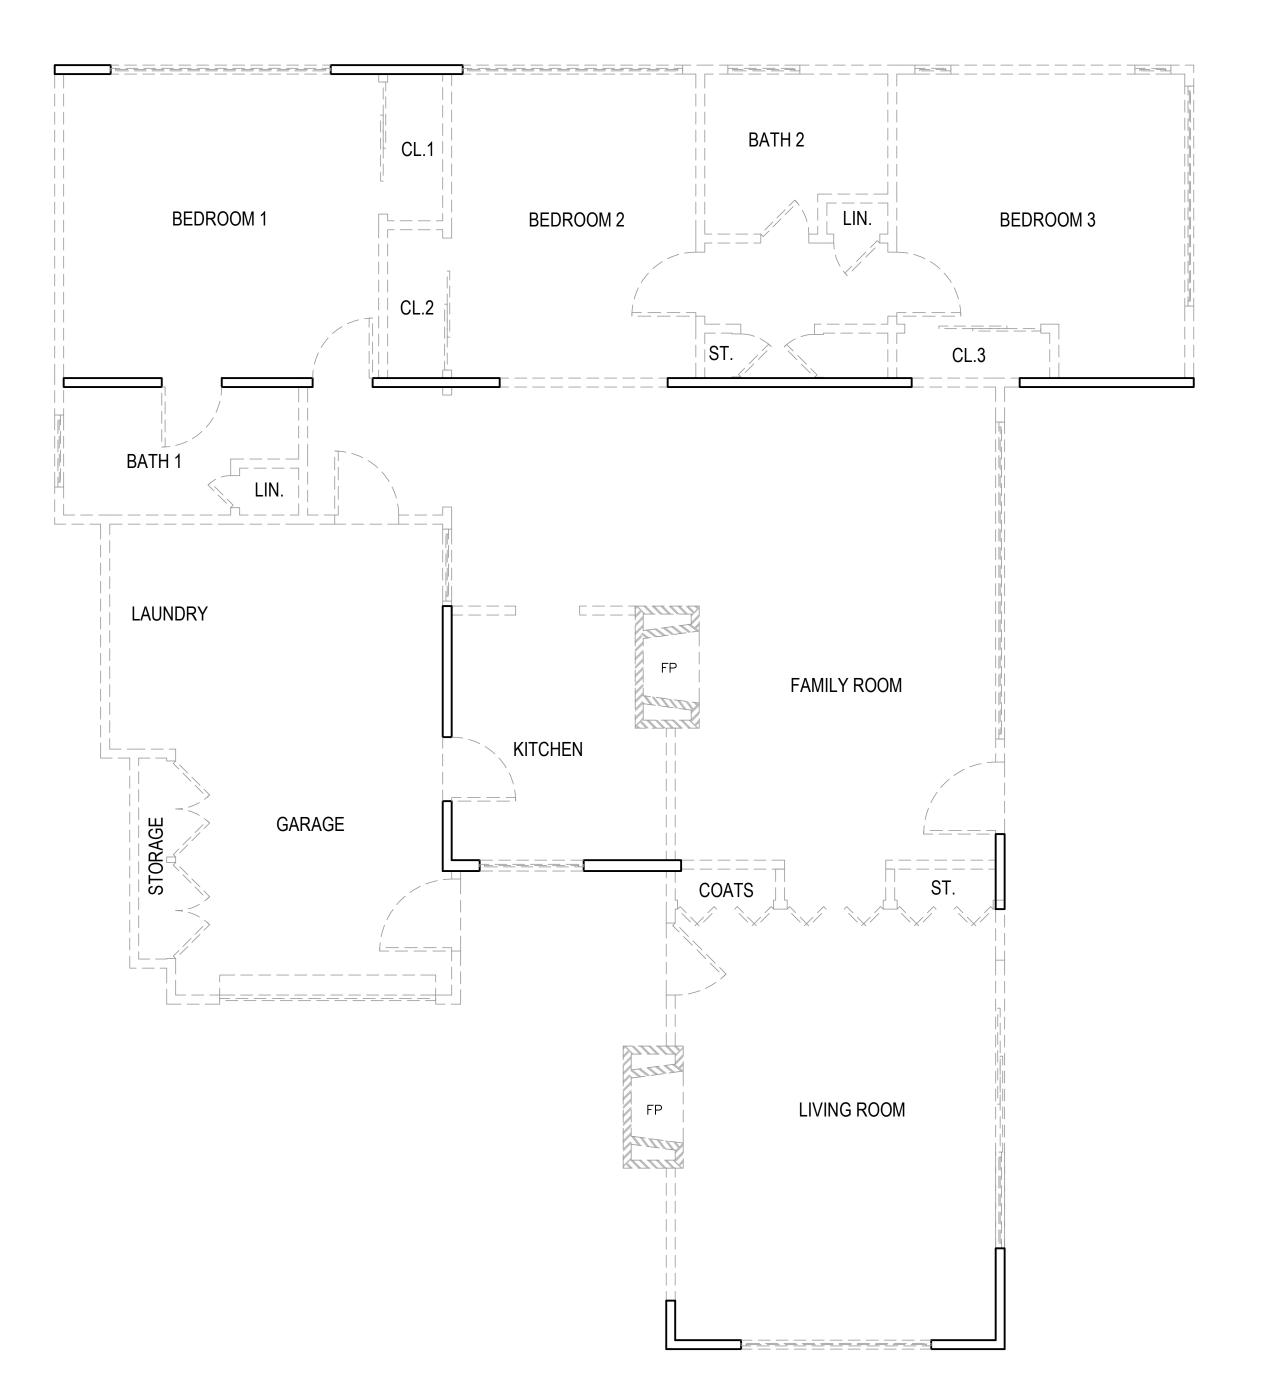

REVISIONS: 07-04-23
PLANNING REVISIONS

DEMOLITION FLOOR PLAN

DATE: 04-02-23 DESIGN APPROVAL

SHEET NO.

D2.0


2X EXISTING WALL TO REMAIN

EXISTING MASONRY WALL TO BE REMOVED

(E) DOOR OR WINDOW TO BE REMOVED

ZX EXISTING WALL TO BE REMOVED

WALL LEGEND

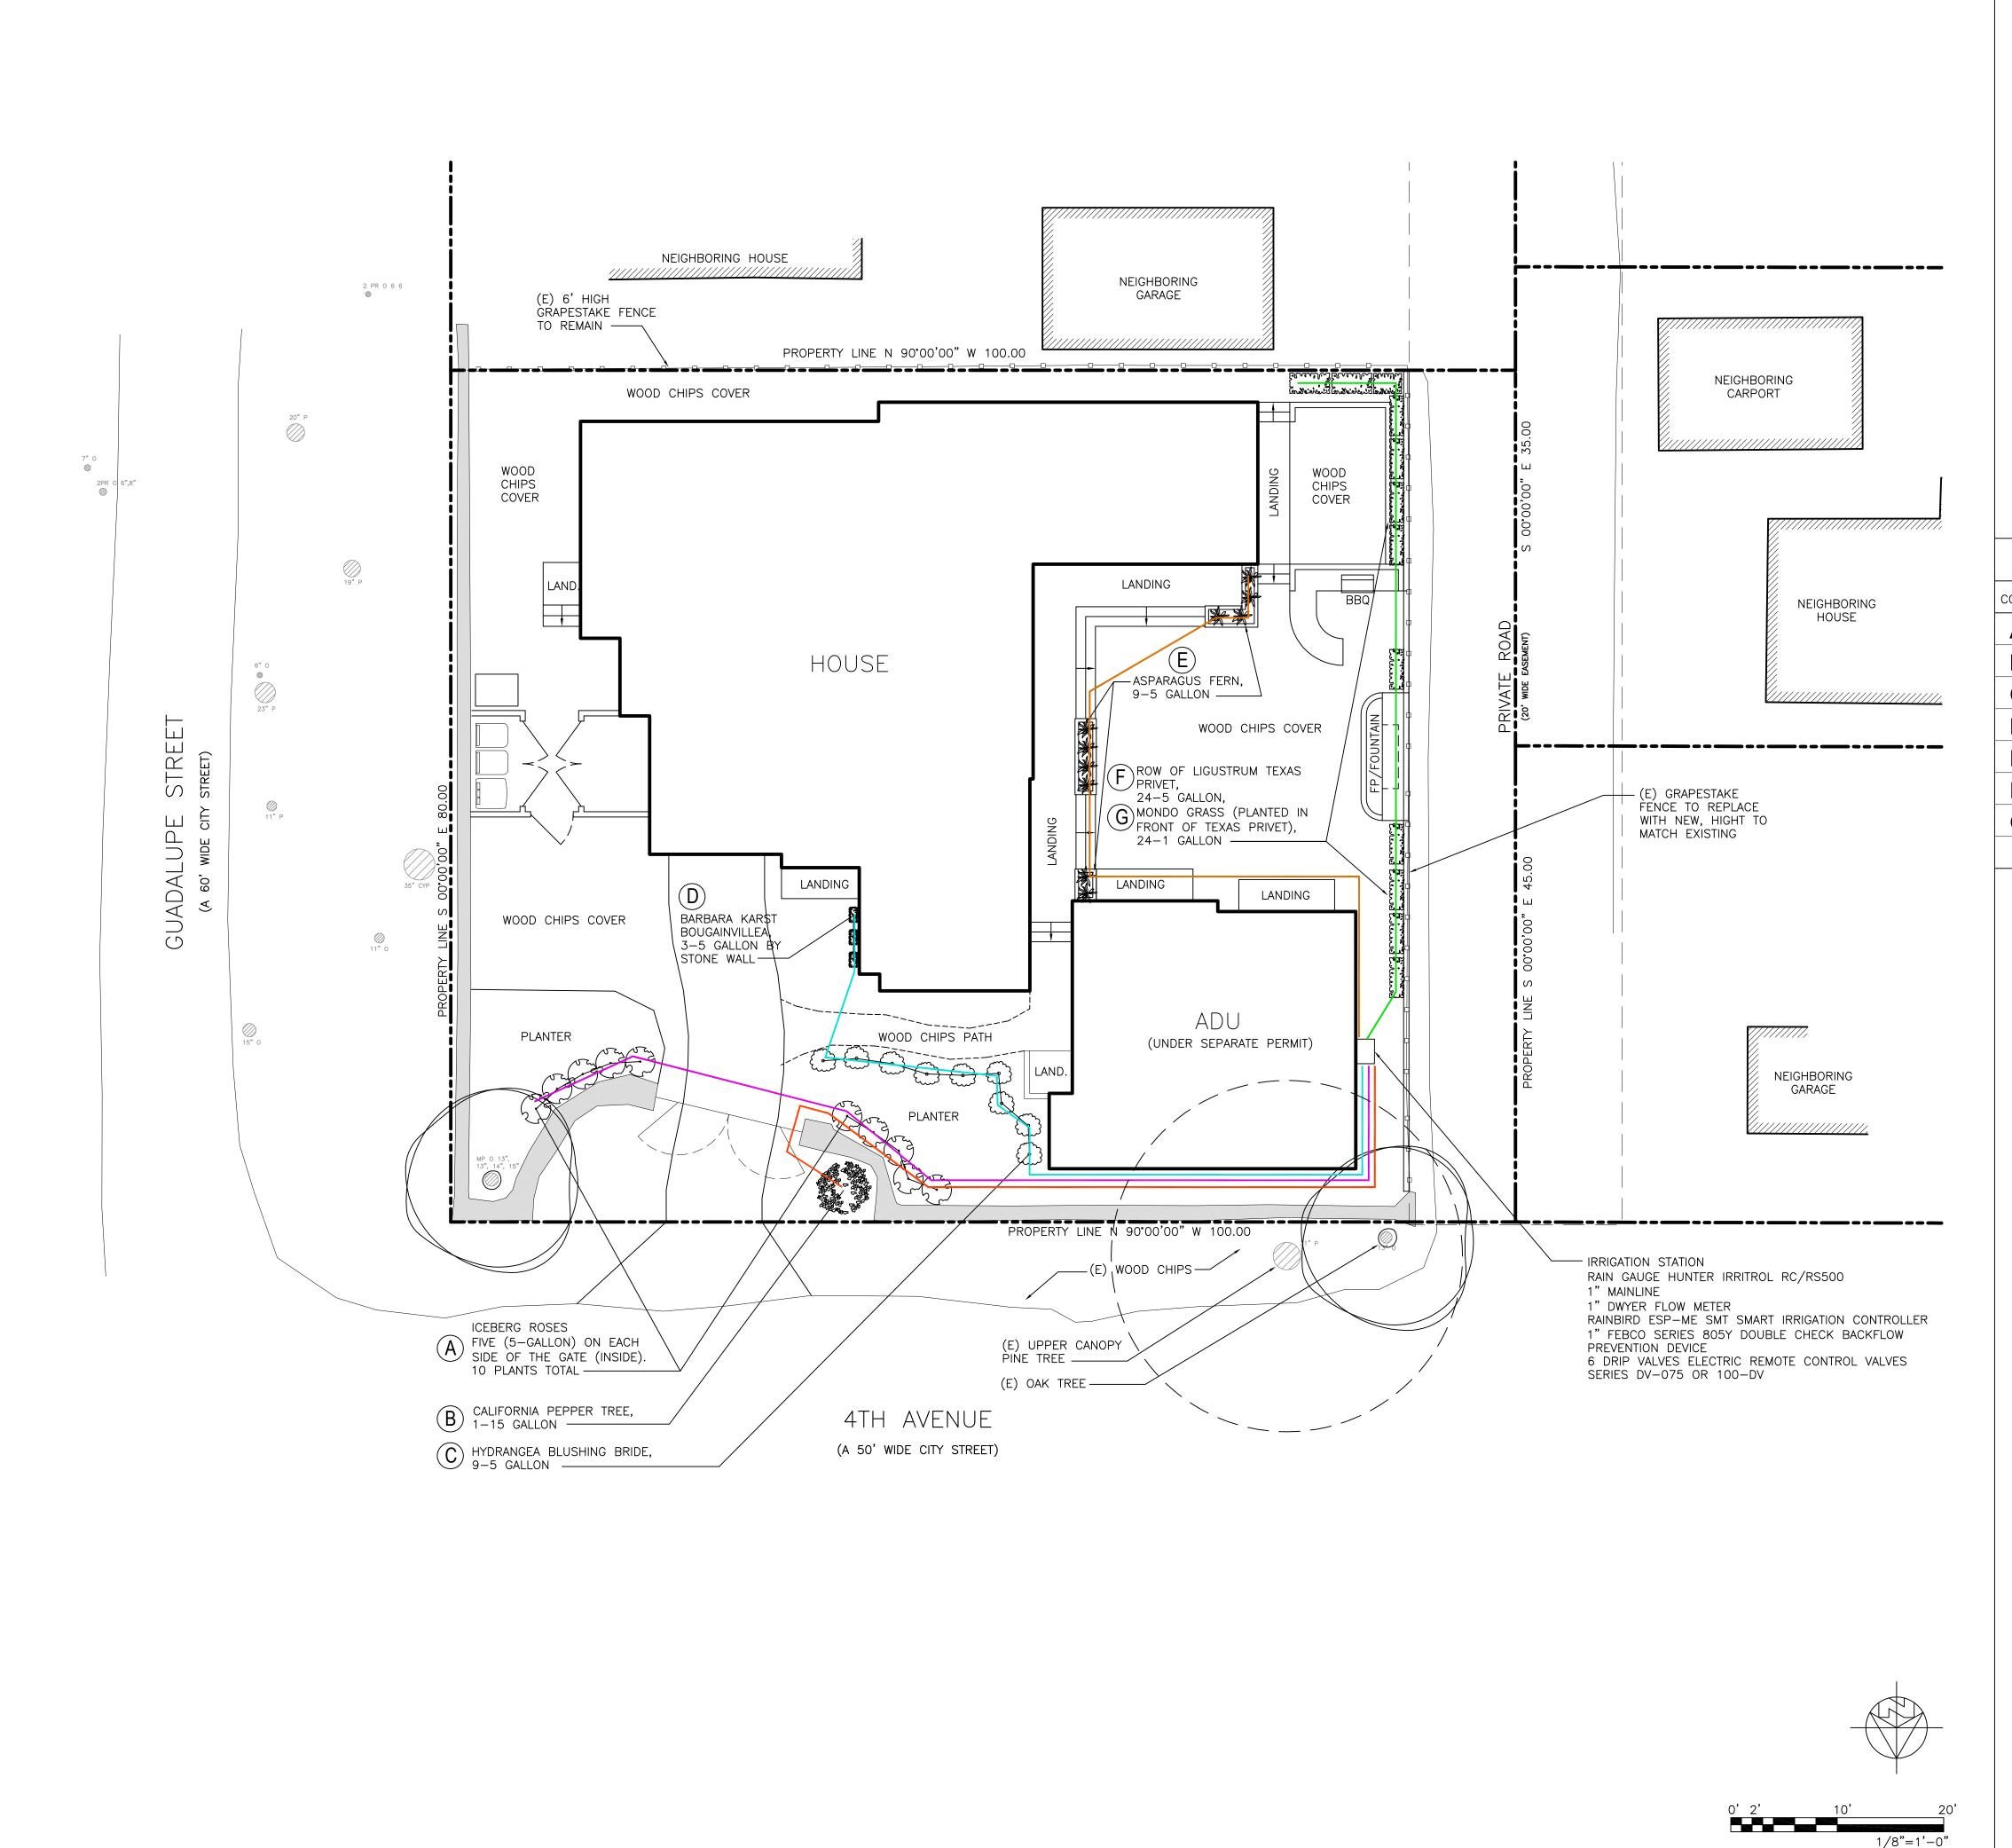

GENERAL IRRIGATION NOTES

1. AUTOMATIC IRRIGATION CONTROLLERS ARE REQUIRED AND MUST USE EVAPOTRANSPIRATION OR SOIL MOISTURE SENSOR DATA AND UTILIZE A RAIN SENSOR.

SOIL MOISTURE SENSOR DATA AND UTILIZE A RAIN SENSOR.

2 IRRIGATION CONTROLLERS SHALL BE OF A TYPE WHICH DOES NOT LOSE PROGRAMMING DATA

2. IRRIGATION CONTROLLERS SHALL BE OF A TYPE WHICH DOES NOT LOSE PROGRAMMING DATA IN THE EVENT THE PRIMARY POWER SOURCE IS INTERRUPTED.

3. PRESSURE REGULATORS SHALL BE INSTALLED ON THE IRRIGATION SYSTEM TO ENSURE THE DYNAMIC PRESSURE OF THE SYSTEM IS WITHIN THE MANUFACTURERS RECOMMENDED PRESSURE RANGE

4. MANUAL SHUT-OFF VALVES (SUCH AS A GATE VALVE, BALL VALVE, OR BUTTERFLY VALVE) SHALL BE INSTALLED AS CLOSE AS POSSIBLE TO THE POINT OF CONNECTION TO THE WATER SUPPLY.

5. ALL IRRIGATION EMISSION DEVICES MUST MEET THE REQUIREMENTS SET IN THE ANSI STANDARD, ASABE/ICC 802-2014. "LANDSCAPE IRRIGATION SPRINKLER AND EMITTER STANDARD". ALL SPRINKLER HEADS INSTALLED IN THE LANDSCAPE MUST DOCUMENT A DISTRIBUTION UNIFORMITY LOW QUARTER OF 0.65 OR HIGHER USING THE PROTOCOL DEFINED IN ASABE/ICC 802-2014.

6. AREAS LESS THAN TEN FEET (10') IN WIDTH IN ANY DIRECTION SHALL BE IRRIGATED WITH SUBSURFACE IRRIGATION OR OTHER MEANS THAT PRODUCES NO RUNOFF OR OVERSPRAY.

7. IRRIGATION TO BE RUN OFF SEPARATE MAINLINE EXTENSION WITH ISOLATION SHUT OFF VALVE

8. ALL DRIP LINES TO HAVE AN IN-LINE FILTER

9. PRESSURE FOR REGULATOR FOR DRIP IRRIGATION TO BE REGULATED TO 25-35 PSI

10. ALL VALVES TO BE SUB-GRADE WITHIN A WEATHERPROOF VALVE BOX

PLANT LIST

DE	QTY	SIZE	BOTANICAL NAME	COMMON NAME	specifications
1	10	5 GAL	ROSA KORBIN	ICEBERG ROSES	specific
3	1	15 GAL	SCHINUS MOLLE	CALIFORNIA PEPPER TREE	s and
	9	5 GAL	HYDRANGEA MACROPHYLLA	HYDRANGEA BLUSHING BRIDE	to plans
)	3	5 GAL	BOUGAINVILLEA	BOUGAINVILLEA BARBARA KARST	Title
	9	5 GAL	ASPARAGUS SETACEUS	ASPARAGUS FERN	prohibited.
-	24	5 GAL	LIGUSTRUM JAPONICUM	TEXAS PRIVET	.∞
ć	24	1 GAL	OPHIOPOGON JAPONICUS	MONDO GRASS	in part
					e or

AO ARCHITECTURAL D E S I G N

ANATOLY OSTRETSOV

P.O.BOX 2272 MONTEREY, CA 93942 (831) 682-1331 anatoly@aoarchdesign.com

, ,

OWN RESIDEN

SW CORNER OF GUADALUPE A

REVISIONS:

1 07-04-23
PLANNING REVISIONS

<u>^2</u> ______

LANDSCAPING PLAN

DATE: 04-02-23

DESIGN APPROVAL


SHEET NO.

110

NOTE:
THE PLAN WAS PREPARED IN CLOSE COOPERATION WITH INCA LANDSCAPE MANAGEMENT.
LICENSE #875311

LANDSCAPING AND IRRIGATION PLAN

1/8"=1'-0"

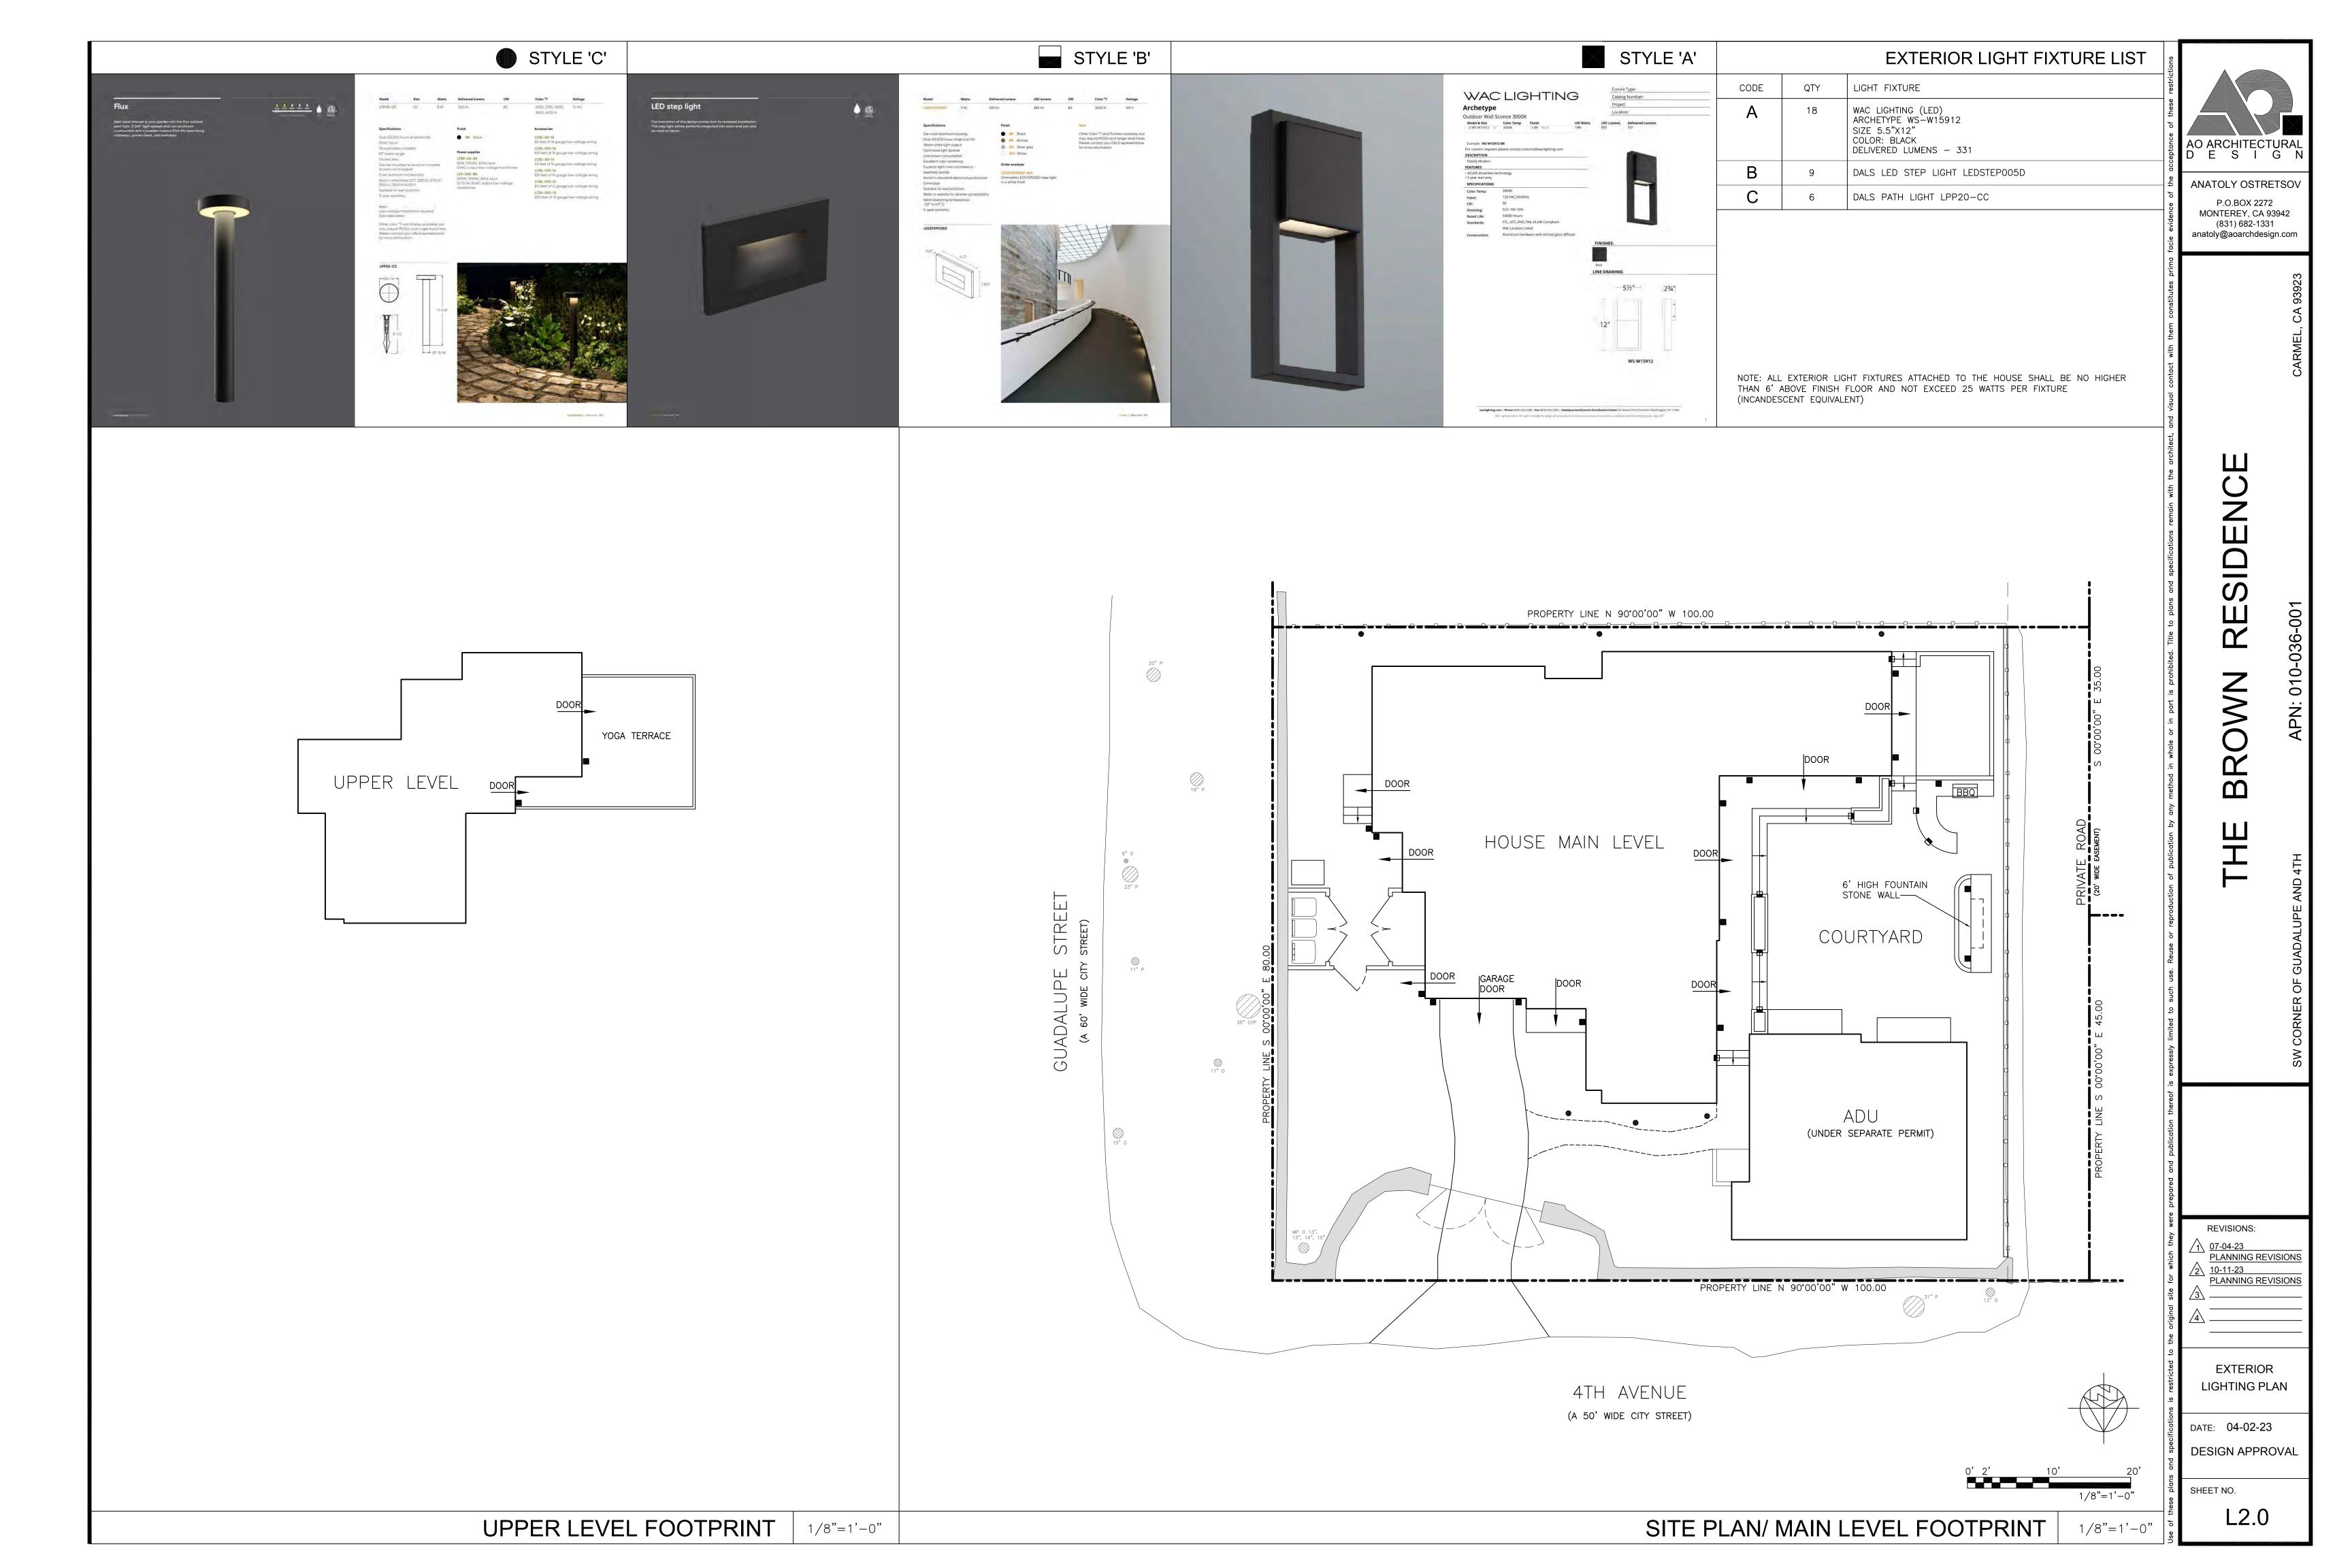

RECOMMENDED GRADING SPECIFICATIONS FOR EARTHWORK

ET:1 GENERAL DESCRIPTION:

1.1 THIS ITEM SHALL CONSIST OF ALL CLEARING AND GRUBBING: PREPARATION OF LAND TO BE FILLED: EXCAVATION AND FILL OF THE LAND: SPREADING. COMPACTION AND CONTROL OF THE FILL; AND ALL SUBSIDIARY WORK NECESSARY TO COMPLETE THE GRADED AREA TO CONFORM WITH THE LINES, GRADES AND

1.2 THE CONTRACTOR SHALL PROVIDE ALL EQUIPMENT AND LABOR NECESSARY TO COMPLETE THE WORK AS SPECIFIED HEREIN, AS SHOWN ON THE APPROVED PLANS AS STATED IN THE PROJECT SPECIFICATIONS.

1.3 RETAINING WALLS REQUIRE A SEPARATE BUILDING PERMIT, ALL BUILDING/GRADING PLANS FOR RETAINING WALL TO CLEAR PERMITS (I.E. PLN130852 AND 13CP1301799). STOP WORK WITHIN 50 METERS (165 FEET) OF UNCOVERED RESOURCE AND CONTACT MONTEREY COUNTY RMA - PLANNING AND A QUALIFIED ARCHAEOLOGIST IMMEDIATELY IF CULTURAL, ARCHAEOLOGICAL, HISTORICAL OR PALEONTOLOGICAL RESOURCES ARE UNCOVERED.

ET:2 TESTS:

2.1 THE STANDARD TEST USED TO DEFINE MAXIMUM DENSITIES OF ALL COMPACTION WORK SHALL BE THE A.S.T.M. D-1557, MOISTURE DENSITY OF SOILS, USING A 10-POUND RAM AND 18-INCH DROP. ALL DENSITIES SHALL BE EXPRESSED AS A RELATIVE DENSITY IN TERMS OF THE MAXIMUM DENSITY OBTAINED IN THE LABORATORY BY THE FOREGOING STANDARD PROCEDURE.

2.2 IN-PLACE DENSITY SHALL BE DETERMINED BY TEST METHODS A.S.T.M. D-1556, DENSITY OF SOIL IN-PLACE BY SAND CONE METHOD AND D-2922, DENSITY OF SOIL

2.3 PAD ELEVATIONS SHALL BE CERTIFIED TO 0.1 FEET, PRIOR TO DIGGING ANY FOOTINGS OR SCHEDULING ANY INSPECTIONS.

ET:3 CLEARING, GRUBBING AND PREPARING AREAS TO BE EXCAVATED OR FILLED:

3.1 ALL VEGETABLE MATTER, IRREDUCIBLE MATERIAL GREATER THAN 4 INCHES AND OTHER DELETERIOUS MATERIALS SHALL BE REMOVED FROM THE AREAS IN WHICH GRADING IS TO BE DONE. ALL STUMPS AND ROOT MASSES OF REMOVED TREES ARE TO CLEARED FROM AREA OF CONSTRUCTION AND FILL PLACEMENT. SUCH MATERIALS NOT SUITABLE FOR REUSE SHALL BE DISPOSED OF AS DIRECTED.

3.2 AFTER THE FOUNDATION FOR FILL HAS BEEN CLEARED. IT SHALL BE BROUGHT TO THE PROPER MOISTURE CONTENT BY ADDING WATER OR AERATING AND COMPACTING TO A RELATIVE DENSITY OF NOT LESS THAN 90% OR AS SPECIFIED. COMPACTION OF FILL PLACED IN LANDSCAPE AREA TO BE COMPACTED TO A RELATIVE DENSITY OF APPROXIMATELY 80% OR AS DIRECTED BY THE OWNER. THE SOILS SHALL BE TESTED TO A DEPTH SUFFICIENT TO DETERMINE QUALITY AND SHALL BE APPROVED BY THE SOILS ENGINEER FOR FOUNDATION PURPOSES PRIOR TO PLACING ENGINEERED FILL.

ET:4 MATERIALS:

4.1 THE MATERIAL FOR ENGINEERED FILL SHALL BE APPROVED BY THE SOILS ENGINEER BEFORE COMMENCEMENT OF GRADING OPERATIONS. ANY IMPORTED MATERIAL MUST BE APPROVED FOR USE BEFORE BEING BROUGHT TO THE SITE. THE MATERIAL USED SHALL BE FREE FROM VEGETABLE MATTER AND OTHER

4.2 IMPORTED MATERIALS FOR ENGINEERED FILL SHALL CONSIST OF NON-EXPANSIVE SOIL WITH MAXIMUM AGGREGATE SIZE OF 4 INCHES, A PI LESS THAN 15 AND/OR A CU GREATER THAN 4 AND SHALL BE APPROVED BY THE ENGINEER.

ET:5 PLACING, SPREADING AND COMPACTING FILL MATERIAL:

5.1 THE SELECTED FILL MATERIAL SHALL BE PLACED IN LAYERS WHICH, WHEN COMPACTED, SHALL NOT EXCEED 6 INCHES IN THICKNESS. EACH LAYER SHALL BE SPREAD EVENLY AND SHALL BE THOROUGHLY MIXED DURING THE SPREADING TO ENSURE UNIFORMITY OF MATERIAL IN EACH LAYER. FILL SHALL BE PLACED SUCH THAT CROSS FALL DOES NOT EXCEED 1 FOOT IN 20 UNLESS OTHERWISE DIRECTED.

5.2 WHEN FILL MATERIAL INCLUDES ROCK OR CONCRETE RUBBLE, NO IRREDUCIBLE MATERIAL LARGER THAN 4 INCHES IN GREATEST DIMENSION WILL BE ALLOWED EXCEPT UNDER THE DIRECTION OF THE SOILS ENGINEER.

5.3 THE MOISTURE CONTENT OF THE FILL MATERIAL SHALL BE MAINTAINED IN A SUITABLE RANGE TO PERMIT EFFICIENT COMPACTION. THE SOILS ENGINEER MAY REQUIRE ADDING MOISTURE, AERATING, OR BLENDING OF WET AND DRY SOILS.

5.4 EACH LAYER SHALL BE COMPACTED TO THE SPECIFIED RELATIVE DENSITY. COMPACTION SHALL BE CONTINUOUS OVER THE ENTIRE AREA OF EACH LAYER.

5.5 FIELD DENSITY TEST SHALL BE MADE BY THE SOILS ENGINEER OF EACH COMPACTED LAYER. AT LEAST ONE TEST SHALL BE MADE FOR EACH 500 CUBIC YARDS OR FRACTION THEREOF, PLACED WITH A MINIMUM OF TWO TESTS PER LAYER IN ISOLATED AREAS. WHERE A SHEEP-FOOT ROLLER IS USED, THE SOIL MAY BE DISTURBED TO A DEPTH OF SEVERAL INCHES. DENSITY TESTS SHALL BE TAKEN IN COMPACTED MATERIALS BELOW THE DISTURBED SURFACE. WHEN THESE TESTS INDICATE THAT THE DENSITY OF ANY LAYER OF FILL OR PORTION THEREOF, IS BELOW THE REQUIRED DENSITY, THAT PARTICULAR LAYER OR PORTION SHALL BE REWORKED UNTIL THE REQUIRED DENSITY HAS BEEN OBTAINED.

5.6 ALL EARTH MOVING AND WORK OPERATIONS SHALL BE CONTROLLED TO PREVENT WATER FROM RUNNING INTO EXCAVATED AREAS. ALL SUCH WATER SHALL BE

5.7 CUT AND FILL SLOPES STEEPER THAN TWO HORIZONTAL TO ONE VERTICAL MUST BE APPROVED BY THE SOILS ENGINEER

ET:6 SEASONAL LIMITS:

6.1 WHEN THE WORK IS INTERRUPTED BY RAIN, FILL OPERATIONS SHALL NOT BE RESUMED UNTIL FIELD TESTS BY THE SOILS ENGINEER INDICATE THAT THE MOISTURE CONTENT AND DENSITY OF THE FILL IS AS PREVIOUSLY SPECIFIED AND SOILS TO BE PLACED ARE IN SUITABLE CONDITION.

ET:7 UNUSUAL CONDITIONS:

7.1 IN THE EVENT THAT ANY UNUSUAL CONDITIONS ARE ENCOUNTERED DURING GRADING OPERATIONS WHICH ARE NOT COVERED BY THE SOIL INVESTIGATION OR THE SPECIFICATIONS. THE SOILS ENGINEER SHALL BE IMMEDIATELY NOTIFIED SUCH THAT ADDITIONAL RECOMMENDATIONS MAY BE MADE.

8.1 A COPY OF ALL COMPACTION TESTS AND FINAL GRADING REPORTS SHALL BE SUBMITTED TO THE COUNTY PRIOR TO SCHEDULING ANY INSPECTIONS.

8.2 ALL GRADING SHALL CONFORM WITH THE MONTEREY COUNTY GRADING ORDINANCE #2535.

8.3 THE SOILS ENGINEER SHALL INSPECT THE BUILDING PAD AND FOUNDATION EXCAVATIONS & SUBMIT WRITTEN APPROVAL TO THE BUILDING INSPECTOR BEFORE REQUESTING FOUNDATION INSPECTION AND POURING OF ANY FOOTINGS.

EROSION CONTROL PLANNING

ER:1 GENERAL DESCRIPTION:

1.1 INSTALLATION OF THE EROSION PROTECTION FEATURES CONFORM TO THE EXISTING AND PROPOSED GRADES AND CONSIDER THE TOPOGRAPHIC AND HYDROLOGIC FEATURES OF THE SITE. ALL DISTURBED AREAS ARE TO BE PROVIDED WITH EROSION CONTROL AS GIVE UNDER SECTION ER:3.

1.2 COLLECTED RUNOFF IS TO BE RELEASED IN A CONTROLLED FASHION. COLLECTED RUNOFF FLOWS IS TO BE DIRECTED INTO PIPES AND THEN ONTO AN ENERGY DISSIPATER TO REDUCE THE HYDRAULIC GRADIENT BEFORE DISCHARGING THE RUNOFF TO GRADE.

1.4 DE-SILTATION OF RUNOFF MAY TAKE FORM OF STILLING BASINS, GRAVEL BERM, TURF OR VEGETATION SCREENS, REFORESTATION, ETC..

1.5 FREE FLOWING STORM RUNOFF SHOULD NEVER BE DIRECTED TOWARDS STRUCTURE (ON OR OFF SITE) OR STRUCTURES SENSITIVE TO FREE FLOWING WATER. COLLECTED DRAINAGE ADJACENT TO SENSITIVE STRUCTURES IS TO BE CARRIED IN CLOSED CONDUIT OR LÍNED SURFACE DRAIN.

1.6 ANY SITE SOILS OR OTHER MATERIALS WHICH ARE DISTURBED SHALL BE ADEQUATELY WATERED TO PREVENT DUST FROM BECOMING AIRBORNE IN ACCORDANCE WITH LOCAL DUST CONTROL ORDINANCES.

ER:1 MATERIALS STORAGE:

2.1 DURING CONSTRUCTION, NEVER STORE CUT AND FILL MATERIAL WHERE IT MAY WASH INTO DRAINAGE WAYS. SHOULD WEATHER THREATEN THE STORED MATERIALS IT SHOULD BE COVERED WITH PLASTIC OR APPROPRIATE RETENTION FACILITIES PROVIDED FOR DESILTATION OF THE STORM WATER PRIOR TO RELEASE.

2.2 KEEP ALL CULVERTS AND DRAINAGE FACILITIES FREE OF SILT AND DEBRIS. KEEP EMERGENCY EROSION CONTROL MATERIALS SUCH AS STRAW MULCH, PLASTIC SHEETING, AND SANDBAGS ON SITE AND INSTALL THESE AT THE END OF EACH DAY AS NECESSARY.

ER:3 RE-VEGETATION AND PLANTING:

3.1 RE-VEGETATE AND PROTECT EXPOSED SOILS BY OCTOBER 15. USE APPROPRIATE GRASS/LEGUME SEED MIXES AND/OR STRAW MULCH FOR TEMPORARY COVER. PLAN PERMANENT VEGETATION TO INCLUDE NATIVE AND DROUGHT TOLERANT PLANTS. SEEDING AND RE-VEGETATION MAY REQUIRE SPECIAL SOIL PREPARATION, FERTILIZING, IRRIGATION, AND MULCHING.

3.1.A RECOMMENDED SEED SCHEDULE IS AS FOLLOWS: 40 POUNDS PER ACRE OF CALIFORNIA BROME 15 POUNDS PER ACRE OF BLUE WILD RYE

4 POUNDS PER ACRE OF ZORRO FESCUE 6 POUNDS PER ACRE OF RED CREEPING FESCUE

3.2 IN THE ABSENCE OF A DETAILED EROSION CONTROL PLAN, THE WORK WILL BE PROTECTED IN ACCORDANCE WITH THE APPROPRIATE ORDINANCE, REGULATION AND/OR STANDARD PRACTICE WHICH EVER PROVIDES SATISFACTORY EROSION PROTECTION.

3.3 ACTUAL GRADING SHALL BEGIN WITHIN 30 DAYS OF VEGETATION REMOVAL OR THE AREA SHALL BE PLANTED TO CONTROL EROSION.

ER:4 COUNTY

4.1 ALL EROSION CONTROL MEASURES FOR GRADING SHALL BE IN PLACE AT THE END OF EACH WORKING DAY BETWEEN OCTOBER 15 AND APRIL 15.

4.2 ALL EROSION CONTROL MEASURES SHALL CONFORM WITH MONTEREY COUNTY EROSION CONTROL ORDINANCE #2806.

ABBREVIATIONS - USED WITH OR WITHOUT PERIODS (E.G. = EG)

AC ASPHALTIC PAVEMENT ACD FINISH GRADE ASPHALTIC CONCRETE DRIVE

ACR ACRE APN ASSESORS PARCEL NUMBER

BCR BEGINNING OF CURB RETURN BS BASE OF THE STEP

втм воттом

BWF BASE OF WALL AT FACE (TALLEST FACE)

BWR BASE OF WALL AT REAR (SHORTEST FACE) C"NUMBER" CURVE NUMBER. SEE TABLE

CB CATCH BASIN CD FINISH GRADE CONCRETE DRIVE

CF FINISH GRADE CONCRETE RESIDENTIAL FLOOR

CG FINISH GRADE CONCRETE GARAGE FLOOR CW FINISH GRADE CONCRETE WALK

CL CENTER LINE CNTR CENTER CONST ITEM TO BE CONSTRUCTED

CPV CONCRETE PAVEMENT DI DRAINAGE INLET DRTE EXISTING GRADE OF DIRT

DRTF FINISH GRADE OF DIRT E or (E) EAST OR EXISTING

EX or (EX) EXISTING (EC) "EXISTING" INFORMATION COMPUTED FROM A SURVEY OR OTHERWISE NOTED DATA

EL ELEVATION END END

EOC END OF CURB

ECR END OF CURB RETURN

EP EDGE OF PAVEMENT FF FINISH FLOOR (STEPPED DOWN EDGE OF THE FOUNDATION SLABS)

FG FINISH GRADE FL FLOW LINE

FT FEET GRT FINISH GRADE OF GRATE OR DRAINAGE INLET

HDPE HIGH DENSITY POLYETHYLENE HPS HIGH PRESSURE SODIUM

INV ELEVATION OF BOTTOM INSIDE OF PIPE (INVERT)

L LEFT

MAX MAXIMUM

MIN MINIMUM

N or (N) NORTH OR NEW

PAR PARCEL

PER PURSUANT TO P.M. PARCEL MAP

R or (R) RIGHT

RD RADIUS

SE SAND EQUIVALENCY

SHT SHEET SL SLOPE

SS SANITARY SEWER

STA+ DISTANCE FORWARD ON PROFILE STA- DISTANCE BACKWARD ON PROFILE

TC TOP OF FACE (ROADSIDE) OF CURB

VOL VOLUME

W WEST WA WATTS

WYE SEWER LATERAL CONNECTION SECONDS OF ANGLE OR INCHES MINUTES OF ANGLE OR FEET

DEGREES OF ANGLE

GRADE ADJACENT TO STRUCTURES


UNLESS OTHERWISE NOTED - THE GROUND IMMEDIATELY ADJACENT TO THE FOUNDATION OF BUILDINGS SHALL BE SLOPED AWAY FROM THE BUILDING AT A SLOPE OF NOT LESS THAN 1 UNIT VERTICAL IN 20 UNITS HORIZONTAL (5% SLOPE) FOR A MINIMUM DISTANCE OF 10 FEET MEASURED PERPENDICULAR TO THE FACE OF THE WALL (FOUNDATION). IF PHYSICAL OBSTRUCTIONS OR LOT LINES PROHIBIT 10 FEET OF HORIZONTAL DISTANCE A 5% SLOPE SHALL BE PROVIDED TO AN APPROVED ALTERNATIVE METHOD OF DIVERTING WATER AWAY FROM THE FOUNDATION. SWALES USED FOR THIS PURPOSE SHALL BE SLOPED A MINIMUM OF 2% WHERE LOCATED WITHIN 10 FEET OF THE BUILDING FOUNDATION. IMPERVIOUS SURFACES WITHIN 10 FEET OF THE BUILDING SHALL BE SLOPED A MINIMUM OF 2% AWAY FROM THE BUILDING.

PARCEL OWNER: MR. AND MRS. DAVID BROWN 1100 ALLIED DRIVE PLANTO, TEXAS 75093

THESE PLANS DETAIL DRAINAGE CONTROL FOR THE RUNOFF FROM THE ROOF OF PROPOSED ADDITIONS TO A RESIDENCE.

RECENTLY APPROVED ACCESSORY DWELLING UNIT DRAINAGE STRUCTURES ARE INCLUDED IN THIS PLAN SET FOR REFERENCE.

NO TREES ARE TO BE REMOVED.

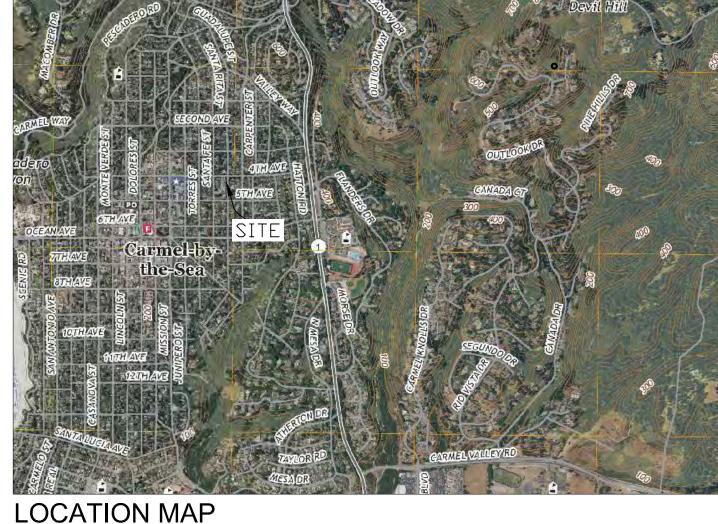

SOIL DISTURBANCE AREA: 176 SQ.FT. INCLUDES STORM DRAIN LINES GRADING BALANCE:

GROSS CUT = 2.16 CUBIC YARDS SHRINKAGE = 0.00 CUBIC YARDS

NET CUT (LESS SHRINKAGE) = 2.16 CUBIC YARDS TOTAL FILL = 1.85 CUBIC YARDS GRAVEL

= 0.35 CUBIC YARD EARTH COVER = 1.85 CUBIC YARDS GRAVEL TOTAL IMPORT

SHRINKAGE FACTOR 0%

VOLUME CALCS ARE TO FINISH GRADE AND DO NOT CONSIDER SPOILS (E.G. UNDERGROUND UTILITIES) OR SECTION THICKNESS (E.G. PAVEMENT, FOUNDATION, WALLS).

GEOTECHNICAL REPORT IS COMPLETED FOR THE PROJECT BY LANDSET ENGINEERS, INC. TELEPHONE (831) 443-6970, PROJECT NO. 2531-02. REFER TO THE RECOMMENDATIONS IN THE REPORT.

ALL WORK TO BE IN COMPLIANCE WITH GEOTECHNICAL REPORT AND PROJECT PLANS AND SPECIFICATIONS.

PROJECT ARCHITECT:

MR. ANATOLY OSTRETSOV A.O. ARCHITECTURE P.O. BOX 2272 MONTEREY, CALIFORNIA 93942 OFFICE (831) 682-1331 EMAIL: ANATOLY@AOARCHDESIGN.COM

PROJECT CONTRACTOR:

PROJECT DRAINAGE ENGINEER: MR. LAWRENCE E. GRICE

GRICE ENGINEERING, INC. 561A BRUNKEN AVENUE SALINAS, CALIFORNIA 93901 OFFICE (831) 422-9619 EMAIL: SAMGE@SBCGLOBAL.NET

PROJECT GEOTECHNICAL ENGINEER AND SURVEYOR: LANDSET ENGINEERS, INC. GUY R. GIRAUDO, P.E. 520-B CRAZY HORSE CANYON ROAD SALINAS, CALIFORNIA 93907 OFFICE (831) 443-6970 WWW.LANDSETENG.COM

> REVISION DATES

PUB 2022/11/20

PUB 2023/07/14

INDEX

T-0 TITLE AND SPECIFICATION SHEET

SD-1 DRAINAGE PLAN

SD-2 SECTION AND DETAILS (APPROVED ADU)

SD-2.1 SECTION AND DETAILS (RESIDENTIAL IMPROVEMENTS) C-5.0 EROSION CONTROL PLAN

MR. AND MRS. DAVID BROWN 1100 ALLIED DRIVE PLANTO, TEXAS 75093

PREPARED FOR:

SW CORNER OF GUADALUPE AND 4TH. CARMEL-BY-THE-SEA. CALIFORNIA

IMPROVEMENT PLANS - DRAINAGE CONTROL TITLE, SPECIFICATIONS AND NOTES

Date Plotted: Jul 14, 2023

FILE NO. 7639-22.11

ENGINEERING HYDROLOGY
 SOILS
 FOUNDATIONS
 EARTH STRUCTURES GEOTECHNICS

561A Brunken Avenue Salinas, California Salinas: (831) 422-9619 Monterey: (831) 375-1198 FAX: (831) 422-1896

2023-07-14DIGITAL

NOT VALID WITHOUT STAMP AND SIGNATURE

LAWRENCE E. GRICE, P.E.: R.C.E. 66857

J.U. JOINT UTILITIES

LAT LATERAL LATS MULTIPLE, SEPARATE LATERALS

LF LINEAR FEET LNDS LANDSCAPE OR EARTHER SURFACE MH MANHOLE

NS NOSE OF THE STEP NW NEW, TO BE INSTALLED, CONSTRUCTED OR FINISHED TO P or (P) PROPOSED

PV PAVEMENT PVC POLY VINYL CHLORIDE PVI POINT OF VERTICAL INTERSECTION

RIMC ELEVATION OF CENTER OF MANHOLE RIMN or NRIM ELEVATION OF NORTH EDGE OF MANHOLE S SOUTH SD STORM DRAIN

SOF ELEVATION OF TOP OF INSIDE OF PIPE (SOFFIT) SP STANDARD PLAN

THR THROUGH TP TOP V VOLTS

> LEGEND EXISTING MAJOR TOPO LINE, 5 FT INTERVAL

> > **EXISTING MINOR TOPO LINE, 1 FT INTERVAL** EXISTING PROPERTY LINE EXISTING UTILITY EASEMENT LINE

PROPOSED MAJOR TOPO LINE, 1 FT INTERVAL PROPOSED MINOR TOPO LINE, 0.25 FT INTERVAL

DRAIN LINE, 4" PVC SDR35

26.08 LF, SLOPE 2%

MATCH LINE BETWEEN EXISTING AND

_ _ _ _ _ _ _ _


STORM DRAIN LINE


PROPOSED GRADES


C-5.1 EROSIN OCONTORL DETAILS


IMPROVEMENTS; BROWN RESIDENCE; A.P.N. 010-036-001


BROWN ADU

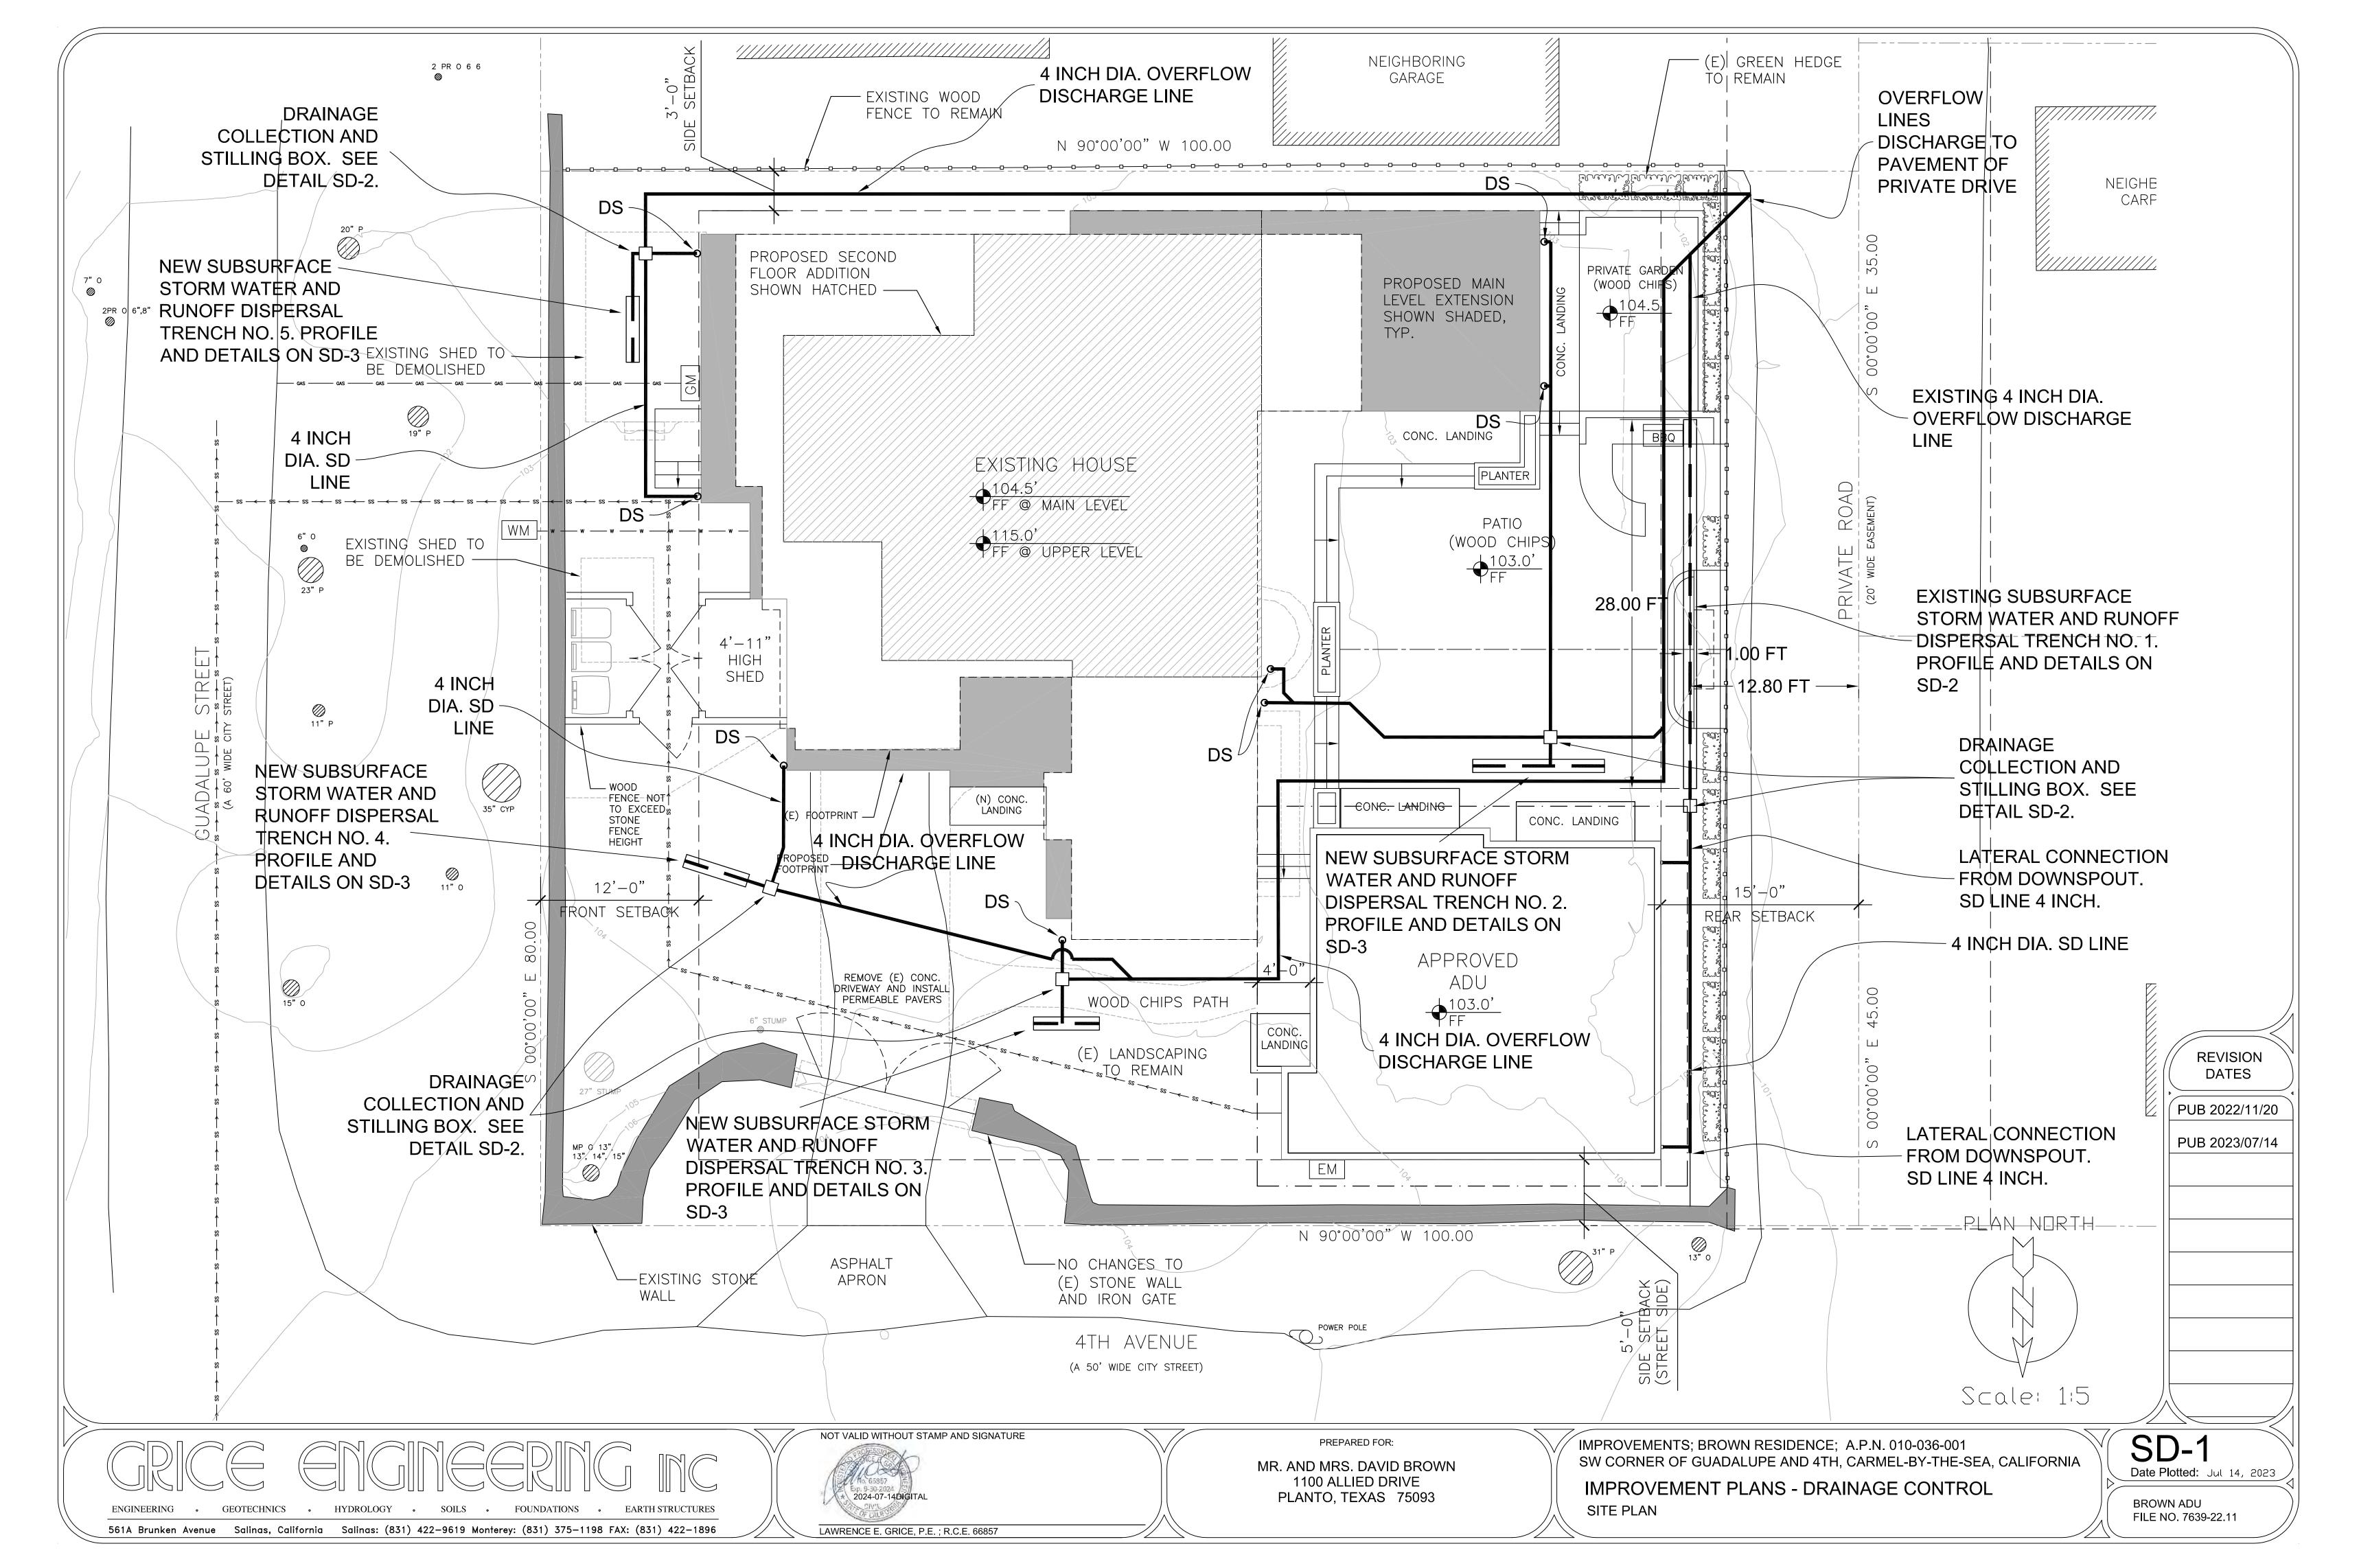

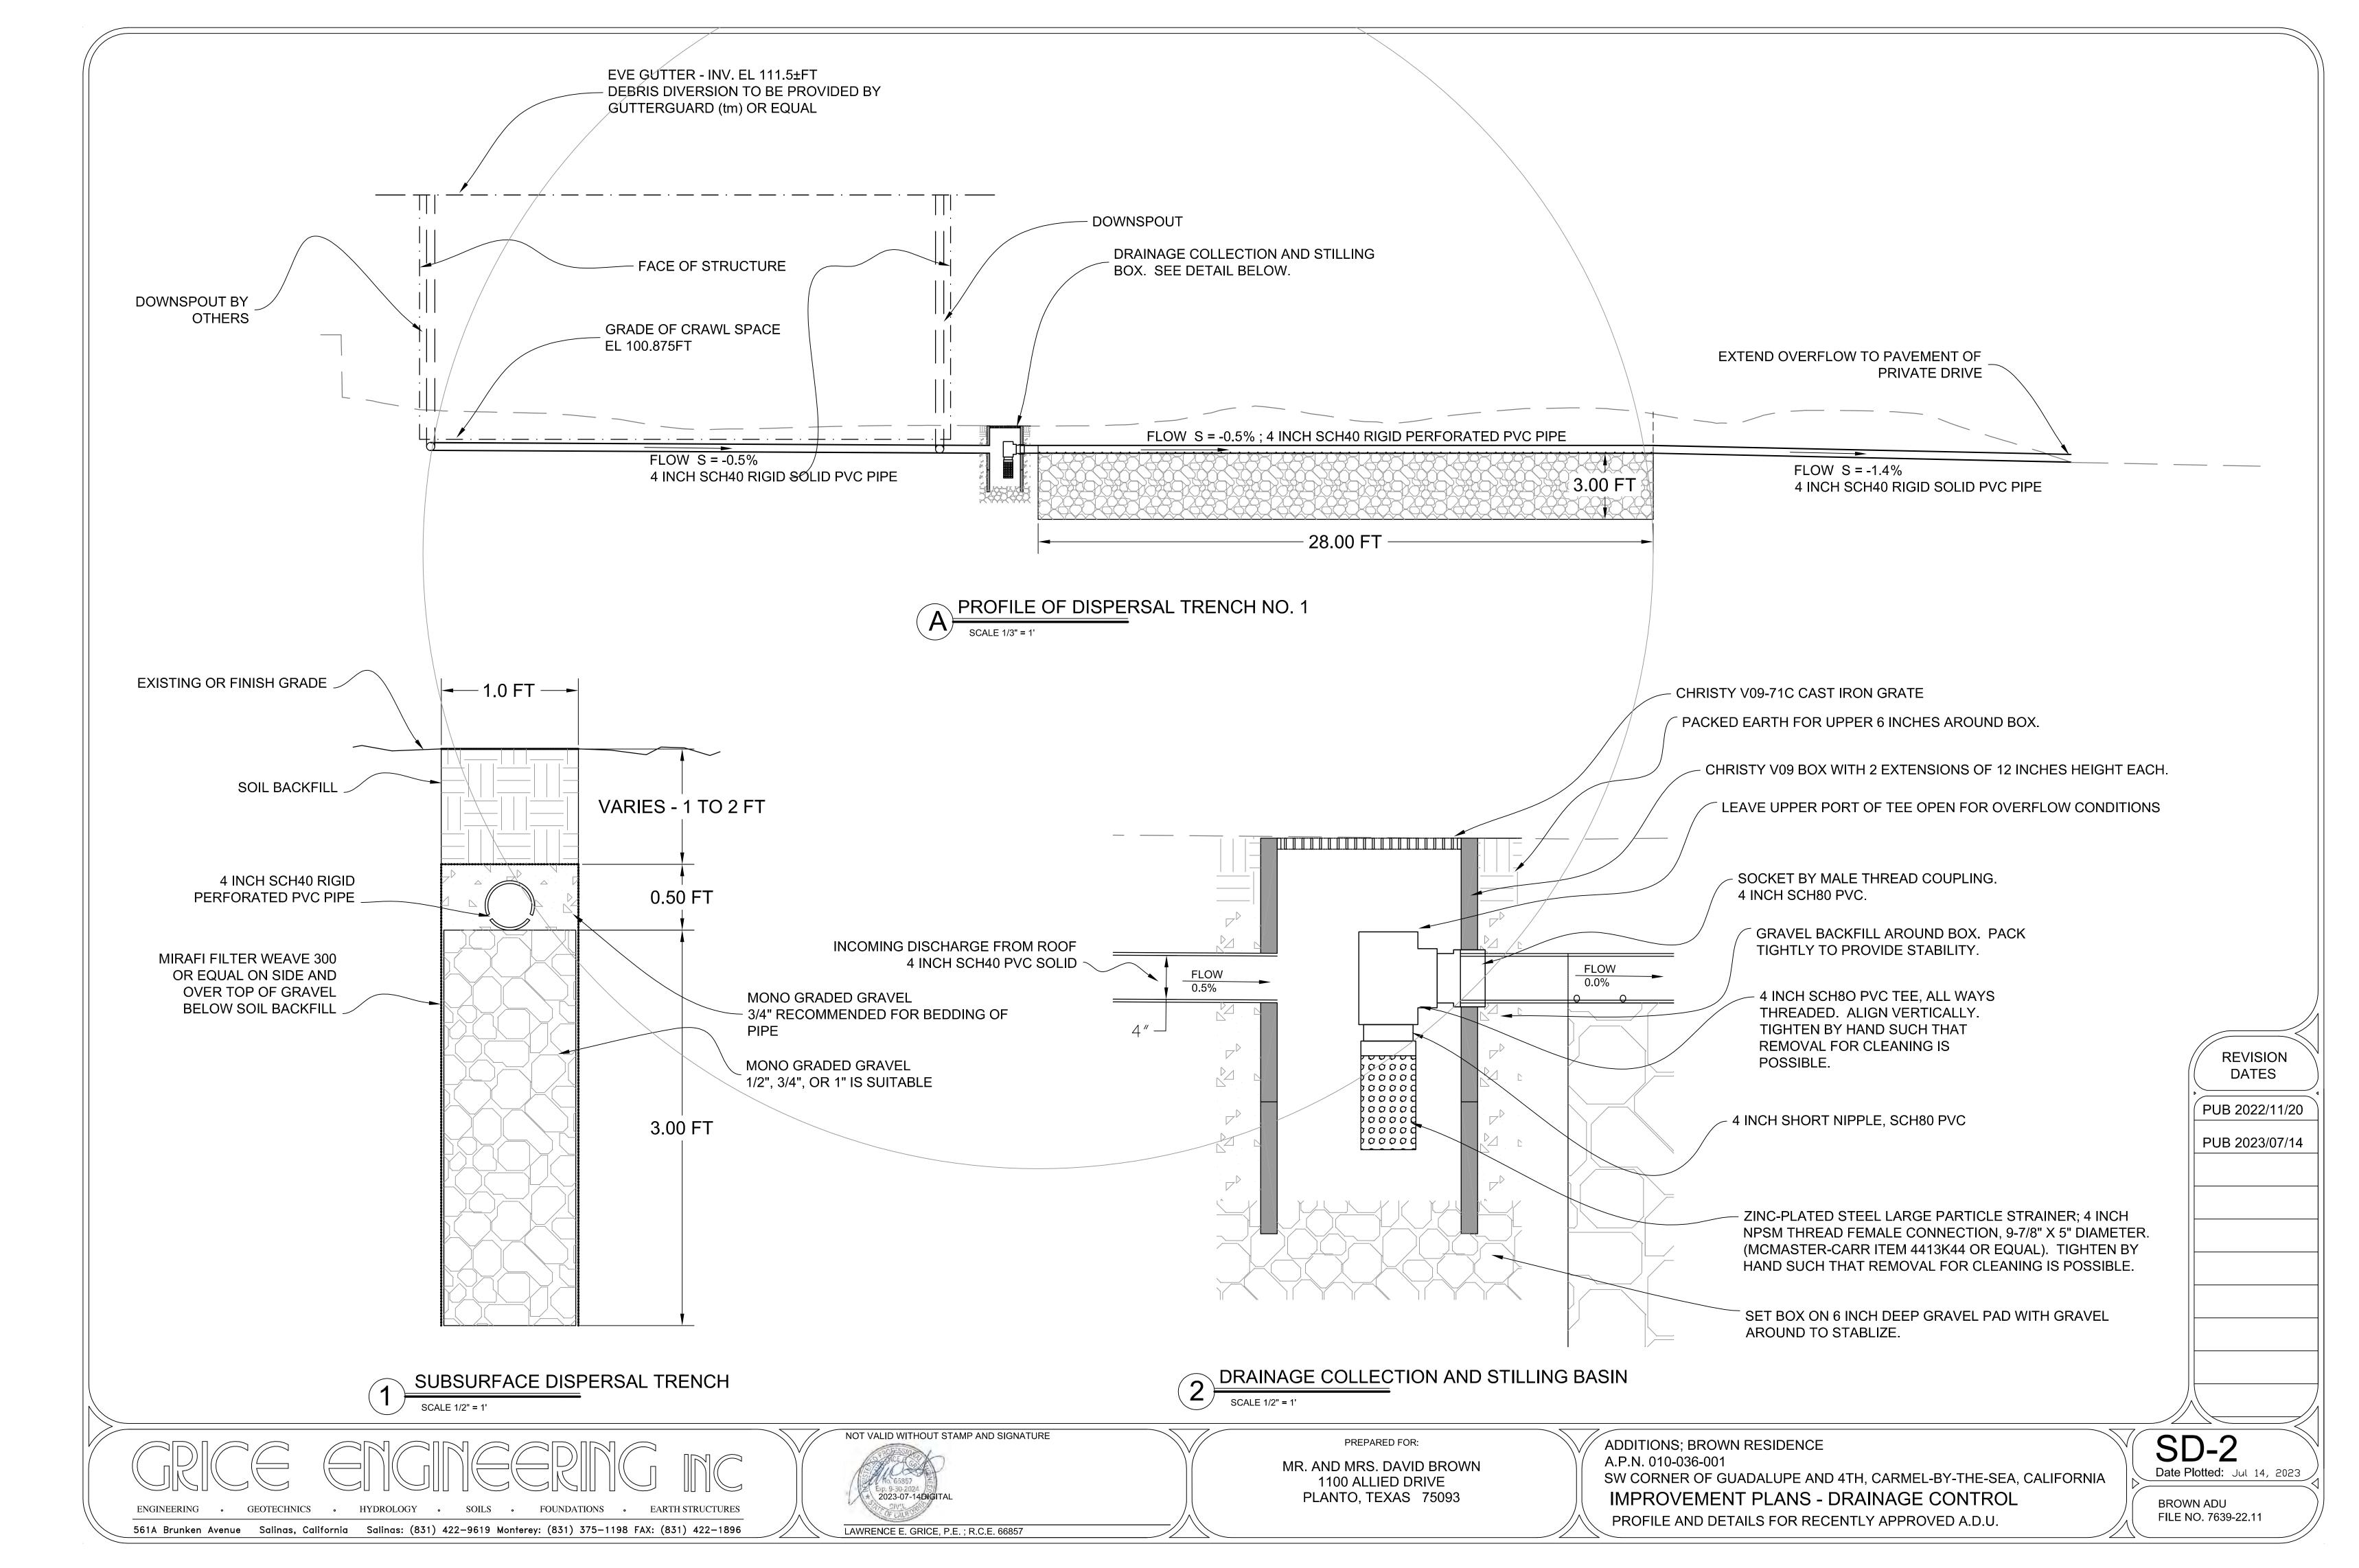


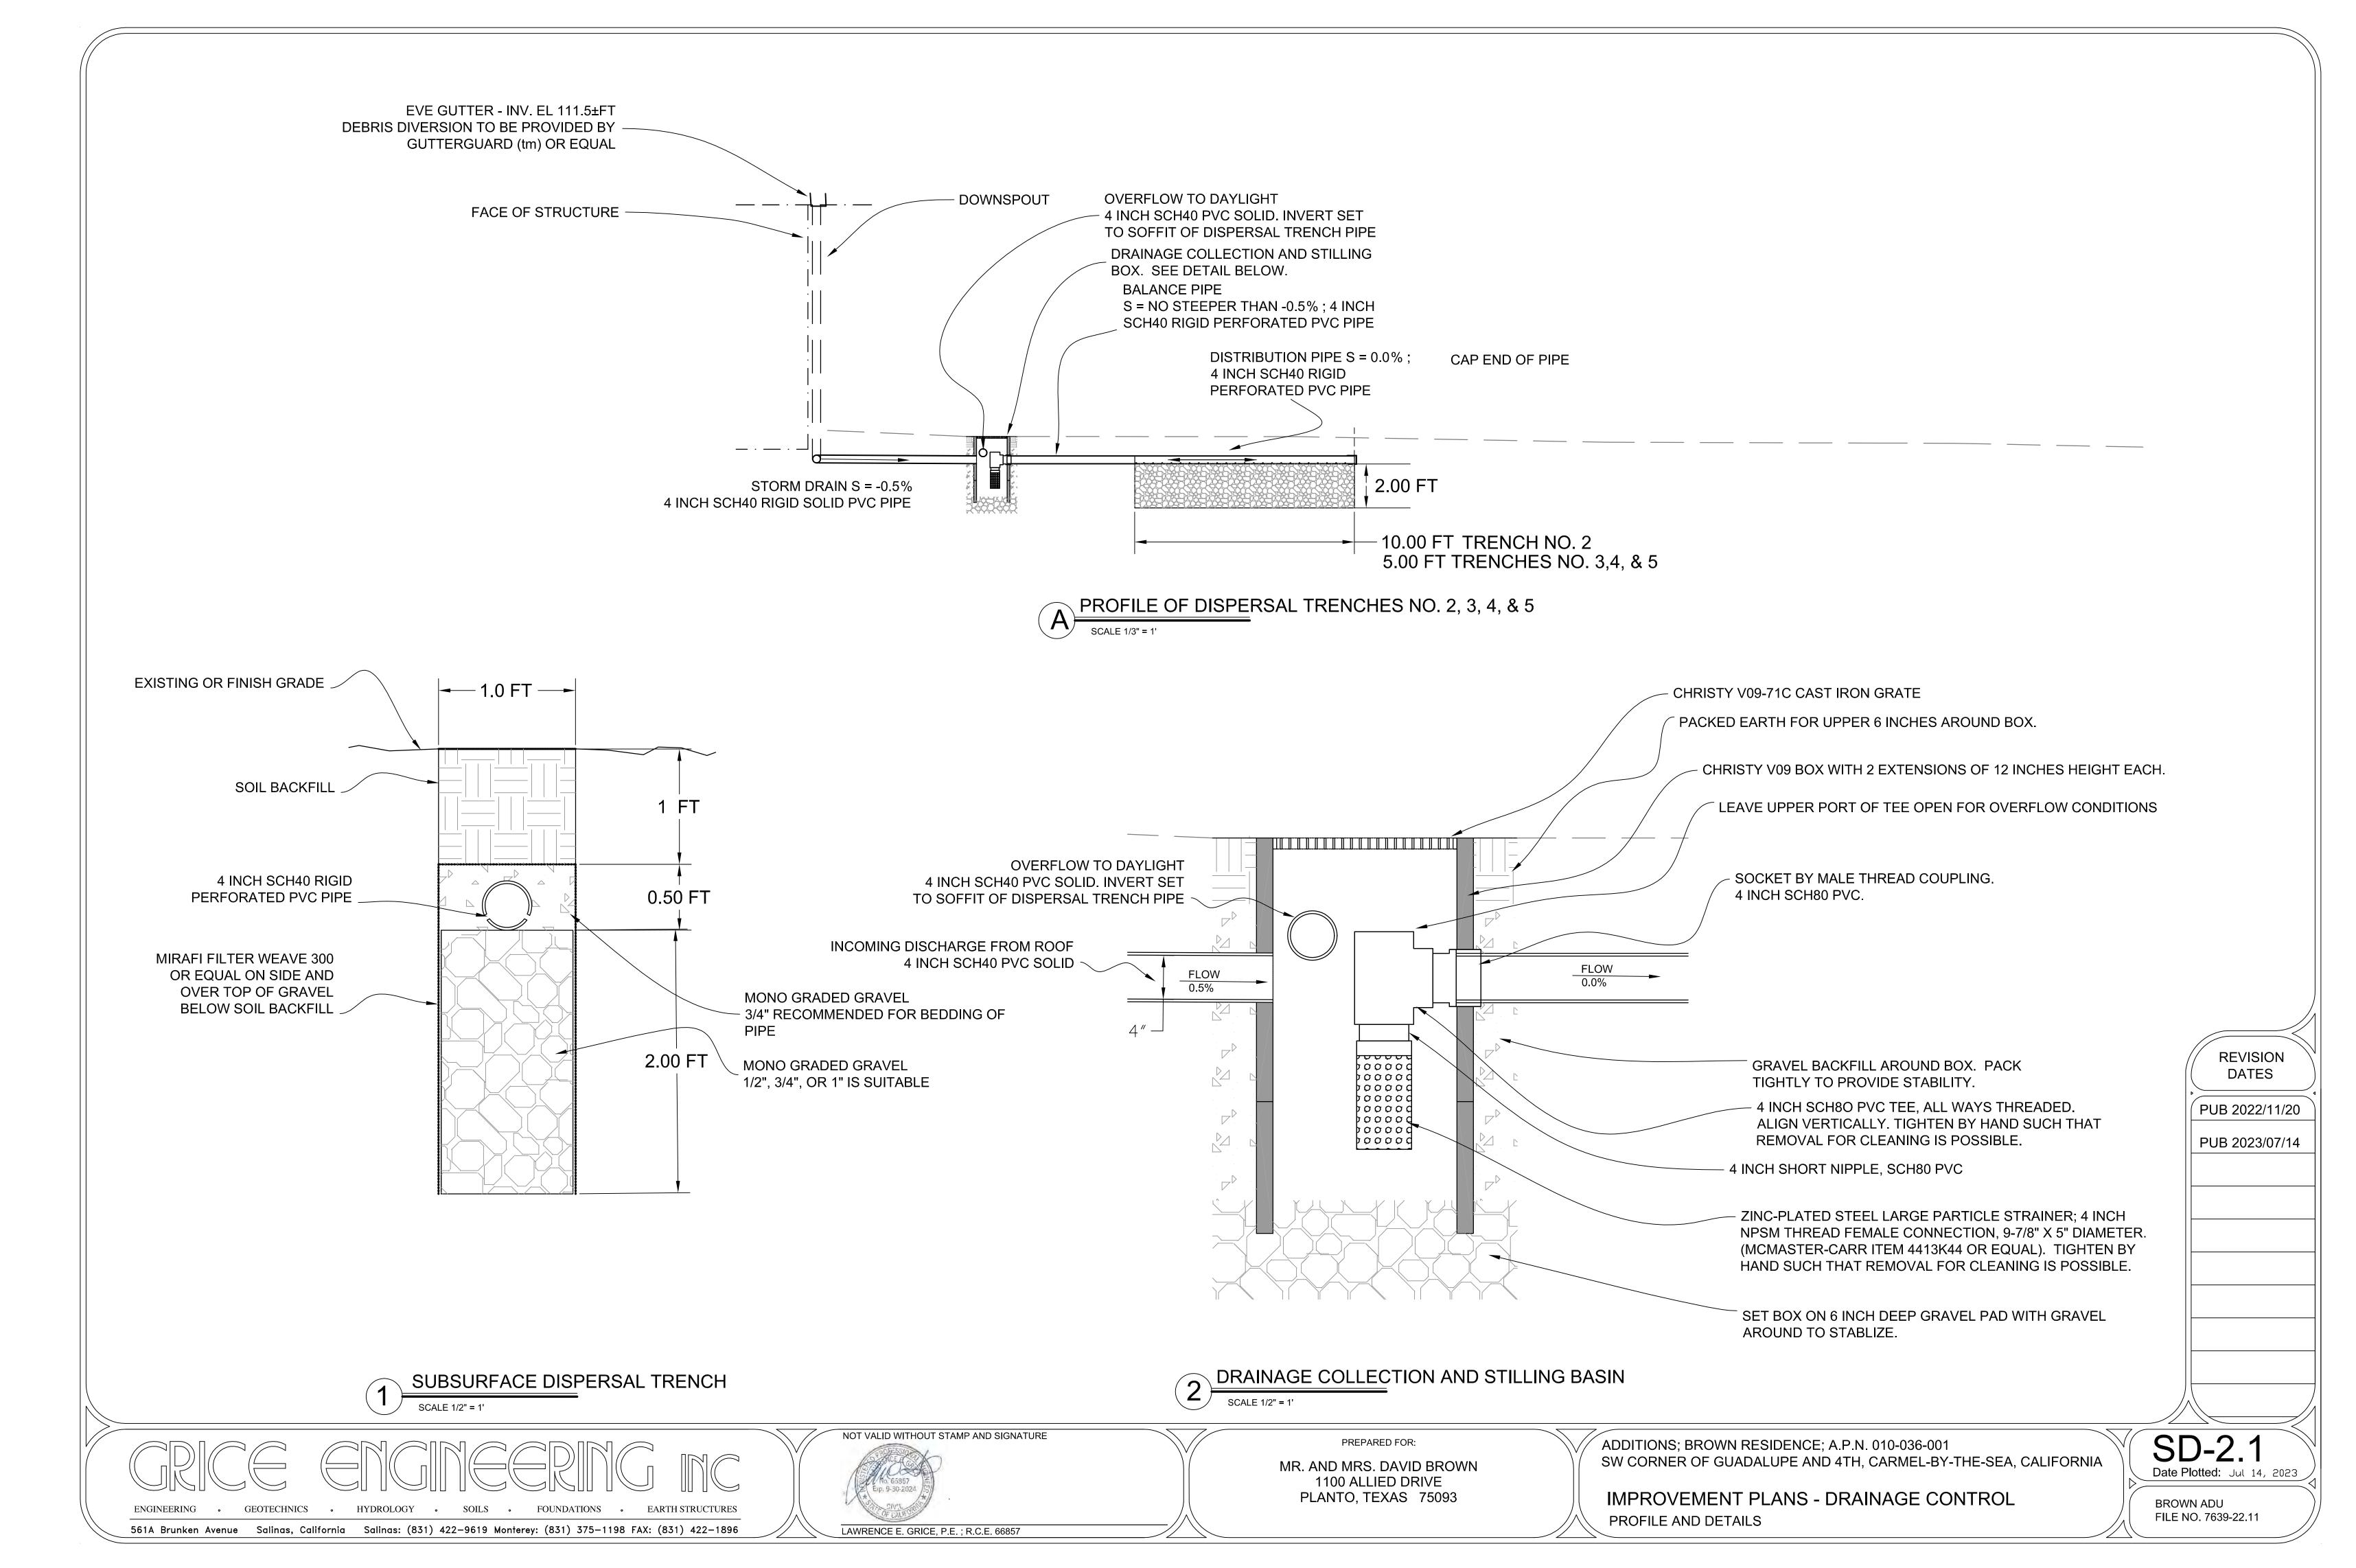

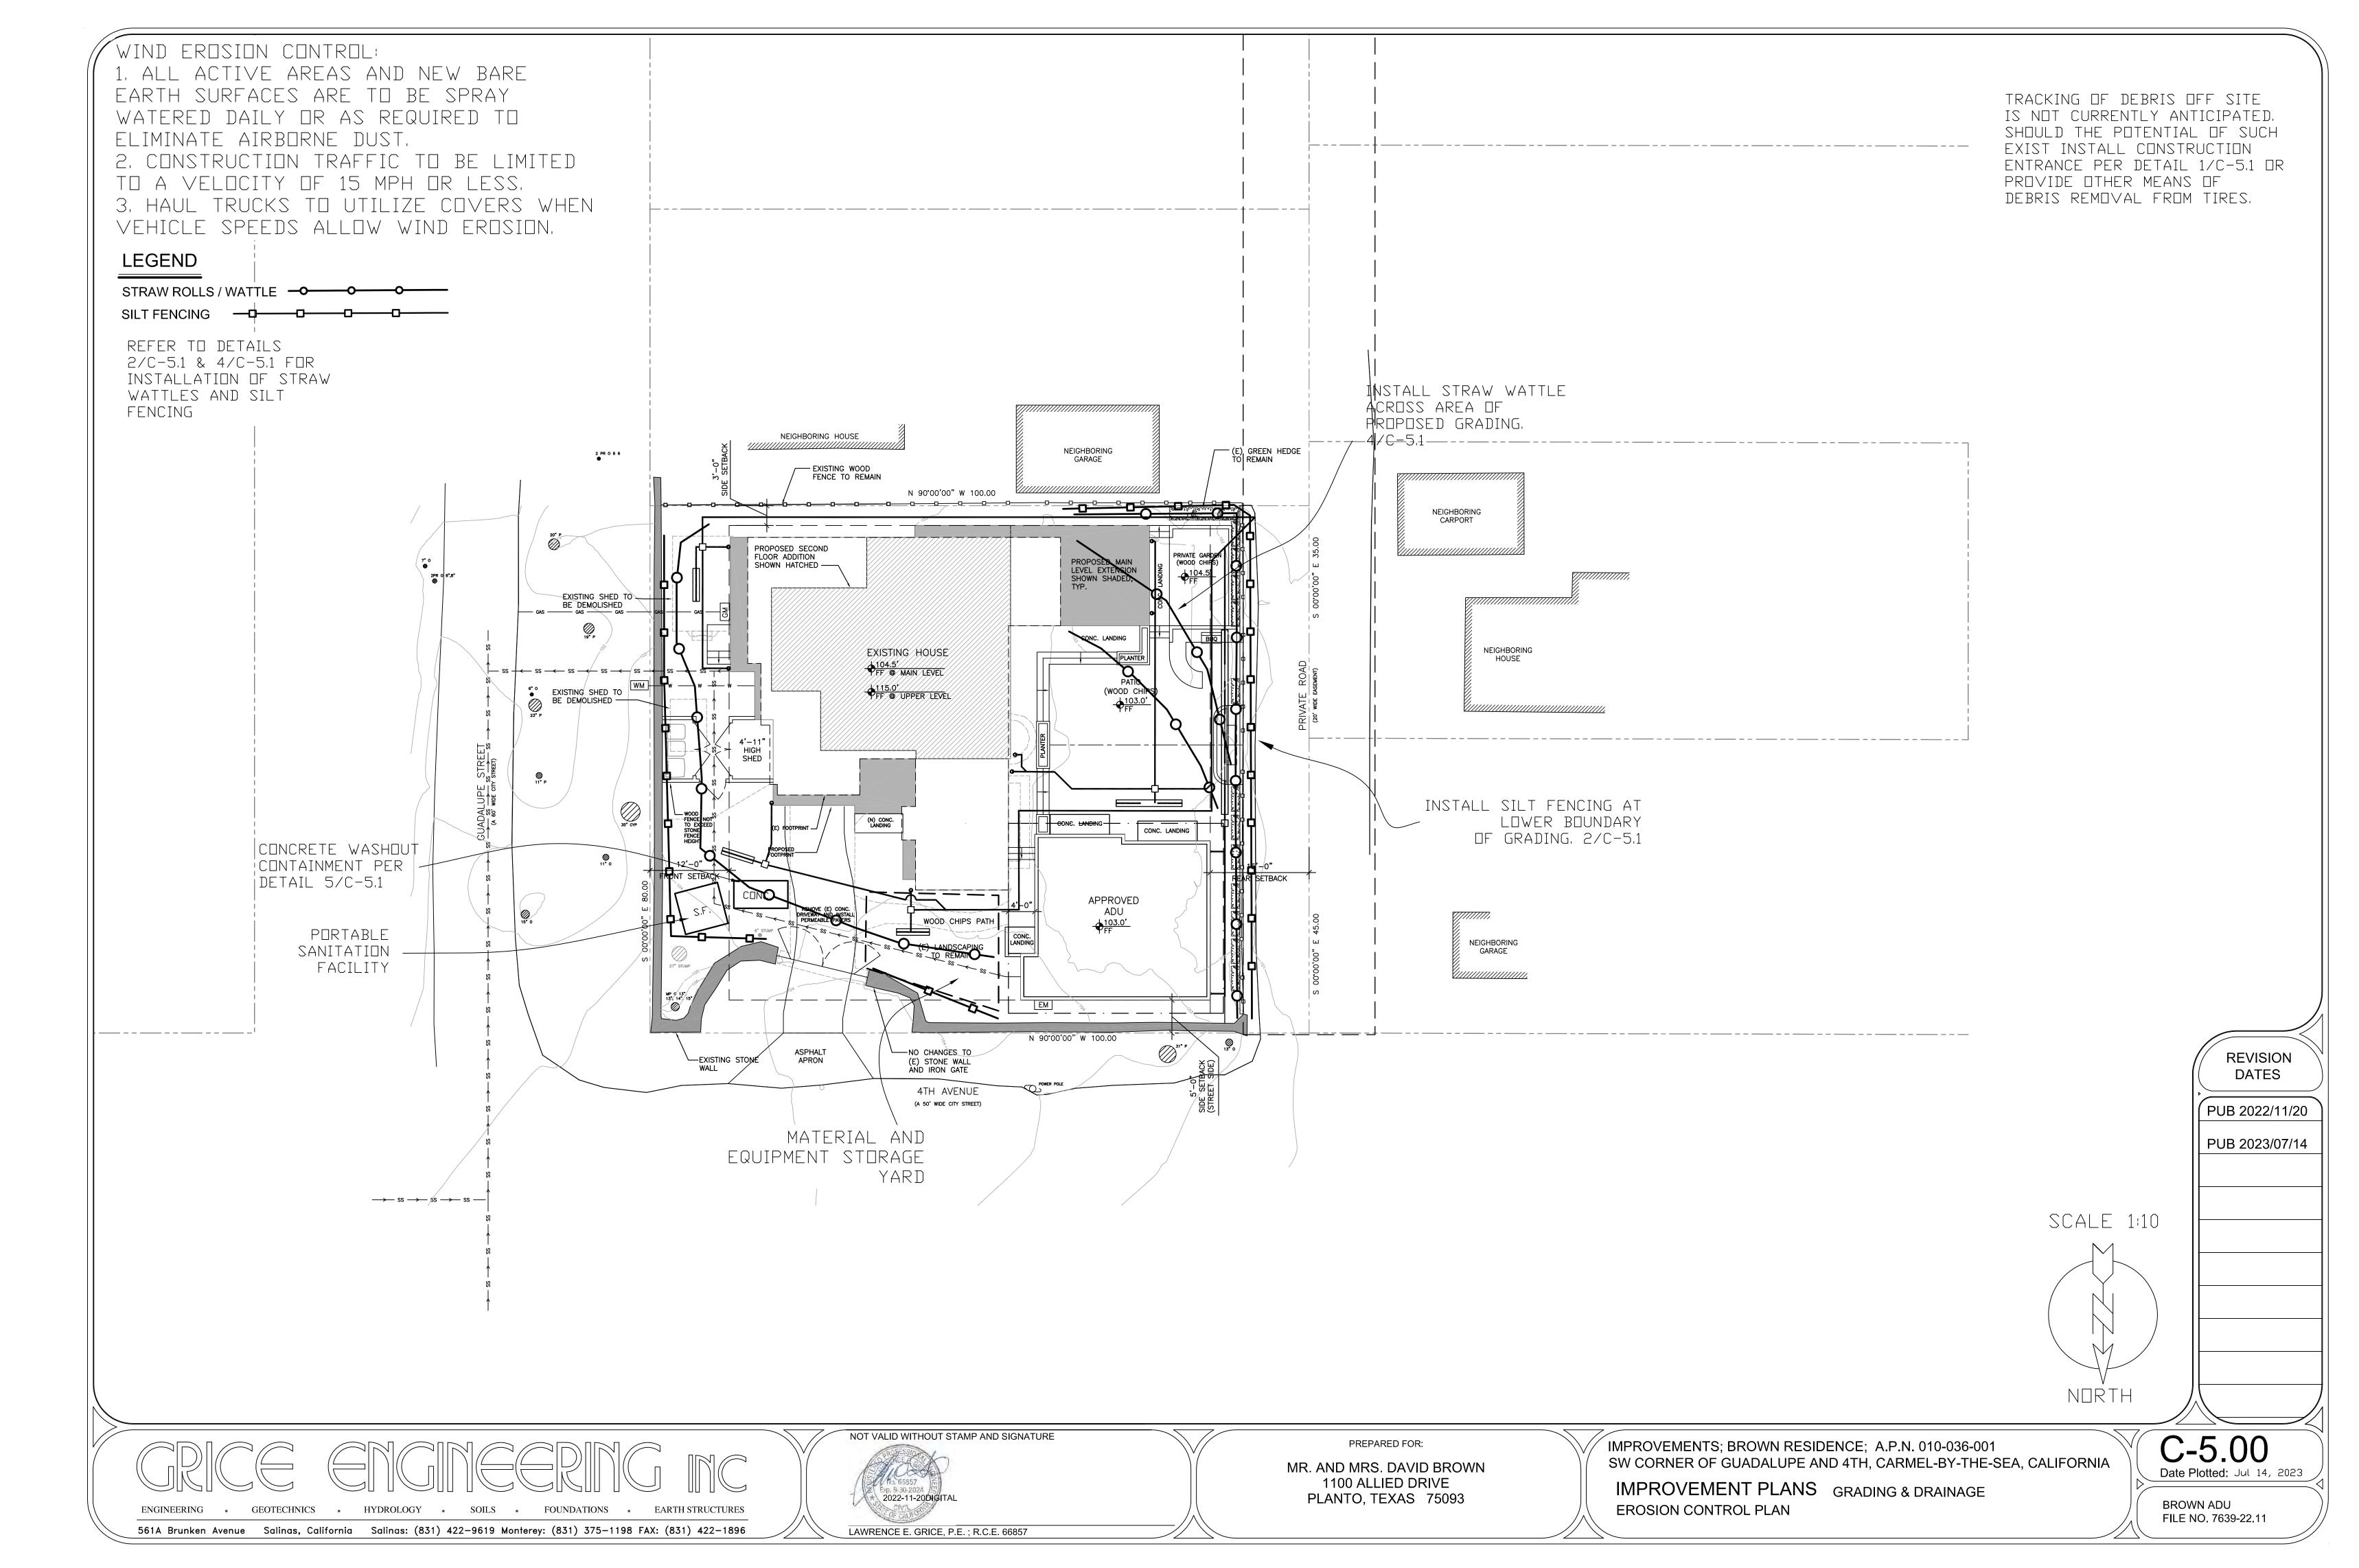


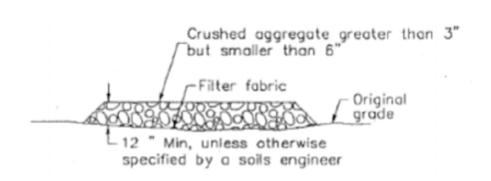


SECTION B-B

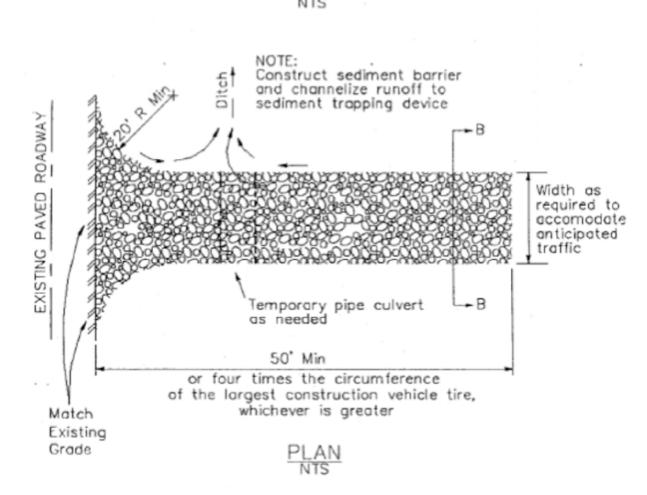

(1) CONSTRUCTION ENTRANCE

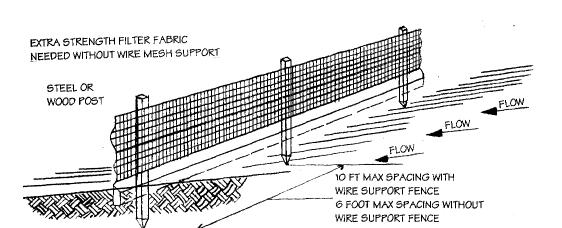

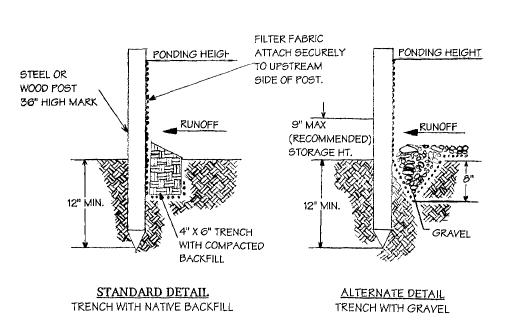

SILT FENCE


NOTE,

1. INSPECT AND REPAIR FENCE AFTER EACH
STORM EVENT AND REMOVE SEDIMENT WHEN
NECESSARY.

2. REMOVED SEDIMENT SHALL BE SEPOSITED
TO AN AREA THAT WILL NOT CONTRIBUTE
SEDIMENT OFF-SITE AND CAN BE PERMANENT
STABILIZED.


3. SILT FENCE SHALL BE PLACED ON SLOPE
CONTOURS TO MAXIMIZE PONDING EFFICIENCY.

SILT FENCE INSTALLATION DETAILS NOT TO SCALE

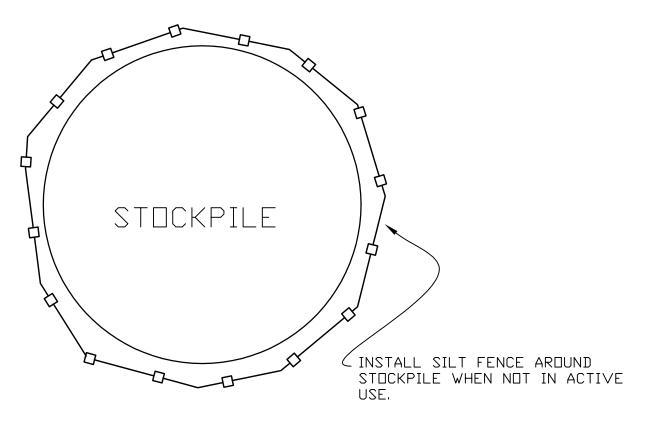

1. LOCATE STOCKPILES A MINIMUM OF 50 FEET AWAY FROM CONCENTRATED FLOW OF STORM WATER, DRAINAGE COURSES AND INLETS.
2. PROTECT ALL STOCKPILES FROM STORM WATER RUN-ON USING A TEMPORARY PERIMETER SEDIMENT BARRIER OF SILT FENCING.
3. IMPLEMENT WIND EROSION CONTROL PRACTICES AS APPROPRIATE ON ALL STOCKPILED MATERIAL.

3 TEMPORARY ACTIVE Stockpile management

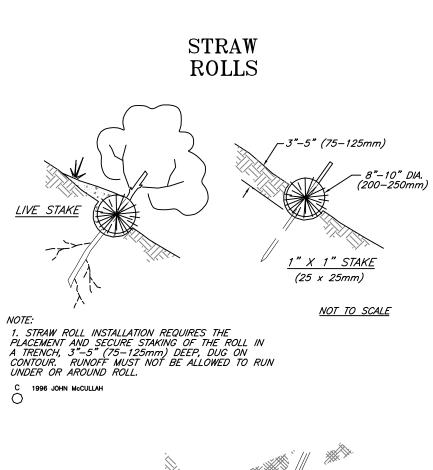

STRAW ROLLS MUST BE PLACED ALONG SLOPE CONTOURS

SPACING DEPENDS ON SOIL TYPE AND SLOPE STEEPNESS STRAW WATTLE INSTALLATION

Proper installation of the Straw Wattles is essential in order to insure the success of the product. Straw Wattles are designed for low surface flows, not to exceed 1 cfs for small areas. While they work well on stream banks, they should not be placed in the path of high waterflow. On slopes, Wattles should be installed on contour with a slight downward angle at the end of the row in order to prevent pooling at the mid-section. No overall slope preparation is needed prior to installation, however Straw Wattles should always be installed in shallow trenches according to the guidelines given below. Running lengths of Wattles should be abutted firmly to ensure no leakage at the abutments. Guidelines regarding vertical spacing are given below. The Wattles should be pinned securely to the ground according to instructions in order to insure their stability and the success of the installation.

SPACING - DOWN SLOPE

Vertical spacing for slope installations should be determined by site conditions: slope gradient and soil type are the main factors. A good rule-of-thumb is:

1:1 slopes = 10 feet apart 2:1 slopes = 20 feet apart

3:1 slopes = 30 feet apart

4:1 slopes = 40 feet apart, etc.

However, adjustments may have to be made for the soil type: For soft, loamy soils - adjust the rows closer together; For hard, rocky soils - adjust the rows further apart.

RENCHING

Use a hand tool such as a maddox or pick to score the ground. Using a shovel, dig the trench to the needed depth. Soil from excavating the trenches can be placed on the uphill, or flow side, of the trench to be used during installation.

For soft, loamy soils dig a 3 - 5 inch trench. For hard, rocky soils dig a 2 - 3 inch trench.

INSTALLING

- SEDIMENT, ORGANIC MATTER, AND NATIVE SEEDS ARE CAPTURED BEHIND THE ROLLS. Lay the first Straw Wattle snugly in the trench. No daylight should be seen under the Wattle. Pack soil from trenching against the Wattle on the uphill side. When installing running lengths of Straw Wattles, butt the second Wattle tightly against the first. DO NOT overlap the ends. Stake the Straw Wattles at each end and four foot on center. For example:

A 25 foot Wattle uses 6 stakes A 20 foot Wattle uses 5 stakes

A 12 foot Wattle uses 4 stakes

Stakes should be driven through the middle of the Wattle, leaving 2 - 3 inches of the stake protruding above the Wattle. A heavy sediment load will tend to pick the Wattle up and could pull it off the stakes if they are driven down too low. It may be necessary to make a hole in the Wattle with the pick end of your maddox in order to get the stake through the straw. When Straw Wattles are used for flat ground applications, drive the stakes straight down; when installing Wattles on slopes, drive the stakes

Drive the first end stake of the second Wattle at an angle toward the first Wattle in order to help abut them tightly together. If you have difficulty driving the stake into extremely hard or rocky slopes, a pilot bar may be needed to begin the stake hole.

FLAT GROUND APPLICATIONS

perpendicular to the slope.

For installations along sidewalks or behind curbs it may not be necessary to stake the Wattles, however trenches must still be dug. If you have not yet back-filled behind the sidewalk or curb, lay the Wattle snugly against it first, then backfill behind the Wattle: your trench is done! For installations around storm drains and inlets, trenches and staking will be needed.


Fit Wattle in trench snugly up against the sidewalk or curb. Around storm drains or inlets, the Wattle should be back 1 - 1 1/2 ft. and should direct water flow toward the angle of drainage. If all drainage angles into the inlet, snake the Wattle all the way around the inlet, using more than one Wattle if

STAKING

We recommend using wood stakes or willow cuttings, rather than metal pins, to secure the Straw Wattles. Wood stakes will eventually biodegrade, and willow cuttings will grow and provide extra stabilization. Be sure to use a stake that is long enough to protrude several inches above the Wattle: 18" is a good length for hard, rocky soil. For soft, loamy soil use a 24" stake for greater security. The diameter of the stake should be approximately 1" for ease of driving through the Wattle.

© 1997-2000 by California Straw Works.

WM-8 Concrete Waste Management

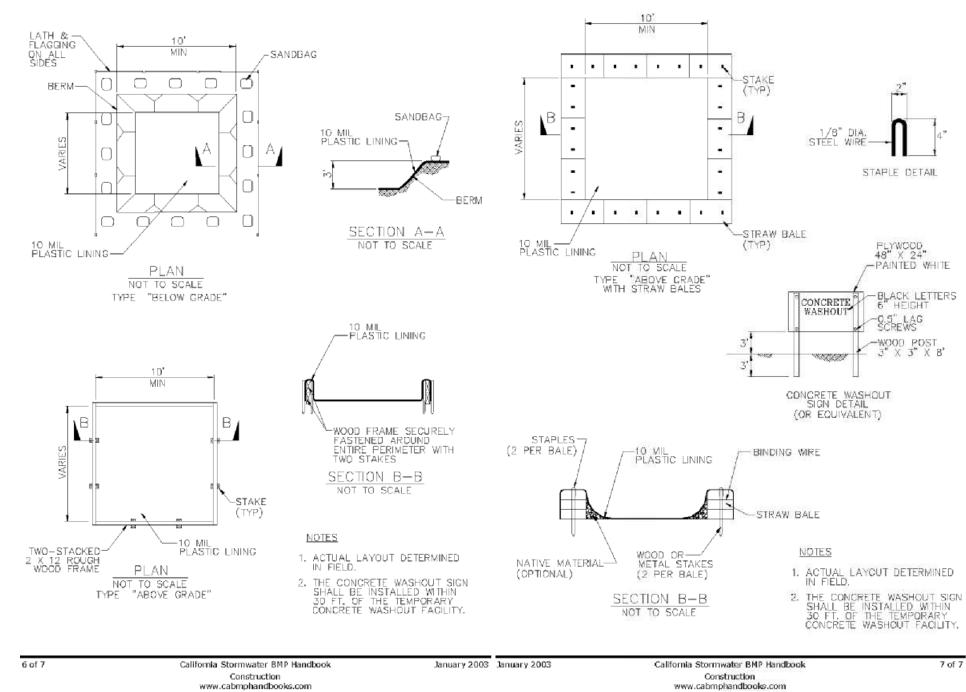


5 CONCRETE WASHOUT MANAGEMENT CONTRACTOR TO DETERMINE WHICH BASIN TO USE, ACCEPTABLE ALTERNATIVES INCLUDE PREFABRICATED ITEMS SUCH AS THE OUTPAK SERIES.

4) STRAW WADDLE DETAILS AND NOTES NOT TO SCALE

GINEERING • GEOTECHNICS • HYDROLOGY • SOILS • FOUNDATIONS • EARTH STRUCTURES

561A Brunken Avenue Salinas, California Salinas: (831) 422-9619 Monterey: (831) 375-1198 FAX: (831) 422-1896

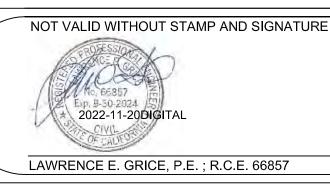

PREPARED FOR:

MR. AND MRS. DAVID BROWN 1100 ALLIED DRIVE PLANTO, TEXAS 75093 IMPROVEMENTS; BROWN RESIDENCE; A.P.N. 010-036-001
SW CORNER OF GUADALUPE AND 4TH, CARMEL-BY-THE-SEA, CALIFORNIA

EROSION CONTROL DETAILS

C-5.1

BROWN ADU FILE NO. 7639-22.11

Date Plotted: Jul 14, 2023

REVISION

DATES

PUB 2022/11/20

PUB 2023/07/14